




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

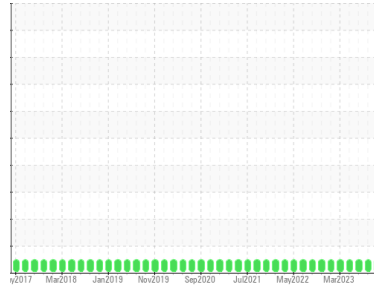

Machine Id  
**TURBINE-1**

Component  
**Turbine**

Fluid  
**MOBIL SHC 824 (275 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0850000</b>	WC0745755	WC0745754
Sample Date	Client Info			<b>29 Jan 2024</b>	05 Oct 2023	02 Aug 2023
Machine Age	hrs	Client Info		<b>11077</b>	8049	6796
Oil Age	hrs	Client Info		<b>67254</b>	64226	62834
Oil Changed	Client Info			<b>N/A</b>	Not Changd	Not Changd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.03	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	1
Lead	ppm	ASTM D5185m		<b>2</b>	0	0
Copper	ppm	ASTM D5185m	>5	<b>2</b>	0	<1
Tin	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>2</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	1	0
Phosphorus	ppm	ASTM D5185m		<b>1077</b>	1031	1024
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>17</b>	15	11

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>2</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	0	0


FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>2570</b>	1918	445
Particles >6µm		ASTM D7647	>1300	<b>809</b>	565	198
Particles >14µm		ASTM D7647	>160	<b>48</b>	19	24
Particles >21µm		ASTM D7647	>40	<b>11</b>	5	5
Particles >38µm		ASTM D7647	>10	<b>0</b>	2	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	1	0
Oil Cleanliness		ISO 4406 (c)	>20/17/14	<b>19/17/13</b>	18/16/11	16/15/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.5	<b>0.23</b>	0.22	0.23




# OIL ANALYSIS REPORT


### Particle Trend

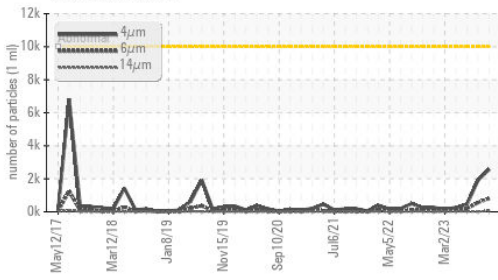


### Acid Number

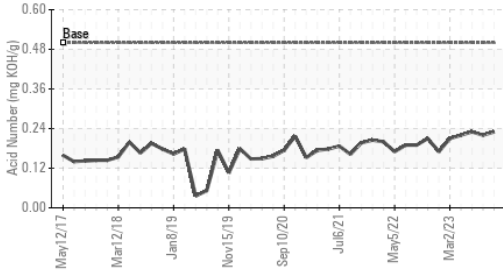

### Viscosity @ 40°C

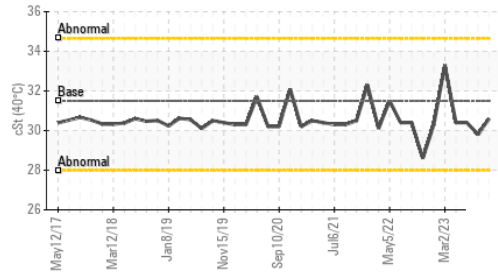

### Particle Trend

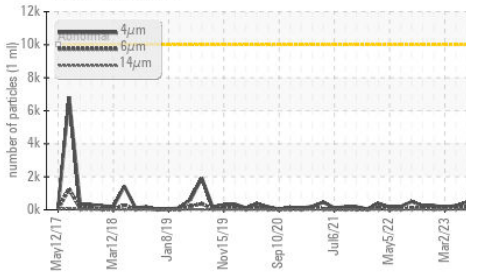

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	31.5	30.6	29.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

### Color




### Bottom




## GRAPHS


### Ferrous Alloys

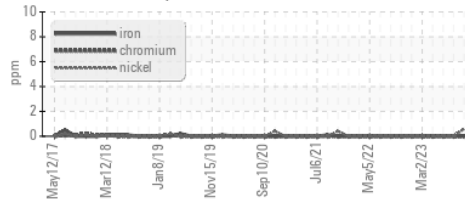


### Non-ferrous Metals

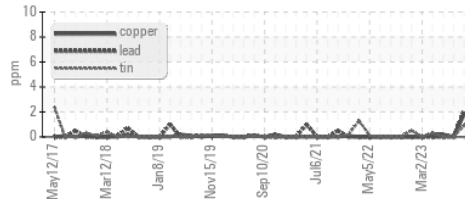


### Viscosity @ 40°C

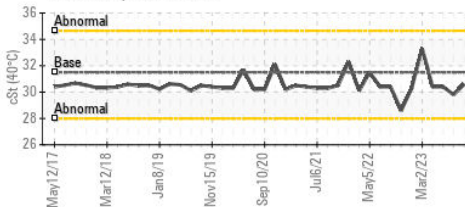

### Particle Count

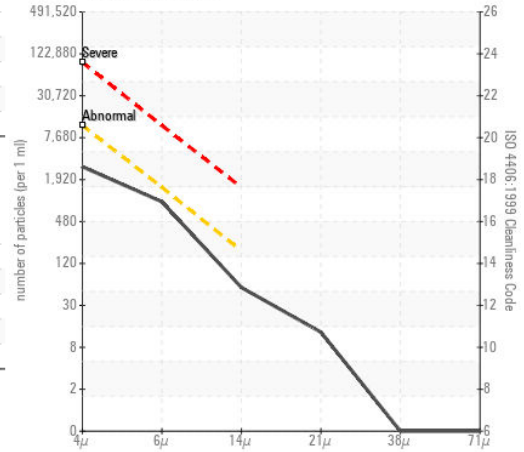

### Acid Number

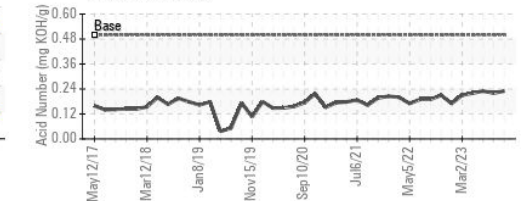

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0850000      **Received** : 01 Feb 2024  
 Lab Number : 06077655      **Diagnosed** : 04 Feb 2024  
 Unique Number : 10859746      **Diagnostician** : Don Baldrige  
 Test Package : IND 2

**GREENE VALLEY LANDFILL**  
 9 SOUTH 610 GREENE ROAD  
 NAPERVILLE, IL  
 US 60565  
 Contact: CHRIS ADEN  
 caden@wm.com  
 T: (630)743-4479  
 F: (630)983-1535

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)