


OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id KAESER DSD 250 8539559 (S/N 1372)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Sep2023	Jan 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC121837	KC124478	
Sample Date		Client Info		05 Jan 2024	29 Sep 2023	
Machine Age	hrs	Client Info		6796	5996	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	<1	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	1	<1	
Lead	ppm	ASTM D5185m	>10	2	<1	
Copper	ppm	ASTM D5185m	>50	3	5	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	10	0	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		2	<1	
Magnesium	ppm	ASTM D5185m	90	57	8	
Calcium	ppm	ASTM D5185m	2	2	1	
Phosphorus	ppm	ASTM D5185m		1	<1	
Zinc	ppm	ASTM D5185m		5	2	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m		16	0	
Potassium	ppm	ASTM D5185m	>20	9	2	
Water	%	ASTM D6304	>0.05	0.033	0.008	
ppm Water	ppm	ASTM D6304	>500	340	89.2	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		931	728	
Particles >6μm		ASTM D7647	>1300	294	214	
Particles >14μm		ASTM D7647	>80	22	17	
Particles >21µm		ASTM D7647		4	4	
Particles >38μm		ASTM D7647	>4	0	0	
Particles >71μm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/12	17/15/11	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.43	0.34	



OIL ANALYSIS REPORT

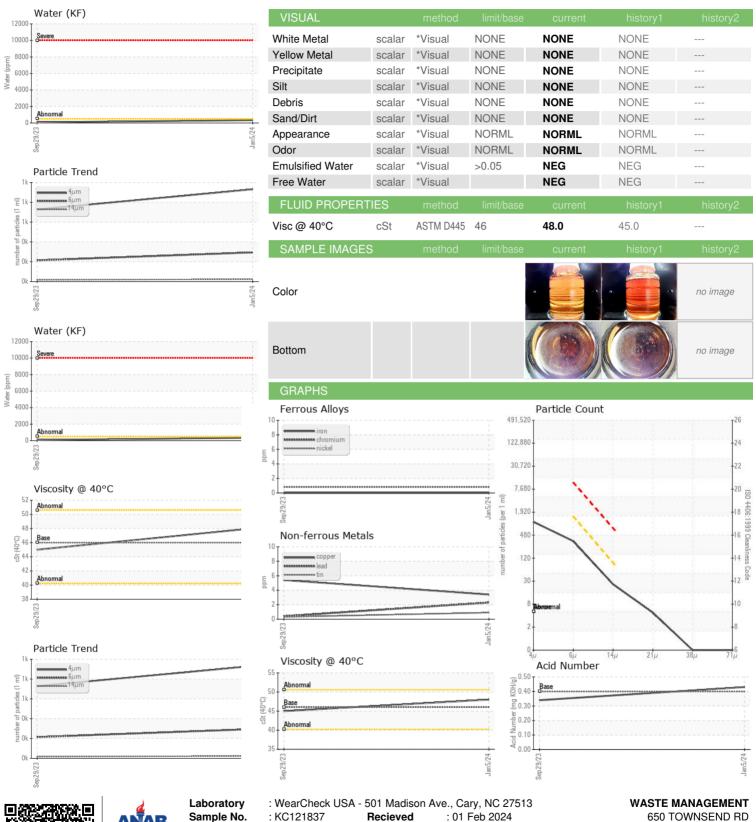





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC121837 : 06077677

: 10859768 : IND 2

: 01 Feb 2024 Recieved Diagnosed : 04 Feb 2024

Diagnostician : Don Baldridge

US 32926 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

COCOA, FL

T: F: