

OIL ANALYSIS REPORT

KAESER 8813129

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Sample Rating Trend ISO

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC96348		
Sample Date		Client Info		16 Jan 2024		
Machine Age	hrs	Client Info		2118		
Oil Age	hrs	Client Info		2118		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	1		
Lead	ppm	ASTM D5185m	>10	2		
Copper	ppm	ASTM D5185m	>50	4		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	26		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		2		
Magnesium	ppm	ASTM D5185m	90	79		
Calcium	ppm	ASTM D5185m	2	3		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		3		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		12		
Potassium	ppm	ASTM D5185m	>20	17		
Water	%	ASTM D6304	>0.05	0.008		
ppm Water	ppm	ASTM D6304	>500	87		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7354		
Particles >6µm		ASTM D7647	>1300	<u></u> 4 3530		
Particles >14μm		ASTM D7647	>80	<u> </u>		
Particles >21μm		ASTM D7647	>20	9		
Particles >38μm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/14		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.47		



OIL ANALYSIS REPORT

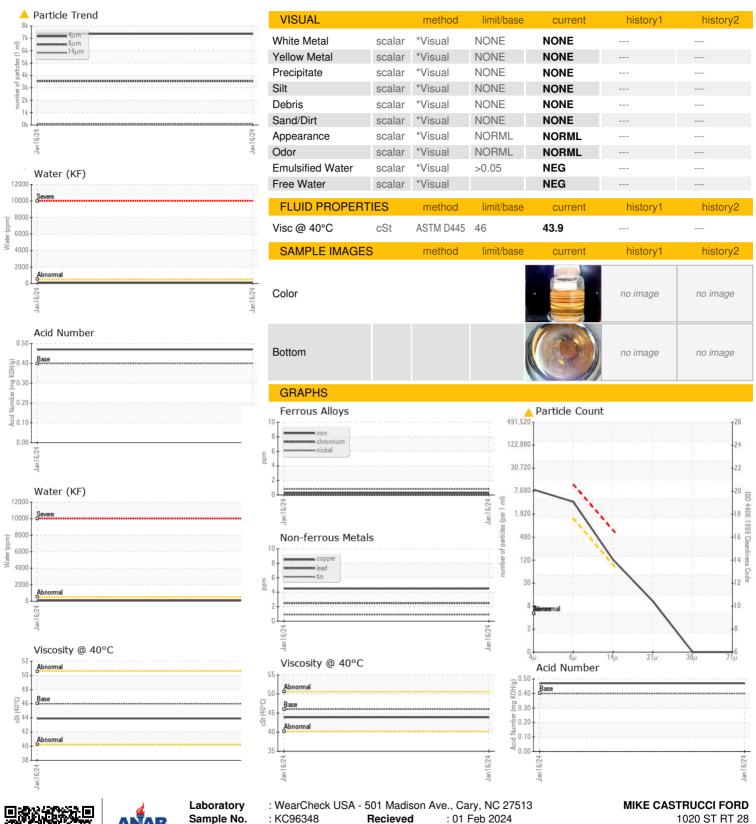





Certificate L2367

Sample No. Lab Number **Unique Number**

Test Package

: KC96348 : 06077682

: 10859773 : IND 2

Recieved Diagnosed Diagnostician

: 01 Feb 2024 : 04 Feb 2024 : Don Baldridge

US 45150 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

MILFORD, OH