


OIL ANALYSIS REPORT

Sample Rating Trend



WATER

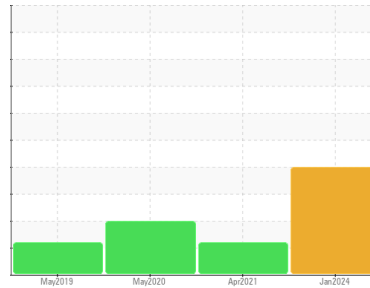

Machine Id
KAESER SK 20 6795452 (S/N 1015)

Component
Compressor

Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

▲ **Recommendation**

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ **Contamination**

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA008836	KCP28278	KCP26680
Sample Date	Client Info			25 Jan 2024	24 Apr 2021	01 May 2020
Machine Age	hrs	Client Info		16764	14146	6576
Oil Age	hrs	Client Info		0	3000	2000
Oil Changed	Client Info			N/A	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	6	<1	1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	<1
Aluminum	ppm	ASTM D5185m	>10	2	3	<1
Lead	ppm	ASTM D5185m	>10	2	0	0
Copper	ppm	ASTM D5185m	>50	4	3	15
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		<1	1	0
Cadmium	ppm	ASTM D5185m		<1	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	2	<1
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		2	0	<1
Magnesium	ppm	ASTM D5185m		2	<1	9
Calcium	ppm	ASTM D5185m		<1	0	0
Phosphorus	ppm	ASTM D5185m	500	214	113	55
Zinc	ppm	ASTM D5185m		206	73	149
Sulfur	ppm	ASTM D5185m		1587	1518	13147

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		3	0	3
Potassium	ppm	ASTM D5185m	>20	4	0	<1
Water	%	ASTM D6304	>0.05	▲ 0.236	0.004	0.005
ppm Water	ppm	ASTM D6304	>500	▲ 2360	40.0	52.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3628	12862	83472
Particles >6µm		ASTM D7647	>1300	▲ 1976	▲ 5732	▲ 39407
Particles >14µm		ASTM D7647	>80	▲ 336	▲ 667	▲ 1525
Particles >21µm		ASTM D7647	>20	▲ 113	▲ 93	▲ 170
Particles >38µm		ASTM D7647	>4	▲ 17	0	▲ 12
Particles >71µm		ASTM D7647	>3	▲ 2	0	▲ 1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 19/18/16	▲ 20/17	▲ 22/18

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.65	0.336	0.317


OIL ANALYSIS REPORT

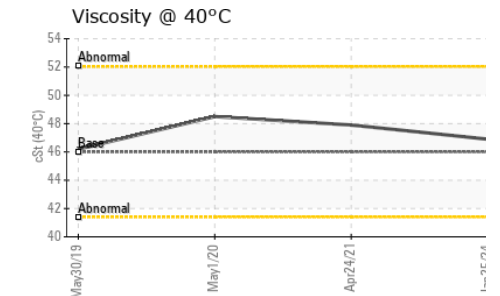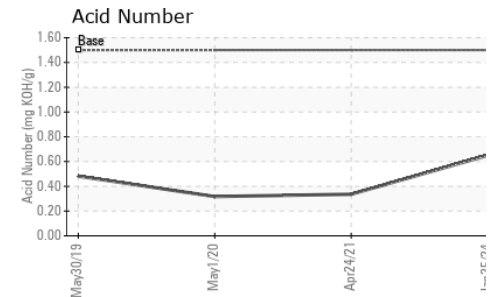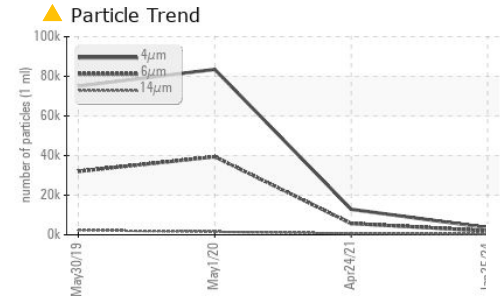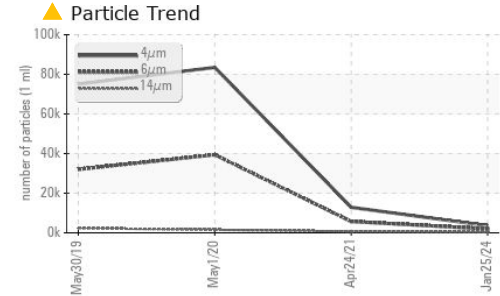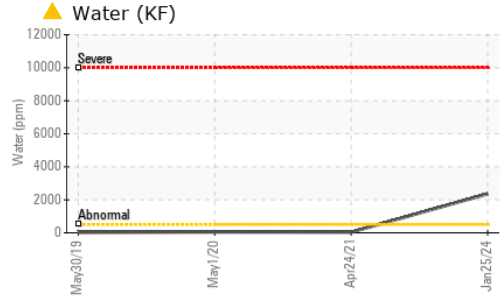






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.9	47.9	48.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

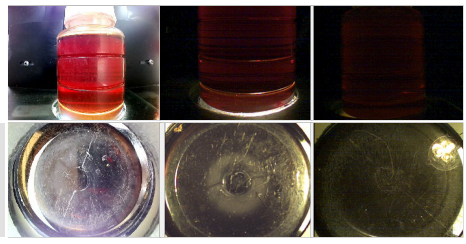

GRAPHS

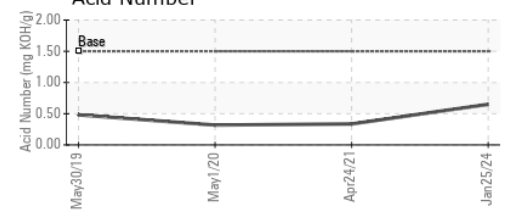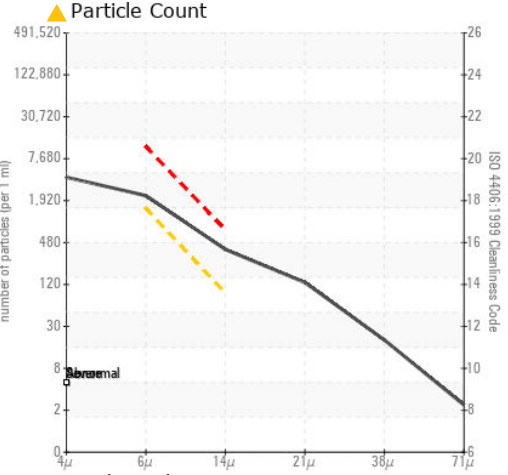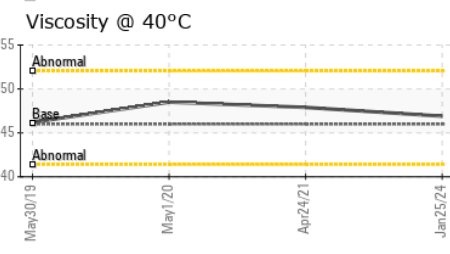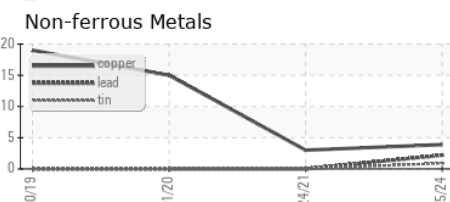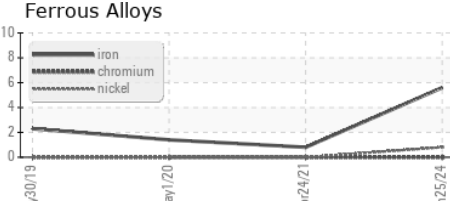

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA008836 **Received** : 01 Feb 2024
Lab Number : 06077688 **Diagnosed** : 07 Feb 2024
Unique Number : 10859779 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

GO MACRO
 415 S WAGONER AVE
 VIOLA, WI
 US 54664
 Contact: JEFF
 jeff@gomacro.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)