


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



# KAESER ASD 30 6581548 (S/N 1024)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jun2019	Oct2020 Apr2021	Nov2021 Mar2022 Dec2022	Dec2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC126530	KCP101631	KC96179
Sample Date		Client Info		27 Dec 2023	06 Dec 2022	04 Mar 2022
Machine Age	hrs	Client Info		14094	11172	8996
Oil Age	hrs	Client Info		0	2112	1002
Oil Changed		Client Info		N/A	Changed	Not Changd
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	<1
Aluminum	ppm	ASTM D5185m	>10	<1	0	<1
Lead	ppm	ASTM D5185m	>10	2	0	0
Copper	ppm	ASTM D5185m	>50	16	12	4
Tin	ppm	ASTM D5185m	>10	1	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		2	0	0
Magnesium	ppm	ASTM D5185m	90	1	2	<1
Calcium	ppm	ASTM D5185m	2	<1	<1	0
Phosphorus	ppm	ASTM D5185m		2	2	3
Zinc	ppm	ASTM D5185m		13	35	48
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	6	4
Sodium	ppm	ASTM D5185m		2	0	0
Potassium	ppm	ASTM D5185m	>20	3	<1	0
Water	%	ASTM D6304	>0.05	0.003	0.005	0.004
ppm Water	ppm	ASTM D6304	>500	30	51.7	45.0
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		298	170	18382
Particles >6µm		ASTM D7647	>1300	62	37	<b>4403</b>
Particles >14µm		ASTM D7647	>80	5	5	<b>△</b> 363
Particles >21µm		ASTM D7647	>20	2	1	<b>△</b> 63
Particles >38µm		ASTM D7647	>4	0	0	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	15/13/10	15/12/10	<b>△</b> 19/16
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.49	0.48	0.48



## **OIL ANALYSIS REPORT**

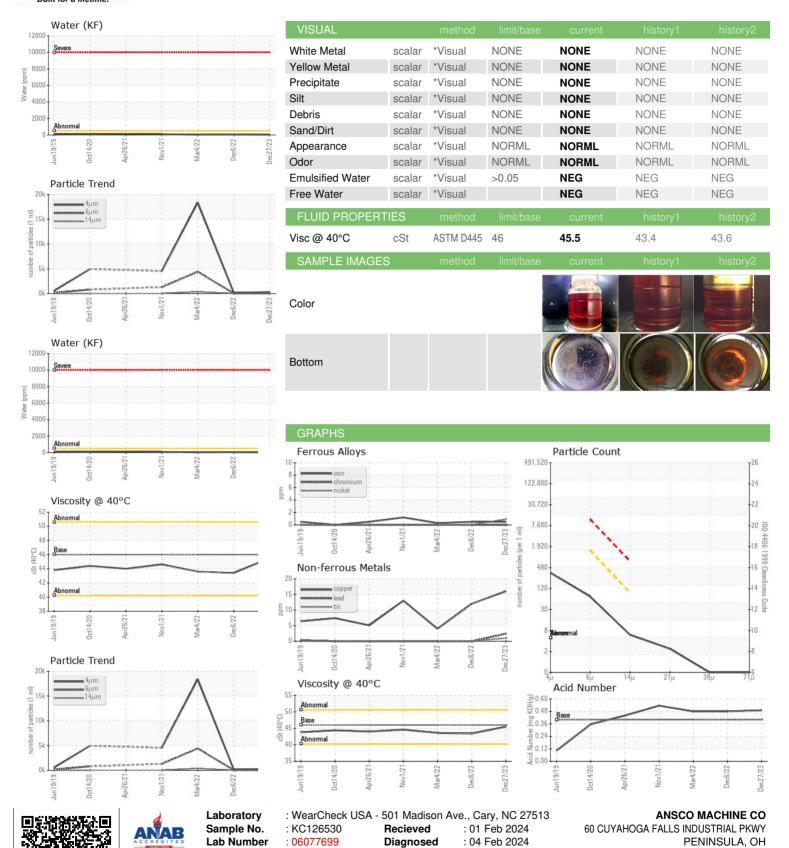

Certificate L2367

**Unique Number** 

Test Package

: 10859790

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: IND 2

Diagnostician

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: Don Baldridge

US 44264

T: F:

Contact: Service Manager