

OIL ANALYSIS REPORT



8799713 (S/N 1014)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

CAMPLE INCORNA	ATION			Janzuz4		1
SAMPLE INFORMA	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA010377		
Sample Date		Client Info		16 Jan 2024		
Machine Age	hrs	Client Info		4920		
- 3-	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	11		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	3		
Copper	ppm	ASTM D5185m	>50	17		
	ppm	ASTM D5185m	>10	1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m		2		
Magnesium	ppm	ASTM D5185m	100	2		
Calcium	ppm	ASTM D5185m	0	1		
Phosphorus	ppm	ASTM D5185m	0	7		
Zinc	ppm	ASTM D5185m	0	<1		
Sulfur	ppm	ASTM D5185m	23500	15413		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.013		
ppm Water	ppm	ASTM D6304	>500	130		
FLUID DEGRADAT	TION	method	limit/base	current	history1	history2
Anial Nivershaw (ANI)	I/OII/-	ACTM DOOM	1.0	0.00		


0.36

Acid Number (AN)

mg KOH/g ASTM D8045 1.0



OIL ANALYSIS REPORT

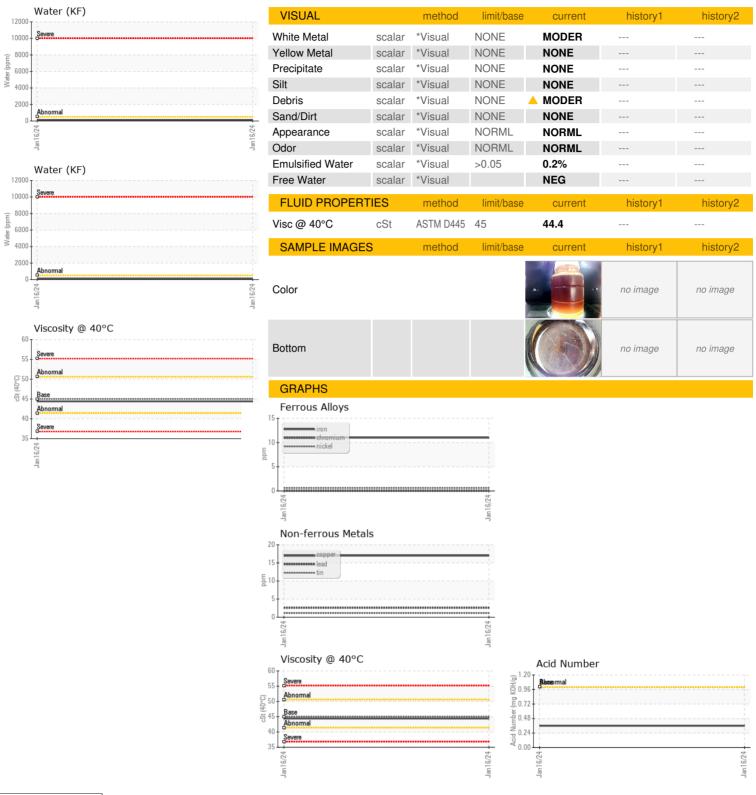





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: 06077707

: 10859798

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Recieved : KCPA010377 Diagnosed

: 05 Feb 2024 Diagnostician : Jonathan Hester

: 01 Feb 2024

Test Package : IND 2 (Additional Tests: KF, PrtCount)

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

SANTA CLARA VALLEY WATER DISTRICT

4190 ZANKER RD SAN JOSE, CA US 95134

Contact: B TURNER

BTURNER@VALLEYWATER.ORG

T: F: