




# OIL ANALYSIS REPORT

Sample Rating Trend

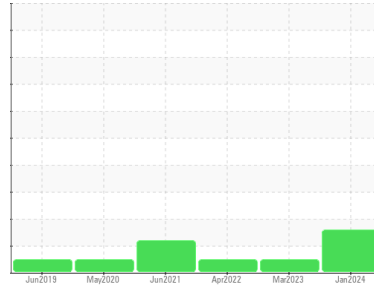

ISO



Machine Id  
**KAESER SFC 90S 5558285 (S/N 2181)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCPA004787</b>	KCPA001220	KCP44670
Sample Date	Client Info	<b>24 Jan 2024</b>	24 Mar 2023	07 Apr 2022
Machine Age	hrs	<b>33339</b>	30094	21912
Oil Age	hrs	<b>0</b>	0	7018
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>4</b>	<1	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m >10	<b>8</b>	3	2
Lead	ppm	ASTM D5185m >10	<b>2</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>8</b>	7	6
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m 90	<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>2</b>	0	0
Magnesium	ppm	ASTM D5185m 100	<b>17</b>	<1	4
Calcium	ppm	ASTM D5185m 0	<b>1</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>2</b>	7	4
Zinc	ppm	ASTM D5185m 0	<b>73</b>	53	2
Sulfur	ppm	ASTM D5185m 23500	<b>19180</b>	19534	11794

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>1</b>	1	<1
Sodium	ppm	ASTM D5185m	<b>12</b>	1	4
Potassium	ppm	ASTM D5185m >20	<b>8</b>	<1	7
Water	%	ASTM D6304 >0.05	<b>0.018</b>	0.007	0.005
ppm Water	ppm	ASTM D6304 >500	<b>185</b>	77.2	51.4






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>80377</b>	732	3146
Particles >6µm	ASTM D7647 >1300	<b>▲ 17825</b>	206	353
Particles >14µm	ASTM D7647 >80	<b>▲ 343</b>	24	21
Particles >21µm	ASTM D7647 >20	<b>▲ 47</b>	8	6
Particles >38µm	ASTM D7647 >4	<b>1</b>	0	0
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>▲ 24/21/16</b>	17/15/12	16/12

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.42</b>	0.45	0.46


# OIL ANALYSIS REPORT

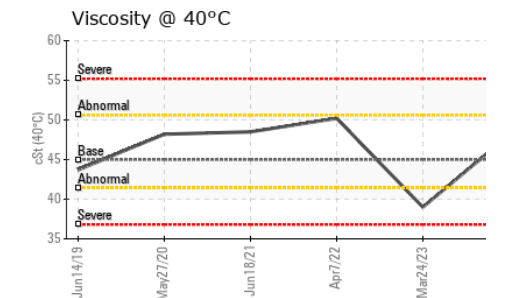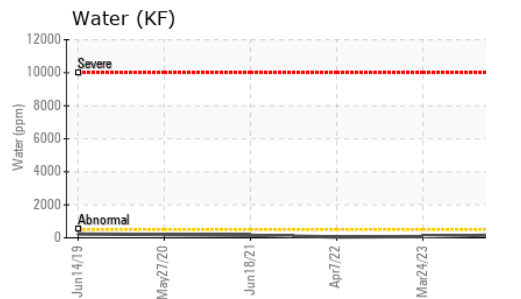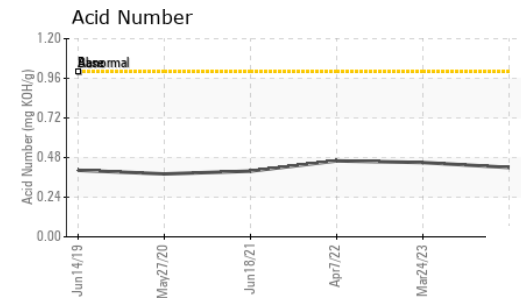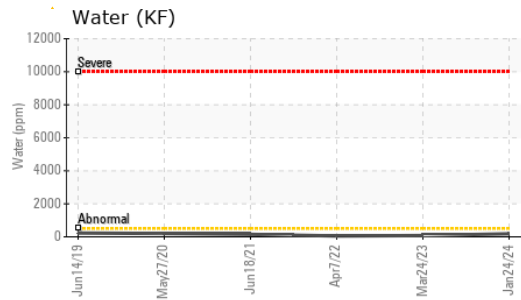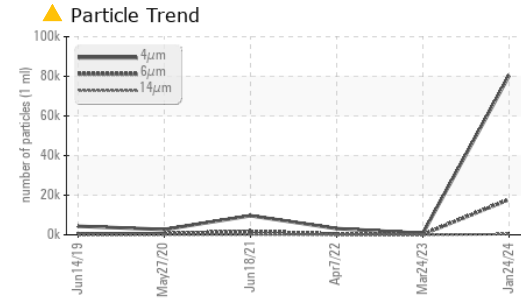





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	<b>48.1</b>	39.0	50.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

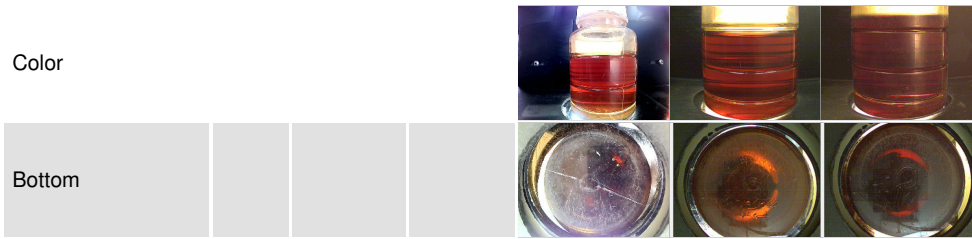

## GRAPHS

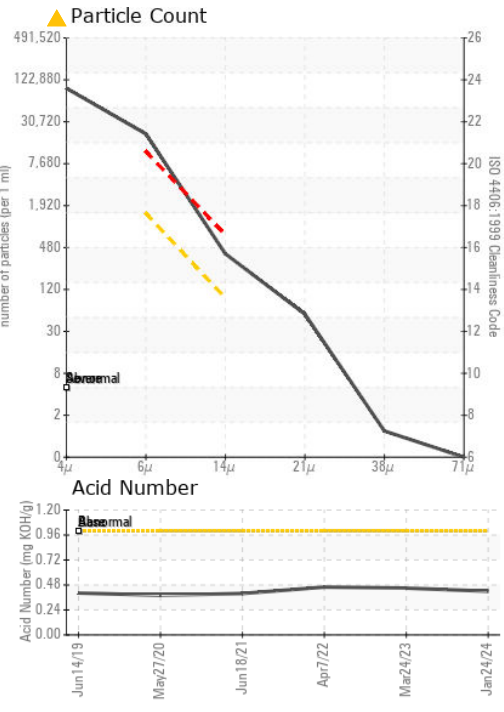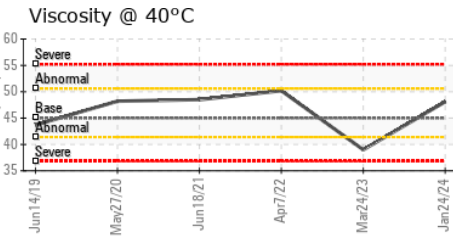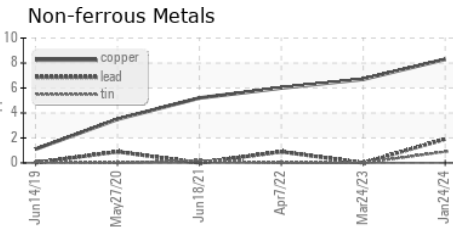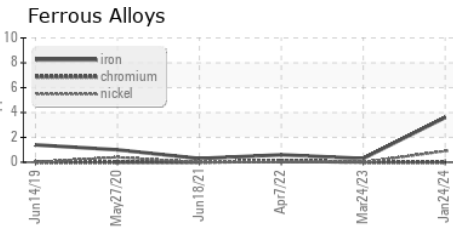

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA004787 **Received** : 01 Feb 2024  
**Lab Number** : 06077709 **Diagnosed** : 04 Feb 2024  
**Unique Number** : 10859800 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**PROGRESS RAIL SERVICES**  
 1185 INDUSTRIAL BLVD  
 BOAZ, AL  
 US 35950  
 Contact: D DILLARD  
 DDILLARD@PROGRESSRAIL.COM  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)