


Machine Id
KAESER ASD 25 5462748 (S/N 1117)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

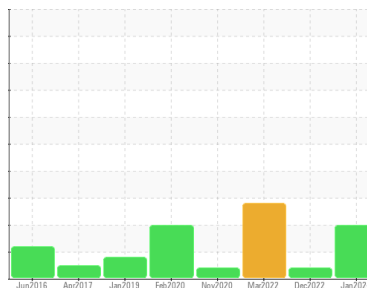

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA011736	KCP47670	KCP44451
Sample Date	Client Info			08 Jan 2024	05 Dec 2022	31 Mar 2022
Machine Age	hrs	Client Info		9365	8069	8068
Oil Age	hrs	Client Info		0	1909	1908
Oil Changed	Client Info			N/A	Changed	Not Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	2	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	2	3	2
Lead	ppm	ASTM D5185m	>10	2	0	0
Copper	ppm	ASTM D5185m	>50	14	13	14
Tin	ppm	ASTM D5185m	>10	1	0	<1
Antimony	ppm	ASTM D5185m		---	---	---
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	<1	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		2	<1	0
Magnesium	ppm	ASTM D5185m	90	35	17	7
Calcium	ppm	ASTM D5185m	2	<1	<1	0
Phosphorus	ppm	ASTM D5185m		2	7	5
Zinc	ppm	ASTM D5185m		222	207	195
Sulfur	ppm	ASTM D5185m		18468	20696	16002

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		16	5	4
Potassium	ppm	ASTM D5185m	>20	8	2	0
Water	%	ASTM D6304	>0.05	0.019	0.022	▲ 0.433
ppm Water	ppm	ASTM D6304	>500	197	225.1	▲ 4330

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		90396	---	---
Particles >6µm		ASTM D7647	>1300	▲ 24764	---	---
Particles >14µm		ASTM D7647	>80	▲ 1171	---	---
Particles >21µm		ASTM D7647	>20	▲ 248	---	---
Particles >38µm		ASTM D7647	>4	▲ 7	---	---
Particles >71µm		ASTM D7647	>3	1	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 24/22/17	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.45	0.42	0.39


OIL ANALYSIS REPORT

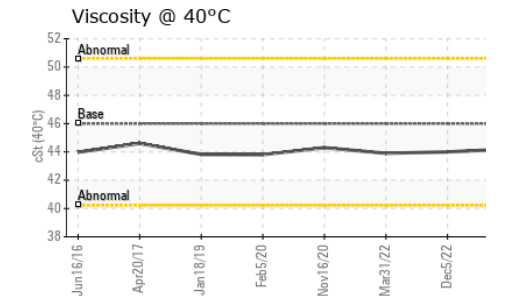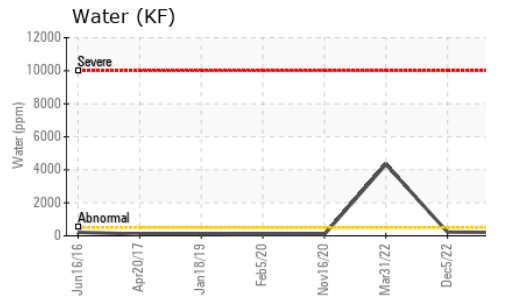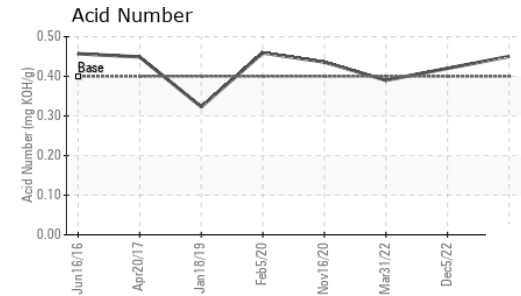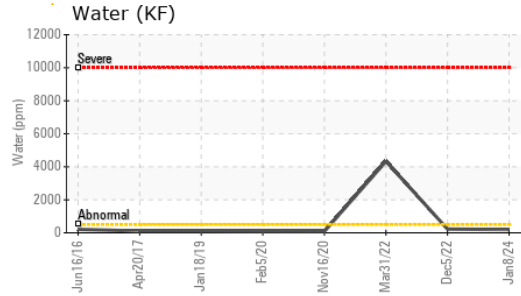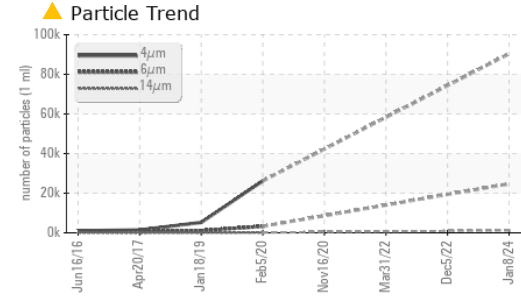





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	▲ HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.2	44.0	43.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

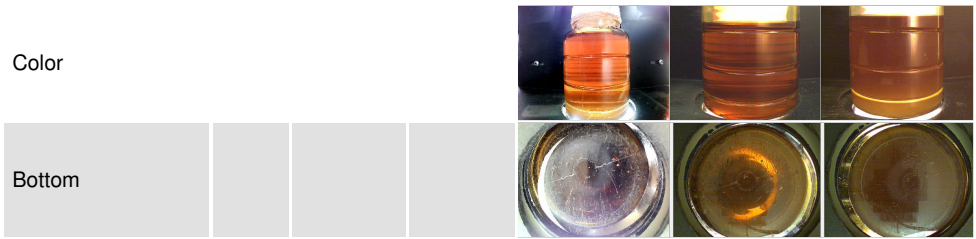

GRAPHS

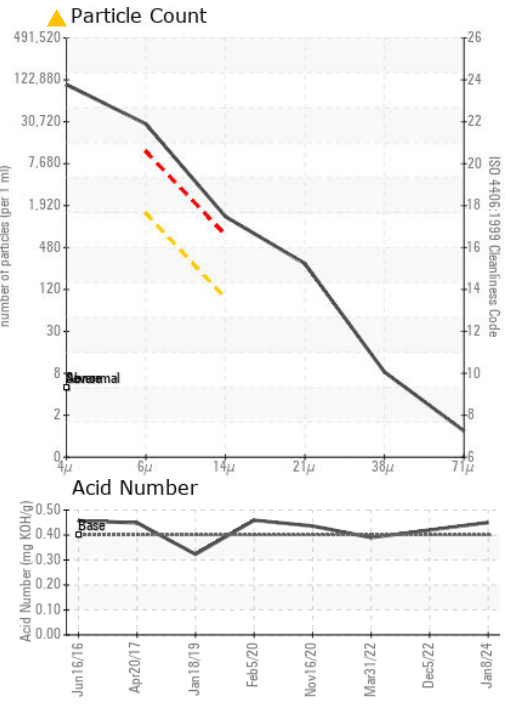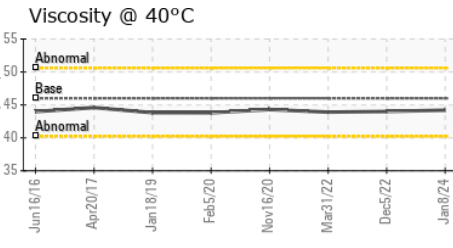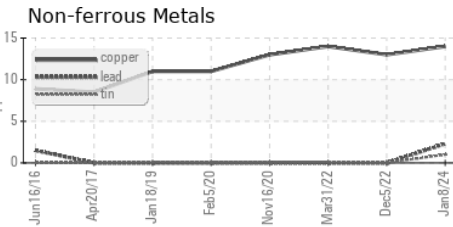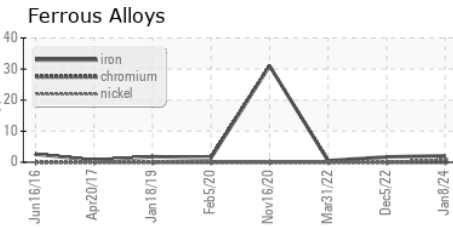

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA011736 **Received** : 01 Feb 2024
Lab Number : 06077717 **Diagnosed** : 04 Feb 2024
Unique Number : 10859808 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ARAMARK UNIFORM SERVICE
 201 4TH ST SE
 DECATUR, AL
 US 35601
 Contact: WILLIAM BRIAN
 WILLIAM-BRIAN10@ARAMARK.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)