




# OIL ANALYSIS REPORT

Sample Rating Trend

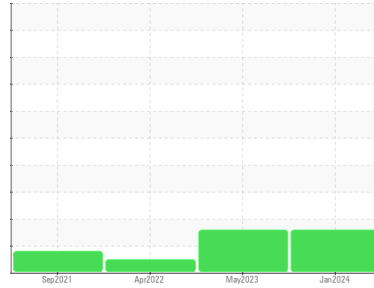

ISO



Machine Id  
**2542698 (S/N 1270)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA003409</b>	KCPA002822	KCP45212
Sample Date	Client Info			<b>28 Jan 2024</b>	04 May 2023	06 Apr 2022
Machine Age	hrs	Client Info		<b>118095</b>	112066	103225
Oil Age	hrs	Client Info		<b>0</b>	0	3000
Oil Changed		Client Info		<b>N/A</b>	N/A	Changed
Sample Status				<b>ATTENTION</b>	ATTENTION	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m	>10	<b>2</b>	1	0
Copper	ppm	ASTM D5185m	>50	<b>9</b>	3	4
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>2</b>	<1	0
Magnesium	ppm	ASTM D5185m	100	<b>2</b>	2	0
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	<1
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	23500	<b>15688</b>	20681	15754


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>3</b>	2	1
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	3	0
Water	%	ASTM D6304	>0.05	<b>0.007</b>	0.004	0.007
ppm Water	ppm	ASTM D6304	>500	<b>75</b>	41.7	79.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>4031</b>	8211	4730
Particles >6µm		ASTM D7647	>1300	<b>▲ 1462</b>	▲ 1915	599
Particles >14µm		ASTM D7647	>80	<b>▲ 150</b>	▲ 90	55
Particles >21µm		ASTM D7647	>20	<b>▲ 33</b>	▲ 25	18
Particles >38µm		ASTM D7647	>4	<b>1</b>	1	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 19/18/14</b>	▲ 20/18/14	16/13


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.50</b>	0.46	0.44

# OIL ANALYSIS REPORT


## Particle Trend

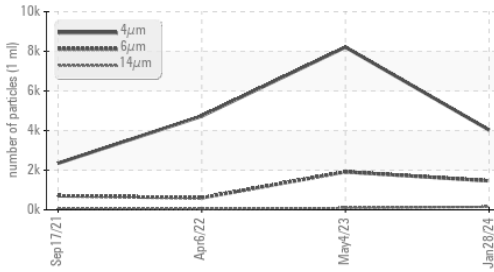


## Water (KF)

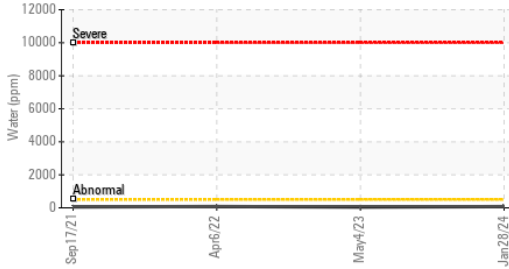


## Acid Number

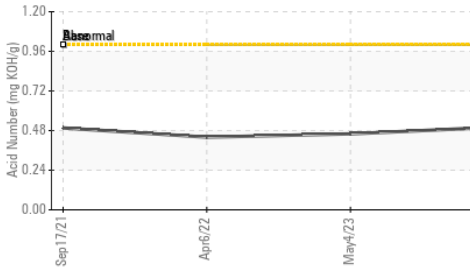

## Water (KF)

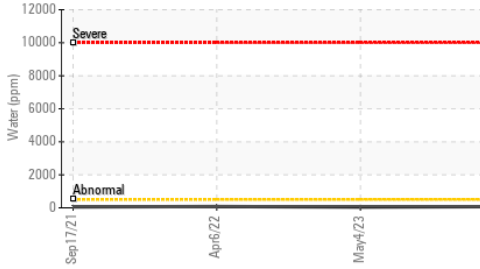

## Viscosity @ 40°C

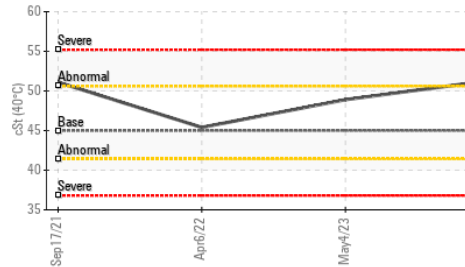


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	51.3	48.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

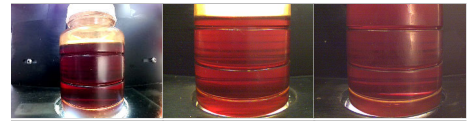


Bottom




## GRAPHS


### Ferrous Alloys

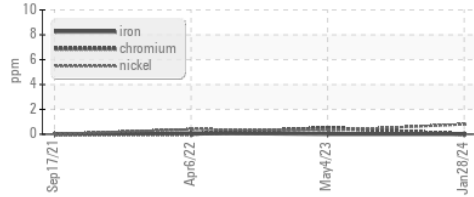


### Non-ferrous Metals

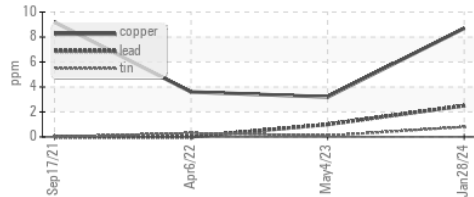


### Viscosity @ 40°C

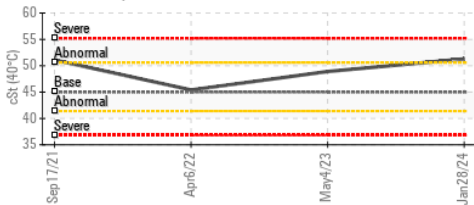

### Particle Count

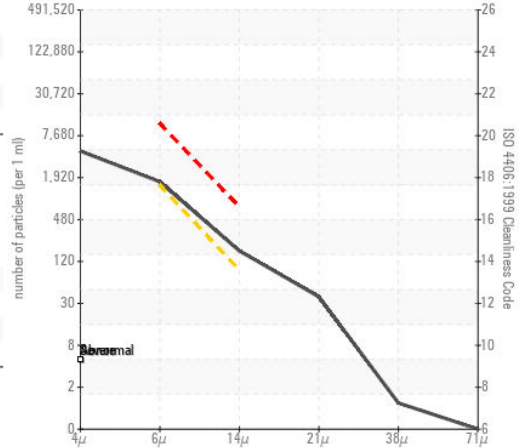

### Acid Number

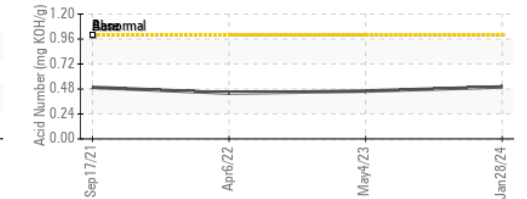

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : KCPA003409  
 Lab Number : 06077719  
 Unique Number : 10859810  
 Test Package : IND 2 ( Additional Tests: KF, PrtCount )

**STREAMLINE CIRCUITS**  
 1410 MARTIN AVE  
 SANTA CLARA, CA  
 US 95050  
 Contact: SEAN NEVOLI  
 SEANNEVOLI@SUMMIT-PCB.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: