


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

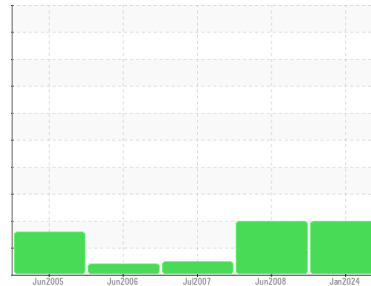

Machine Id
KAESER SK 26 SIMPLEX 2172099 (S/N 1338)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA011067	KC16109	KC13991
Sample Date	Client Info			19 Jan 2024	17 Jun 2008	13 Jul 2007
Machine Age	hrs	Client Info		65028	19569	14888
Oil Age	hrs	Client Info		0	4700	4163
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		<1	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	0	<1
Lead	ppm	ASTM D5185m	>25	2	0	0
Copper	ppm	ASTM D5185m	>50	15	36	14
Tin	ppm	ASTM D5185m	>15	<1	0	0
Antimony	ppm	ASTM D5185m		---	0	3
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	<1
Manganese	ppm	ASTM D5185m		2	0	0
Magnesium	ppm	ASTM D5185m	90	1	0	2
Calcium	ppm	ASTM D5185m	2	<1	0	0
Phosphorus	ppm	ASTM D5185m		<1	0	0
Zinc	ppm	ASTM D5185m		31	0	12
Sulfur	ppm	ASTM D5185m		17042	11613	14110

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	1
Sodium	ppm	ASTM D5185m		3	0	<1
Potassium	ppm	ASTM D5185m	>20	4	5	12
Water	%	ASTM D6304	>0.1	0.007	0.007	0.006
ppm Water	ppm	ASTM D6304	>1000	73	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		36634	28578	294
Particles >6µm		ASTM D7647	>1300	▲ 19923	▲ 15567	160
Particles >14µm		ASTM D7647	>80	▲ 2616	▲ 2652	27
Particles >21µm		ASTM D7647	>20	▲ 499	▲ 895	9
Particles >38µm		ASTM D7647	>4	▲ 7	▲ 138	1
Particles >71µm		ASTM D7647	>3	0	▲ 14	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 22/21/19	▲ 21/19	14/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.39	0.383	0.362

OIL ANALYSIS REPORT

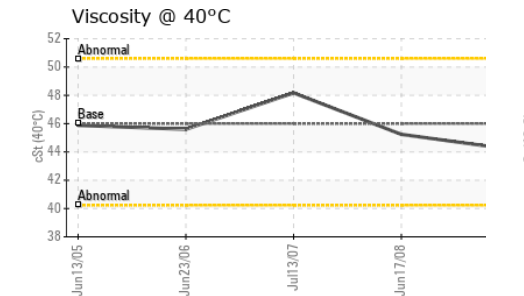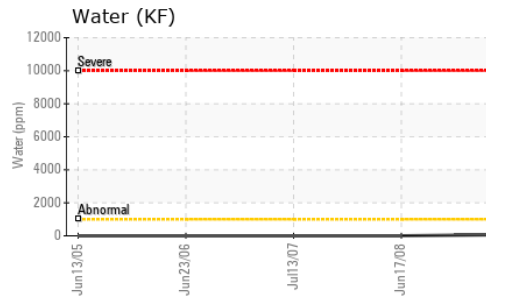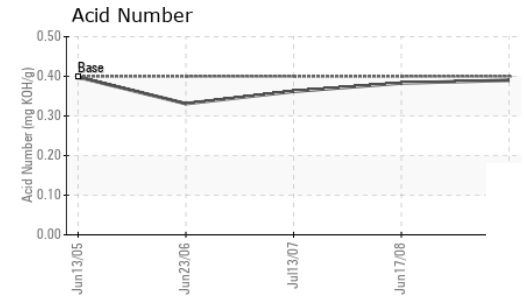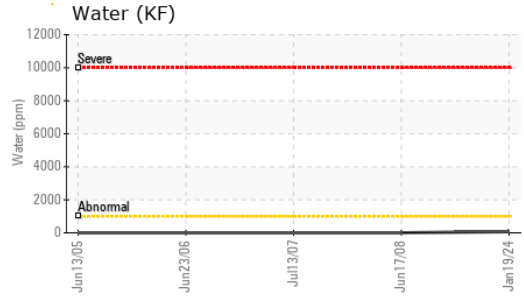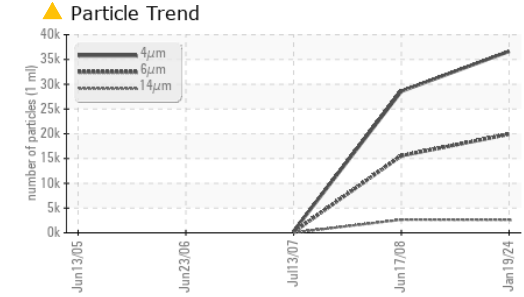






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.2	45.24	48.17

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

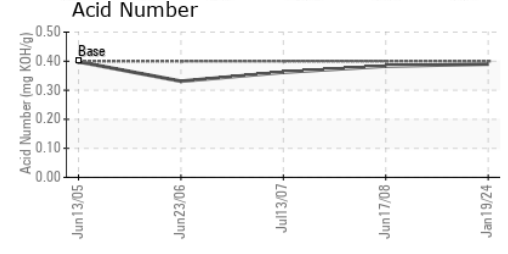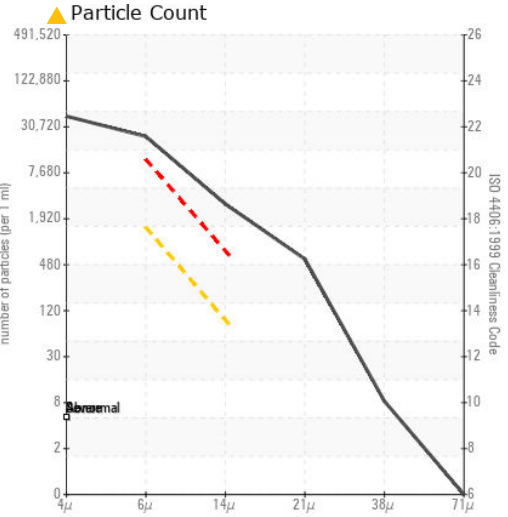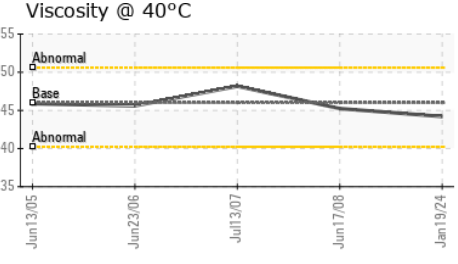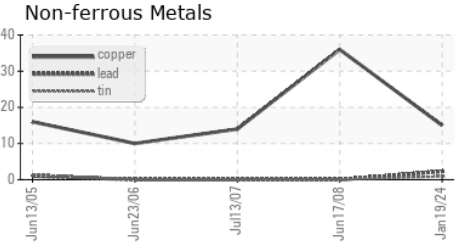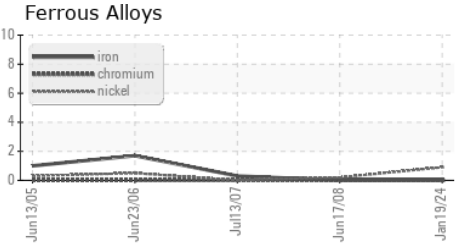

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA011067 **Received** : 01 Feb 2024
Lab Number : 06077720 **Diagnosed** : 04 Feb 2024
Unique Number : 10859811 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ARBAN ASSOCIATES
 19000 COLONIAL PORT RD.
 DUMFRIES, VA
 US 22026
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: