




OIL ANALYSIS REPORT

Sample Rating Trend

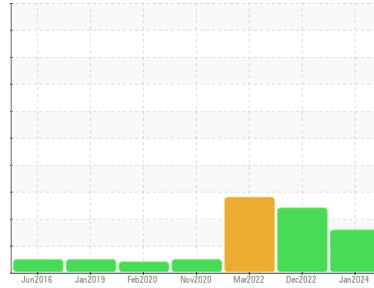

Machine Id
KAESER ASD 25 5457110 (S/N 1116)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA011741	KCP47660	KCP44456
Sample Date	Client Info		08 Jan 2024	05 Dec 2022	31 Mar 2022
Machine Age	hrs	Client Info	12366	11074	9254
Oil Age	hrs	Client Info	0	4131	2311
Oil Changed	Client Info		N/A	Changed	Not Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	2	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	1	0	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	4	▲ 12	8
Lead	ppm	ASTM D5185m >10	2	0	0
Copper	ppm	ASTM D5185m >50	16	9	8
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	2	0	0
Magnesium	ppm	ASTM D5185m 90	25	<1	2
Calcium	ppm	ASTM D5185m 2	<1	0	0
Phosphorus	ppm	ASTM D5185m	2	3	9
Zinc	ppm	ASTM D5185m	202	168	169
Sulfur	ppm	ASTM D5185m	18236	18655	15675

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	10	3	3
Potassium	ppm	ASTM D5185m >20	11	9	2
Water	%	ASTM D6304 >0.05	0.016	0.022	▲ 0.564
ppm Water	ppm	ASTM D6304 >500	166	220.4	▲ 5640






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		7537	21946	---
Particles >6µm	ASTM D7647	>1300	▲ 2263	▲ 2316	---
Particles >14µm	ASTM D7647	>80	▲ 204	▲ 82	---
Particles >21µm	ASTM D7647	>20	▲ 59	▲ 25	---
Particles >38µm	ASTM D7647	>4	3	4	---
Particles >71µm	ASTM D7647	>3	0	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/15	▲ 22/18/14	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.43	0.38	0.37

OIL ANALYSIS REPORT

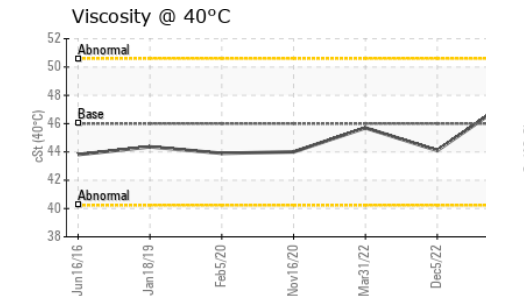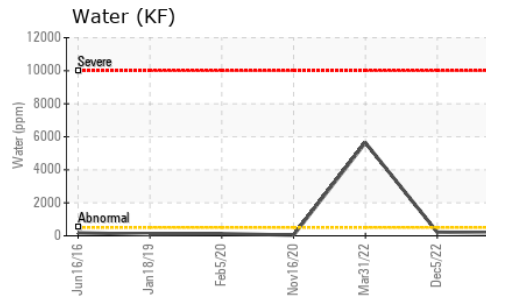
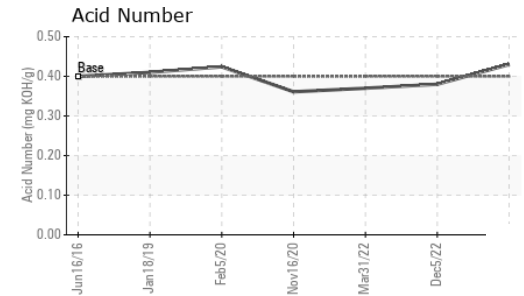
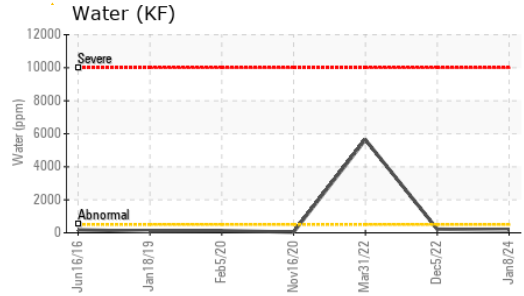
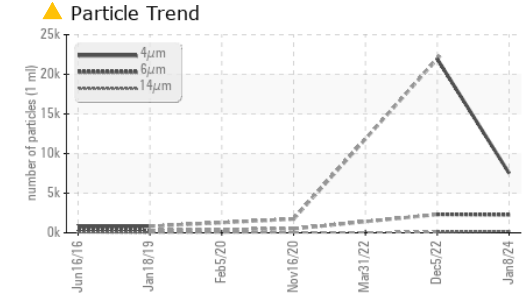


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	▲ HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	47.6	44.1	45.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

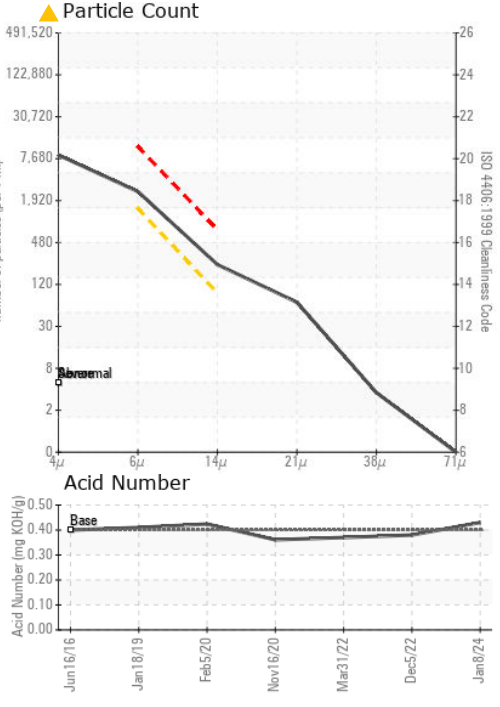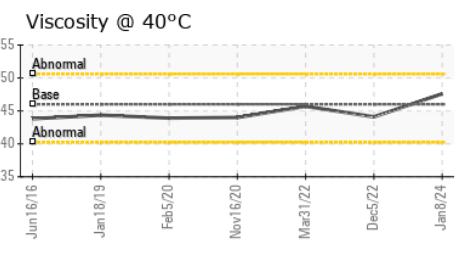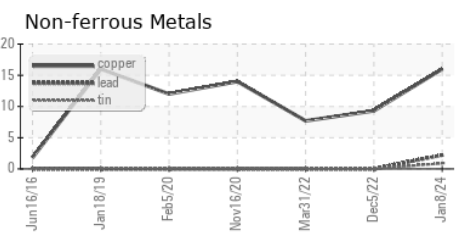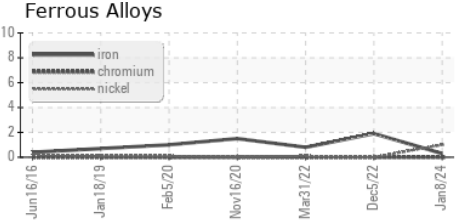

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA011741 **Recieved** : 01 Feb 2024
Lab Number : 06077724 **Diagnosed** : 04 Feb 2024
Unique Number : 10859815 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ARAMARK UNIFORM SERVICE
 201 4TH ST SE
 DECATUR, AL
 US 35601
 Contact: WILLIAM BRIAN
 WILLIAM-BRIAN10@ARAMARK.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)