

# **OIL ANALYSIS REPORT**

Sample Rating Trend

**NORMAL** 



Machine Id **4647695 (S/N 1089)** 

Component

**Compressor** Fluid

KAESER SIGMA (OEM) S-460 (--- QTS)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Mar2023	Dec2023		
SAMPLE INFORM	/ATION	method	limit/base	current	history1	history2
Sample Number	(11011	Client Info	mmusacc	KC101495	KC101475	
Sample Date		Client Info		26 Dec 2023	04 Mar 2023	
Machine Age	hrs	Client Info		47064	42103	
Oil Age	hrs	Client Info		6090	1128	
Oil Changed	1115	Client Info		Not Changd	Not Changd	
Sample Status		Ciletit IIIIO		NORMAL	NORMAL	
-		.1	12 - 24 //			
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m		<1	0	
Lead	ppm	ASTM D5185m	>10	2	0	
Copper	ppm	ASTM D5185m	>50	6	5	
Tin	ppm	ASTM D5185m	>10	1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	35	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		2	<1	
Magnesium	ppm	ASTM D5185m	90	1	58	
Calcium	ppm	ASTM D5185m	2	<1	3	
Phosphorus	ppm	ASTM D5185m		<1	4	
Zinc	ppm	ASTM D5185m		0	0	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m	7 20	2	20	
Potassium	ppm	ASTM D5185m	>20	3	4	
Water	%	ASTM D6304	>0.05	0.006	0.018	
ppm Water	ppm	ASTM D6304	>500	60	189.6	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		390	3695	
Particles >6µm		ASTM D7647	>1300	139	991	
Particles >14µm		ASTM D7647	>80	21	79	
Particles >21µm		ASTM D7647		7	22	
Particles >38µm		ASTM D7647	>4	0	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/14/12	19/17/13	
	TION					
FLUID DEGRADA	MOIT	method	limit/base	current	history1	history2

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.37

0.45



## **OIL ANALYSIS REPORT**

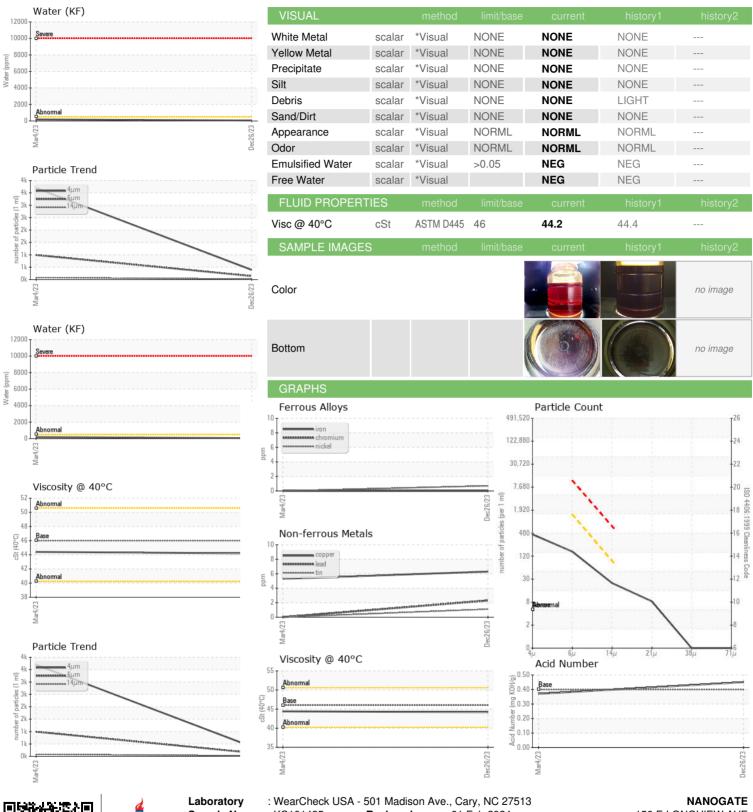





Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC101495 : 06077728

: 10859819 : IND 2

: 01 Feb 2024 Recieved Diagnosed : 04 Feb 2024 Diagnostician

: Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) 150 E LONGVIEW AVE MANSFIELD, OH US 44903

Contact: MATT BUZARD matt.buzard@nanogate.com T: (419)521-0191