




OIL ANALYSIS REPORT

Sample Rating Trend

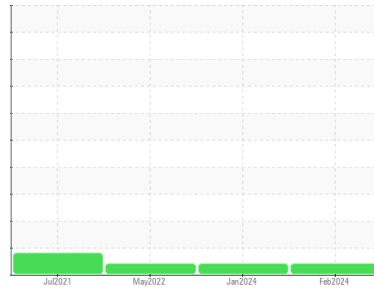

VISCOSITY



Machine Id
STUFF LINE 1

Component
Hydraulic System

Fluid
ESSO NUTO H ISO 68 (--- GAL)

DIAGNOSIS

▲ Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

▲ Fluid Condition

The oil viscosity is lower than normal. Confirmed. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USPM30900	USP0004843	USP235783
Sample Date	Client Info	01 Feb 2024	17 Jan 2024	01 May 2022
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ATTENTION	ATTENTION	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	<1	0	<1
Chromium	ppm	ASTM D5185m >20	0	0	0
Nickel	ppm	ASTM D5185m >20	<1	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	<1	0	<1
Aluminum	ppm	ASTM D5185m >20	<1	0	0
Lead	ppm	ASTM D5185m >20	2	0	<1
Copper	ppm	ASTM D5185m >20	6	4	4
Tin	ppm	ASTM D5185m >20	<1	<1	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	<1	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 5	1	0	<1
Calcium	ppm	ASTM D5185m 50	41	40	40
Phosphorus	ppm	ASTM D5185m 330	347	351	323
Zinc	ppm	ASTM D5185m 420	424	422	408
Sulfur	ppm	ASTM D5185m 3100	2962	2983	2532

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	1	0	<1
Sodium	ppm	ASTM D5185m	2	0	0
Potassium	ppm	ASTM D5185m >20	4	0	<1
Water	%	ASTM D6304 >0.05	0.004	0.005	0.003
ppm Water	ppm	ASTM D6304 >500	45	60	34.3

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	434	2013	1253
Particles >6µm	ASTM D7647 >1300	132	560	217
Particles >14µm	ASTM D7647 >160	14	46	13
Particles >21µm	ASTM D7647 >40	4	12	2
Particles >38µm	ASTM D7647 >10	0	1	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	16/14/11	18/16/13	17/15/11

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 .40	0.26	0.18	0.27




OIL ANALYSIS REPORT

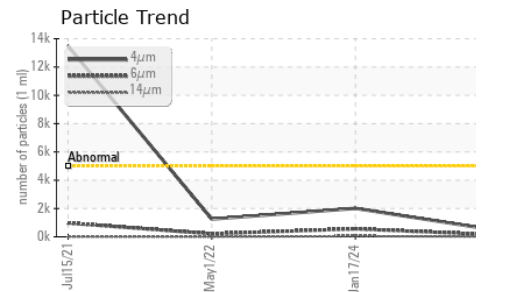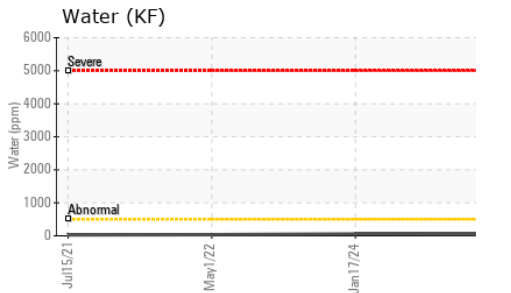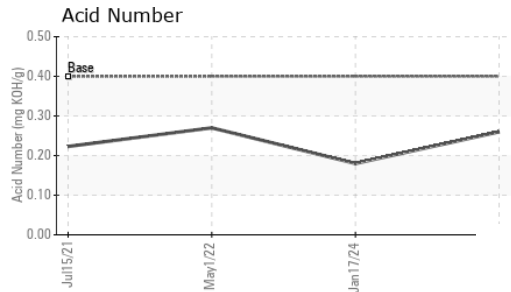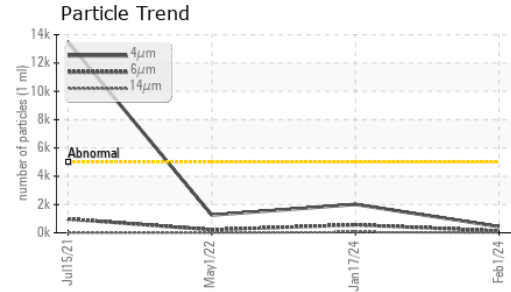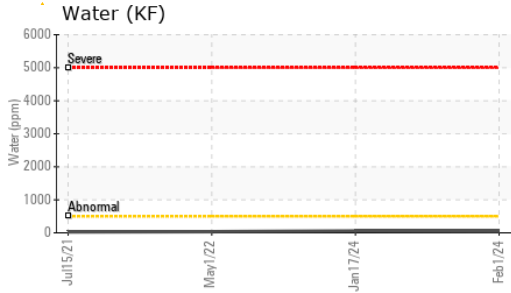






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.8 ▲ 56.3	▲ 56.5	▲ 55.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

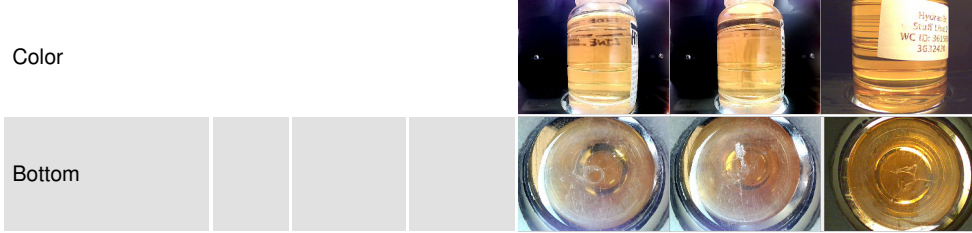

GRAPHS

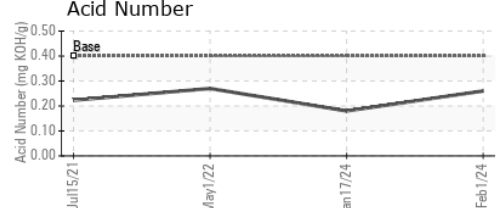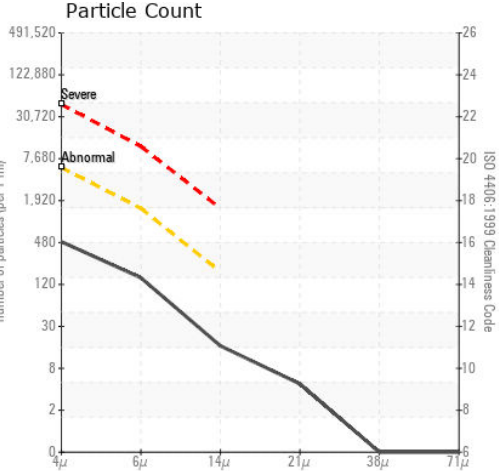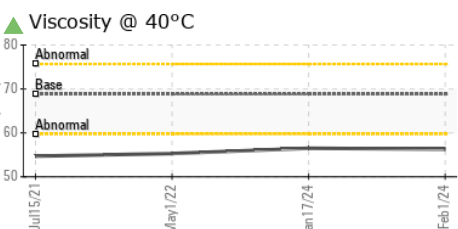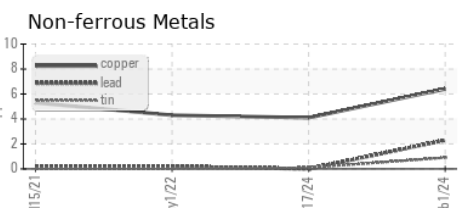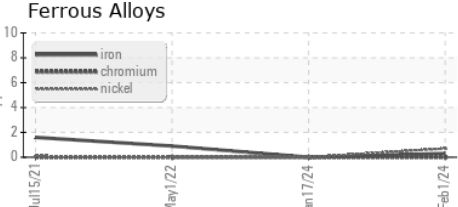

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM30900 **Received** : 01 Feb 2024
Lab Number : 06077729 **Diagnosed** : 02 Feb 2024
Unique Number : 10859820 **Diagnostician** : Doug Bogart
Test Package : IND 2

KraftHeinz - Newberry - Plant 8335
 3704 LOUIS RICH DR
 NEWBERRY, SC
 US 29108
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: