

OIL ANALYSIS REPORT

Sample Rating Trend


NORMAL



COMPRESSOR 1 YORK Trinity St.Joe (S/N SHHM-614850)

Centrifugal Compressor

YORK TYPE K (20 GAL)





Recommendation

Resample at the next service interval to monitor. (Customer Sample Comment: Routine maintenance)

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

L)				Jan2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0827184		
Sample Date		Client Info		23 Jan 2024		
Machine Age	hrs	Client Info		5965		
Oil Age	hrs	Client Info		5965		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	2		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>15	1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	0	1		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m	0	2		
Magnesium	ppm	ASTM D5185m	0	<1		
Calcium	ppm	ASTM D5185m	0	1		
Phosphorus	ppm	ASTM D5185m	5	2		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	10	7		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	8		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	4		
Water	%	ASTM D6304	>0.03	0.010		
ppm Water	ppm	ASTM D6304	>300	109		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


0.014

Acid Number (AN)

mg KOH/g ASTM D8045 0.03



OIL ANALYSIS REPORT

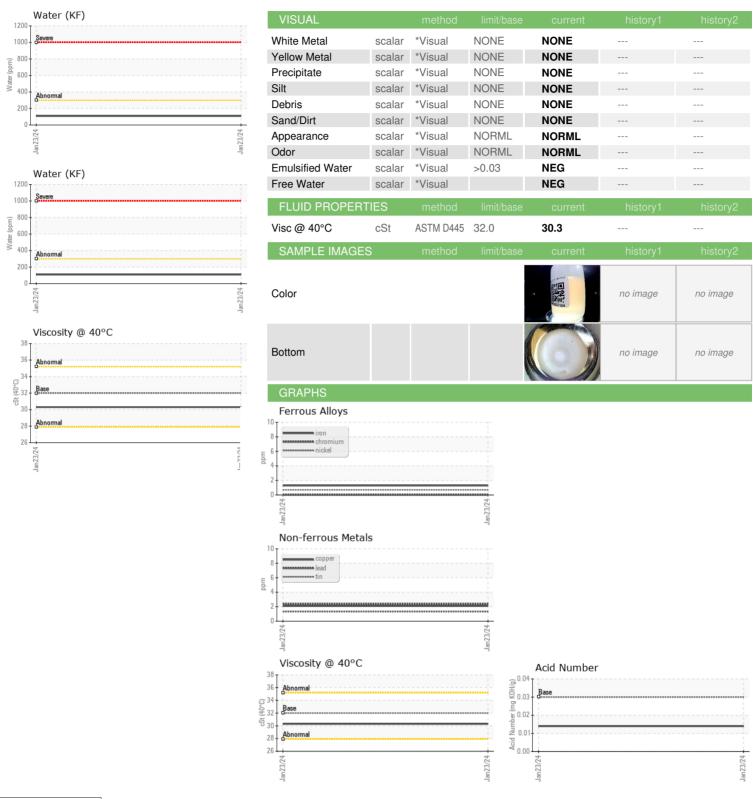





Certificate L2367

Laboratory Sample No.

Lab Number : 06077741

Test Package : PLANT

: WC0827184 Unique Number: 10859832

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 01 Feb 2024 **Tested**

: 05 Feb 2024 : 05 Feb 2024 - Jonathan Hester Diagnosed

THERMALNETICS, INC 3955 PINNACLE COURT SUITE 200

AUBURN HILLS, MI US 48326

Contact: GARY WATSON garyw@thermalnetics.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (248)276-3351 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: