



# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**COMPRESSOR 1/Oil sump**  
 Machine Id  
**YORK Trinity St. Joe (S/N SMYM-462970)**  
 Component  
**Centrifugal Compressor**  
 Fluid  
**YORK TYPE K (20 GAL)**



## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. ( Customer Sample Comment: Routine maintenance )

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0758326</b>	---	---
Sample Date	Client Info		<b>24 Jan 2024</b>	---	---
Machine Age	hrs	Client Info	<b>32892</b>	---	---
Oil Age	hrs	Client Info	<b>32892</b>	---	---
Oil Changed	Client Info		<b>Not Chngd</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m >25	<b>3</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>2</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 0	<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m 0	<b>2</b>	---	---
Magnesium	ppm	ASTM D5185m 0	<b>1</b>	---	---
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m 5	<b>1</b>	---	---
Zinc	ppm	ASTM D5185m 0	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m 10	<b>0</b>	---	---

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>5</b>	---	---
Sodium	ppm	ASTM D5185m	<b>2</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>3</b>	---	---
Water	%	ASTM D6304 >0.03	<b>0.008</b>	---	---
ppm Water	ppm	ASTM D6304 >300	<b>88</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.03	<b>0.013</b>	---	---



# OIL ANALYSIS REPORT

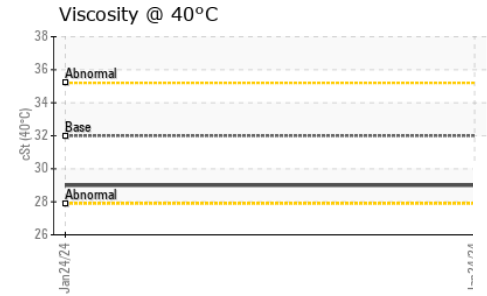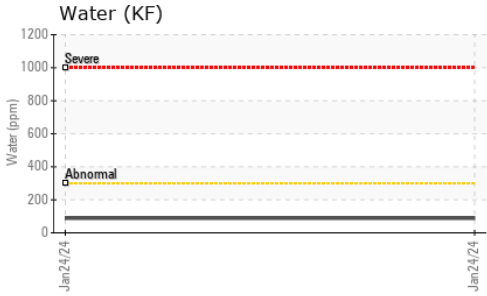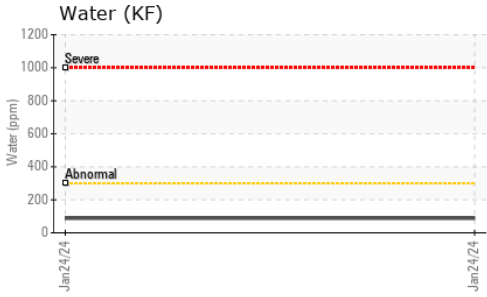





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.03	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	32.0	<b>29.0</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

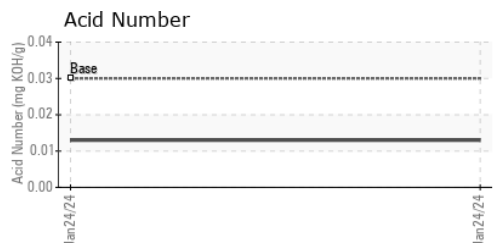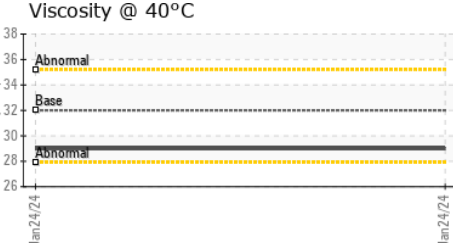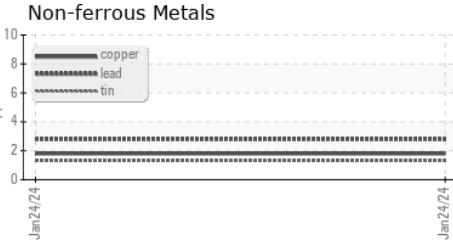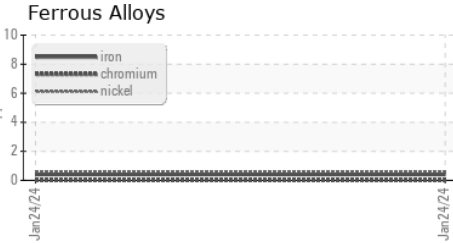

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0758326      **Received** : 01 Feb 2024  
**Lab Number** : 06077743      **Tested** : 05 Feb 2024  
**Unique Number** : 10859834      **Diagnosed** : 05 Feb 2024 - Jonathan Hester  
**Test Package** : PLANT

**THERMALNETICS, INC**  
 3955 PINNACLE COURT SUITE 200  
 AUBURN HILLS, MI  
 US 48326  
 Contact: GARY WATSON  
 garyw@thermalnetics.com  
 T: (248)276-3351  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)