

# **OIL ANALYSIS REPORT**

Sample Rating Trend

NORMAL



# NOT GIVEN Machine Id 5309592 Component

Compressor

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

Moderate concentration of visible dirt/debris present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCS06077768		
Sample Date		Client Info		24 Jan 2024		
Machine Age	hrs	Client Info		61359		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	2		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		2		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m		333		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		433		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	3		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.10		

# **Sullivan**

## **OIL ANALYSIS REPORT**

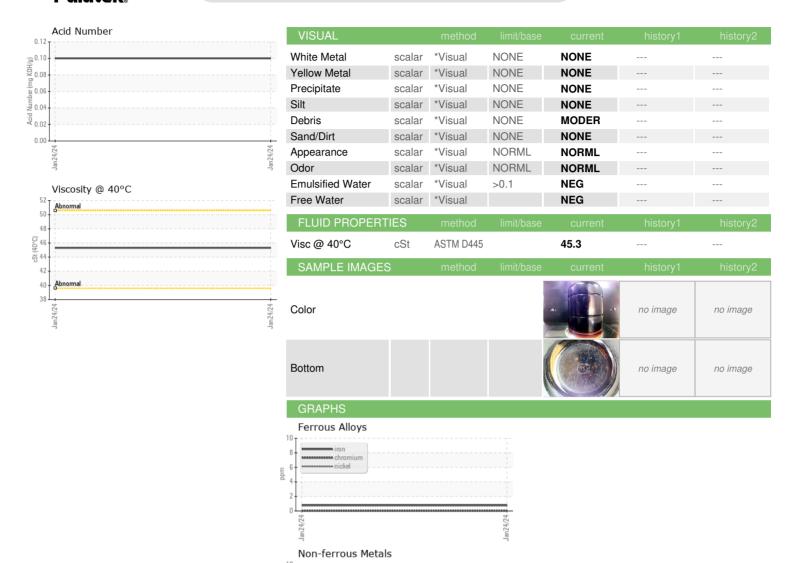





Certificate L2367

Laboratory Sample No. Lab Number Unique Number

: UCS06077768 : 06077768

Viscosity @ 40°C

: 10859859 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : 01 Feb 2024 Recieved

Diagnosed : 04 Feb 2024 : Don Baldridge Diagnostician

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) **UMPQUA DAIRY** 

ROSEBURG, OR US 97470 Contact: ANDY COUCH andyc@umpquadairy.com

> T: (541)672-2638 F: (541)673-0256

Acid Number

Acid