




OIL ANALYSIS REPORT

Sample Rating Trend

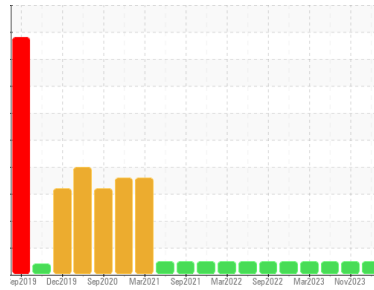

NORMAL



Machine Id
CARL_U2120 CARL_U2120_SS2120

Component
Non-Drive End Seal Pot

Fluid
ROYAL PURPLE BARRIER FLUID FDA22 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			RP0025827	RP0034103	RP0034007
Sample Date	Client Info			20 Feb 2024	15 Nov 2023	25 Sep 2023
Machine Age	hrs	Client Info		2358	2358	2358
Oil Age	hrs	Client Info		2358	2358	2358
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0	---	0
Chromium	ppm	ASTM D5185m	>20	0	---	0
Nickel	ppm	ASTM D5185m	>20	<1	---	<1
Titanium	ppm	ASTM D5185m		0	---	0
Silver	ppm	ASTM D5185m		0	---	0
Aluminum	ppm	ASTM D5185m	>20	0	---	0
Lead	ppm	ASTM D5185m	>20	0	---	0
Copper	ppm	ASTM D5185m	>20	0	---	0
Tin	ppm	ASTM D5185m	>20	<1	---	0
Vanadium	ppm	ASTM D5185m		0	---	0
Cadmium	ppm	ASTM D5185m		0	---	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	---	0
Barium	ppm	ASTM D5185m		0	---	0
Molybdenum	ppm	ASTM D5185m		0	---	0
Manganese	ppm	ASTM D5185m		<1	---	0
Magnesium	ppm	ASTM D5185m		0	---	0
Calcium	ppm	ASTM D5185m		<1	---	0
Phosphorus	ppm	ASTM D5185m		<1	---	<1
Zinc	ppm	ASTM D5185m		0	---	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	---	<1
Sodium	ppm	ASTM D5185m		<1	---	0
Potassium	ppm	ASTM D5185m	>20	<1	---	<1
Water	%	ASTM D6304	>0.05	0.003	0.009	0.007
ppm Water	ppm	ASTM D6304	>500	30	92	70.3

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.046	0.08	0.038

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

OIL ANALYSIS REPORT

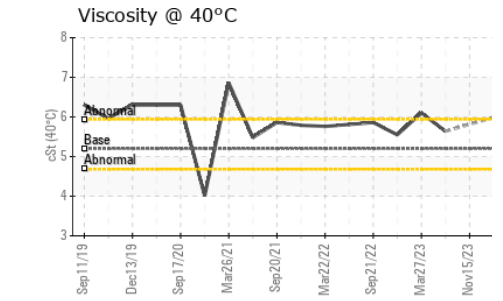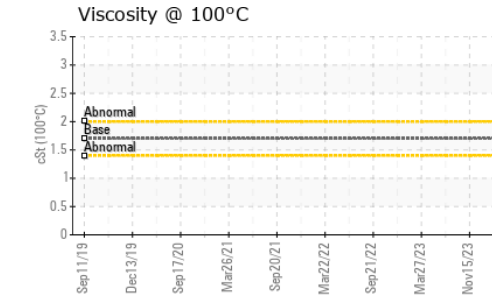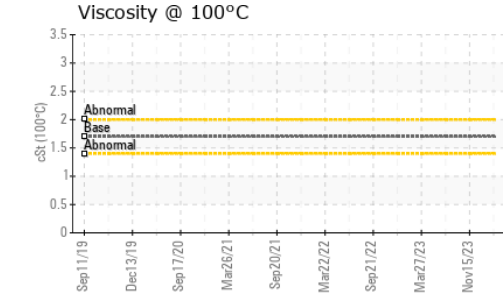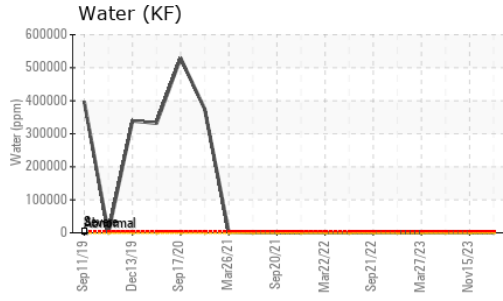

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	5.2	5.99	---	5.64
Visc @ 100°C	cSt	ASTM D445	1.7	2.04	---	---
Viscosity Index (VI)	Scale	ASTM D2270		150	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------





Color



Bottom



GRAPHS

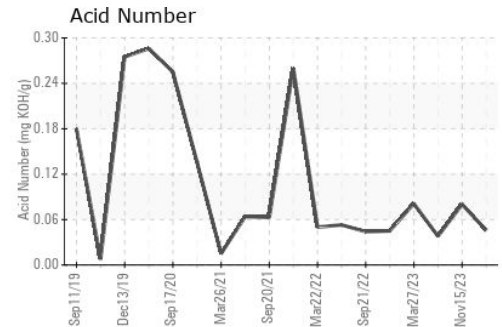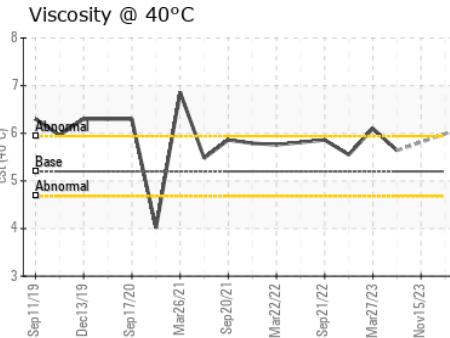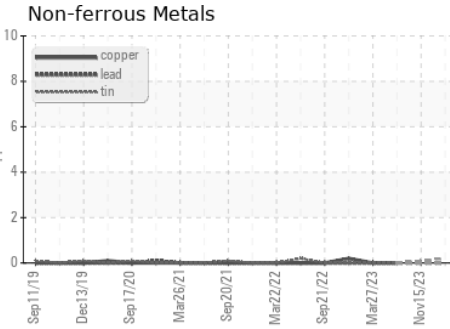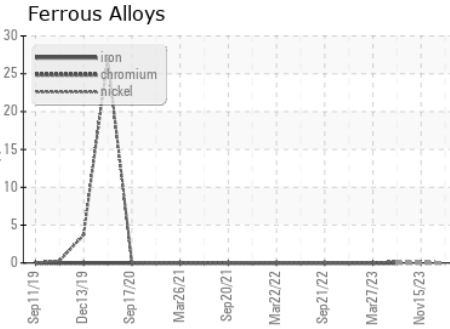

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0025827 **Received** : 22 Feb 2024
Lab Number : 06097340 **Tested** : 26 Feb 2024
Unique Number : 10890193 **Diagnosed** : 26 Feb 2024 - Jonathan Hester
Test Package : PLANT (Additional Tests: KV100, VI)

ENERGY TRANSFER - CARLTON
 11500 FRESSNER ROAD
 CARLTON, MI
 US 48117
 Contact: SCOTT VERHELLE

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (313)580-0267

F: