




FUEL REPORT

Sample Rating Trend

NORMAL



Area
Store 3 - Norton
 Machine Id
TANK 2
 Component
Diesel Fuel
 Fluid
OFF ROAD (--- GAL)

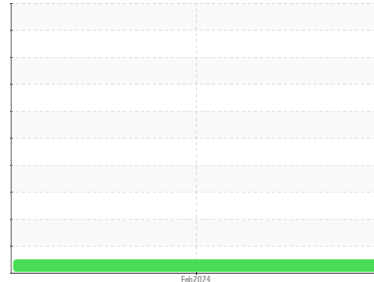

DIAGNOSIS

Recommendation

No corrective action is recommended at this time.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no indication of any contamination in the fuel.

Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	LEC0042771	---	---
Sample Date	Client Info	20 Feb 2024	---	---
Machine Age	hrs	Client Info	0	---
Sample Status			NORMAL	---

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	2.34	---

SULFUR CONTENT

method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	8	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0
Sodium	ppm	ASTM D5185m	<0.1	<1
Potassium	ppm	ASTM D5185m	<0.1	<1
Water	%	ASTM D6304	<0.05	0.003
ppm Water	ppm	ASTM D6304	<500	28

HEAVY METALS





method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0
Nickel	ppm	ASTM D5185m	<0.1	<1
Lead	ppm	ASTM D5185m	<0.1	0
Vanadium	ppm	ASTM D5185m	<0.1	0
Iron	ppm	ASTM D5185m	<0.1	0
Calcium	ppm	ASTM D5185m	<0.1	1
Magnesium	ppm	ASTM D5185m	<0.1	<1
Phosphorus	ppm	ASTM D5185m	<0.1	<1
Zinc	ppm	ASTM D5185m	<0.1	0

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image

FUEL REPORT

GRAPHS

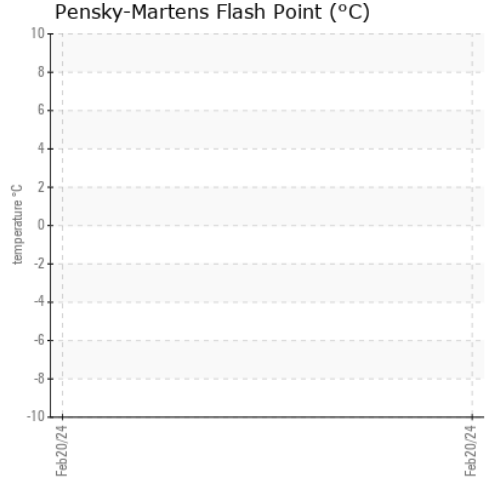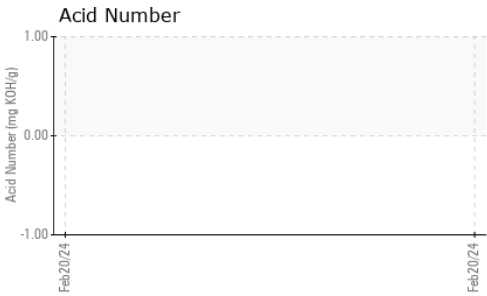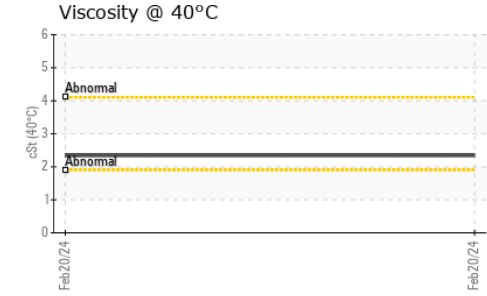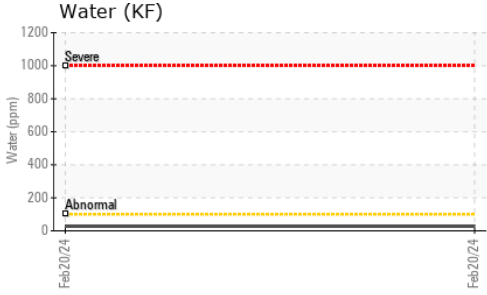

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : LEC0042771 **Received** : 22 Feb 2024
Lab Number : 06097345 **Tested** : 26 Feb 2024
Unique Number : 10890198 **Diagnosed** : 26 Feb 2024 - Jonathan Hester
Test Package : CONST (Additional Tests: KF, PQ, SCREEN)

ARMSTRONG WOOD PRODUCTS
 PO BOX 160
 BEVERLY, WV
 US 26253
 Contact: JAMES THOMPSON
 James.Thompson@AHFProducts.com
 T: (304)338-7614
 F: (304)338-4105

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)