OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id
41-42-43
Component
Hydraulic System
Fluid
{not provided} (--- GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear
All component wear rates are normal.

Contamination
There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Particle Filter (Magn: 200 x)

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**PH0003244**	---	---
Sample Date		Client Info		**13 Feb 2024**	---	---
Machine Age	hrs	Client Info		**0**	---	---
Oil Age	hrs	Client Info		**0**	---	---
Oil Changed		Client Info		**N/A**	---	---
Sample Status				**ATTENTION**	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.05	**NEG**	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	**2**	---	---
Chromium	ppm	ASTM D5185m	>20	**<1**	---	---
Nickel	ppm	ASTM D5185m	>20	**0**	---	---
Titanium	ppm	ASTM D5185m		**0**	---	---
Silver	ppm	ASTM D5185m		**0**	---	---
Aluminum	ppm	ASTM D5185m	>20	**0**	---	---
Lead	ppm	ASTM D5185m	>20	**0**	---	---
Copper	ppm	ASTM D5185m	>20	**1**	---	---
Tin	ppm	ASTM D5185m	>20	**0**	---	---
Vanadium	ppm	ASTM D5185m		**0**	---	---
Cadmium	ppm	ASTM D5185m		**0**	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	---	---
Barium	ppm	ASTM D5185m		**0**	---	---
Molybdenum	ppm	ASTM D5185m		**0**	---	---
Manganese	ppm	ASTM D5185m		**0**	---	---
Magnesium	ppm	ASTM D5185m		**<1**	---	---
Calcium	ppm	ASTM D5185m		**18**	---	---
Phosphorus	ppm	ASTM D5185m		**279**	---	---
Zinc	ppm	ASTM D5185m		**203**	---	---
Sulfur	ppm	ASTM D5185m		**716**	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	**<1**	---	---
Sodium	ppm	ASTM D5185m		**<1**	---	---
Potassium	ppm	ASTM D5185m	>20	**0**	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	**12740**	---	---
Particles >6µm		ASTM D7647	>2500	**923**	---	---
Particles >14µm		ASTM D7647	>320	**92**	---	---
Particles >21µm		ASTM D7647	>80	**24**	---	---
Particles >38µm		ASTM D7647	>20	**1**	---	---
Particles >71µm		ASTM D7647	>4	**0**	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	**21/17/14**	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.31**	---	---

OIL ANALYSIS REPORT

Particle Count

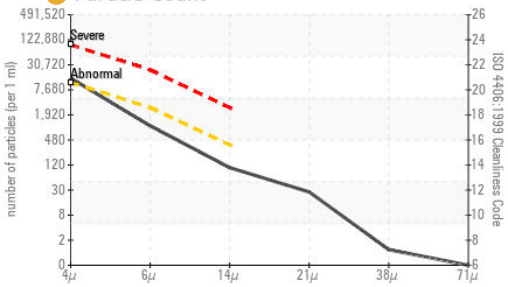

Particle Trend

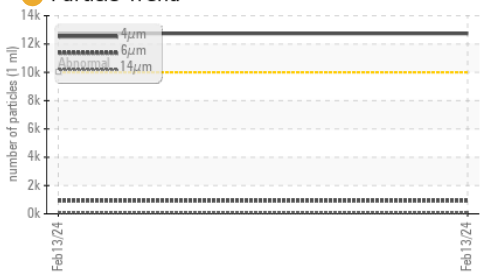

Acid Number

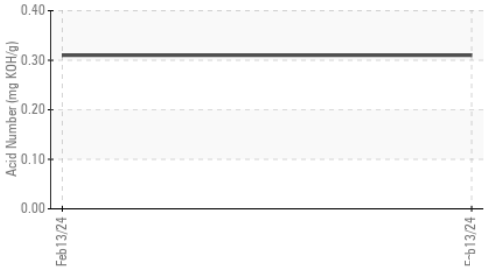

Viscosity @ 40°C

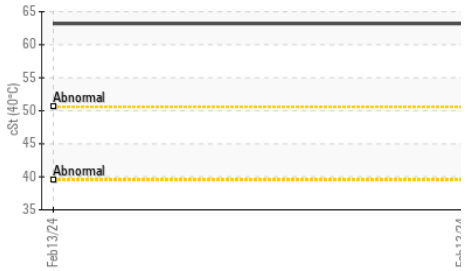

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	---	---
Yellow Metal	scalar	*Visual	NONE	**NONE**	---	---
Precipitate	scalar	*Visual	NONE	**NONE**	---	---
Silt	scalar	*Visual	NONE	**NONE**	---	---
Debris	scalar	*Visual	NONE	**NONE**	---	---
Sand/Dirt	scalar	*Visual	NONE	**NONE**	---	---
Appearance	scalar	*Visual	NORML	**NORML**	---	---
Odor	scalar	*Visual	NORML	**NORML**	---	---
Emulsified Water	scalar	*Visual	>0.05	**NEG**	---	---
Free Water	scalar	*Visual		**NEG**	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		**63.2**	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				*no image*	*no image*
Bottom				*no image*	*no image*
PrtFilter				*no image*	*no image*

GRAPHS

Ferrous Alloys

Non-ferrous Metals

Viscosity @ 40°C

Particle Filter (Magn: 200 x)

Acid Number

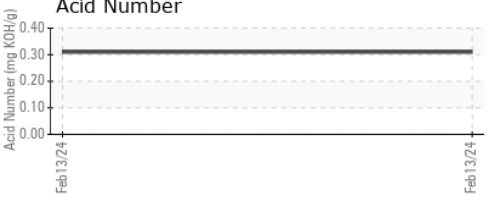

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PH0003244
Lab Number : 06097657
Unique Number : 10890510
Test Package : PLANT (Additional Tests: PrtFilter)

Received : 22 Feb 2024
Tested : 26 Feb 2024
Diagnosed : 26 Feb 2024 - Jonathan Hester

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

NPAA - NIPPON PAINT AUTOMOTIVE AMERICAS
2701 E 170TH ST
LANSING, IL
US 60438
Contact: MIKE GUTYAN
wcgfldemo@gmail.com
T:
F:

Report Id: NIPLAN [WUSCAR] 06097657 (Generated: 06/24/2024 12:05:01) Rev: 1

Contact/Location: MIKE GUTYAN - NIPLAN