


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

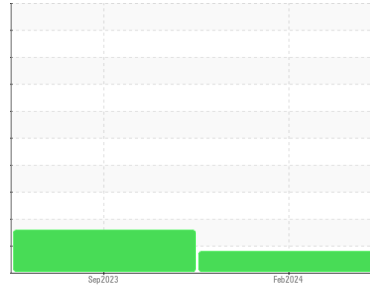

Machine Id
KAESER 6439383 (S/N 1192)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info	KCPA011755	KCPA004987	---
Sample Date	Client Info	05 Feb 2024	19 Sep 2023	---
Machine Age	hrs	Client Info	16327	14722
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	---
Sample Status		ATTENTION	ATTENTION	---

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	<1	0	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	3	5	---
Tin	ppm	ASTM D5185m	>10	0	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	90	24	8	---
Molybdenum	ppm	ASTM D5185m	0	0	<1	---
Manganese	ppm	ASTM D5185m		0	<1	---
Magnesium	ppm	ASTM D5185m	100	47	50	---
Calcium	ppm	ASTM D5185m	0	3	3	---
Phosphorus	ppm	ASTM D5185m	0	<1	4	---
Zinc	ppm	ASTM D5185m	0	2	2	---
Sulfur	ppm	ASTM D5185m	23500	18725	24391	---

CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	<1	2	---
Sodium	ppm	ASTM D5185m		26	22	---
Potassium	ppm	ASTM D5185m	>20	5	5	---
Water	%	ASTM D6304	>0.05	0.017	0.015	---
ppm Water	ppm	ASTM D6304	>500	175	156.3	---






FLUID CLEANLINESS method limit/base current history1 history2

Particles >4µm		ASTM D7647		7383	6219	---
Particles >6µm		ASTM D7647	>1300	▲ 1446	▲ 1632	---
Particles >14µm		ASTM D7647	>80	60	▲ 128	---
Particles >21µm		ASTM D7647	>20	13	▲ 37	---
Particles >38µm		ASTM D7647	>4	0	2	---
Particles >71µm		ASTM D7647	>3	0	1	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/18/13	▲ 20/18/14	---

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.39	0.37	---
------------------	----------	------------	-----	-------------	------	-----


OIL ANALYSIS REPORT

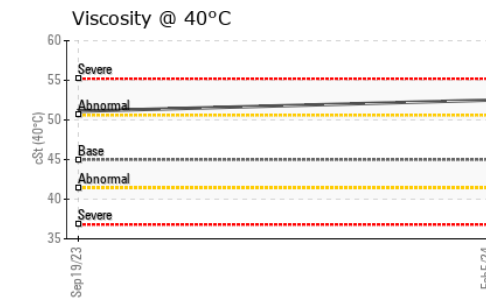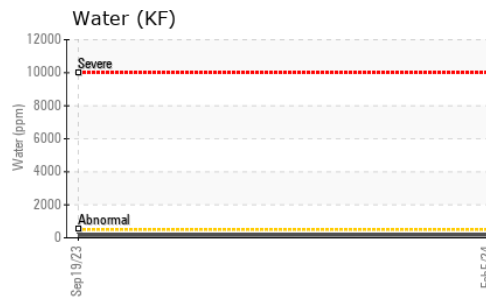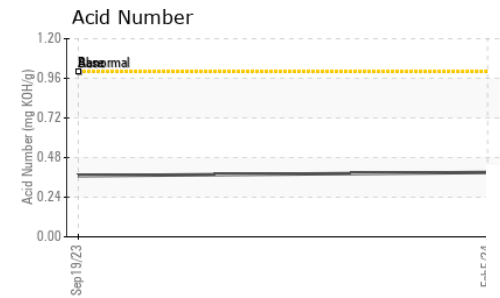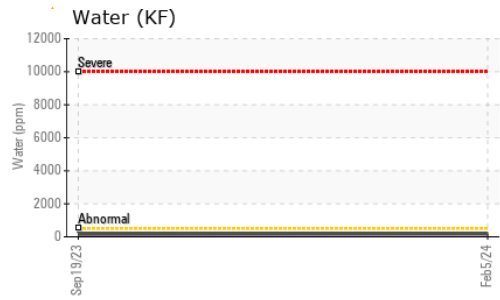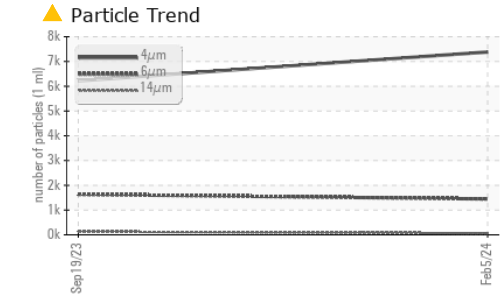






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	52.5	51.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

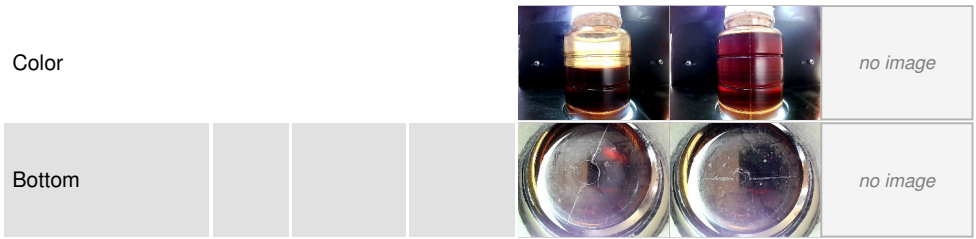

GRAPHS

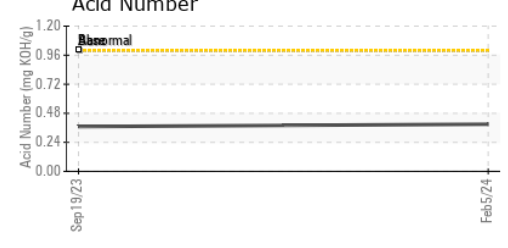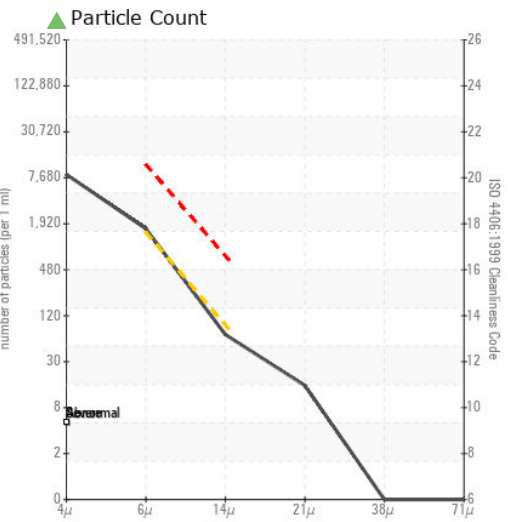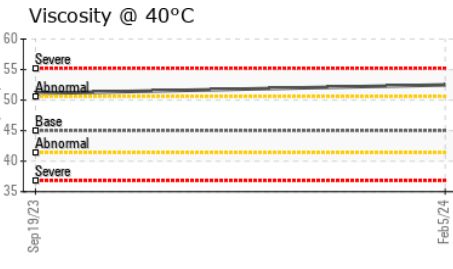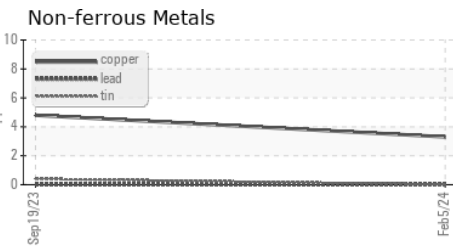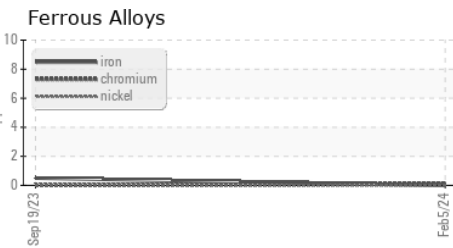

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA011755 **Received** : 22 Feb 2024
Lab Number : 06097685 **Tested** : 23 Feb 2024
Unique Number : 10890538 **Diagnosed** : 25 Feb 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

RECOLOGY
 1000 AMADOR ST
 SAN FRANCISCO, CA
 US 94124
 Contact: Service Manager
 ESTRACENER@RECOLOGY.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)