




PROBLEM SUMMARY

Sample Rating Trend

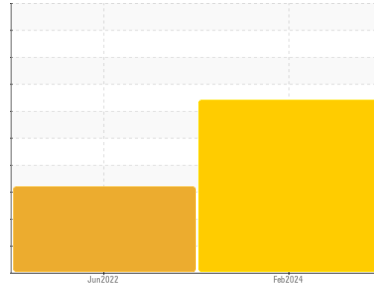

DIRT




Machine Id
KAESER 1369571

Component
Compressor


Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

Silicon (ppm)

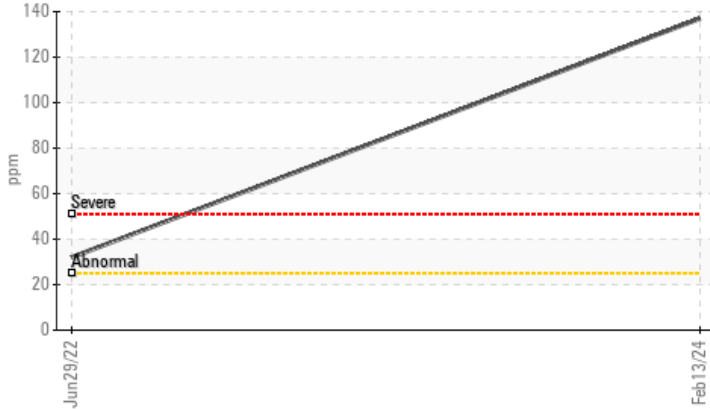

Particle Trend

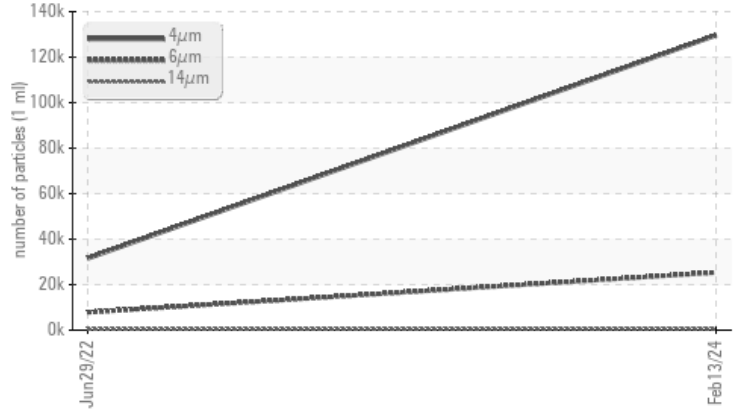

RECOMMENDATION

We advise that you check all areas where dirt can enter the system. The filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status	SEVERE	ABNORMAL	---
Silicon ppm	137	32	---
Particles >6µm	25340	7827	---
Particles >14µm	552	342	---
Particles >21µm	114	38	---
Oil Cleanliness	24/22/16	22/20/16	---

Customer Id: NICOAKCA
Sample No.: KCPA008532
Lab Number: 06097704
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check Dirt Access	---	---	?	We advise that you check all areas where dirt can enter the system.

HISTORICAL DIAGNOSIS

29 Jun 2022 Diag: Doug Bogart




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. Elemental level of silicon (Si) above normal indicating ingress of seal material. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



OIL ANALYSIS REPORT

Sample Rating Trend

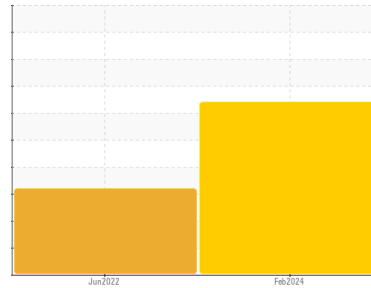

DIRT



Machine Id
KAESER 1369571

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check all areas where dirt can enter the system. The filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. Elemental level of silicon (Si) above normal.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA008532	KCP40585	---
Sample Date	Client Info			13 Feb 2024	29 Jun 2022	---
Machine Age	hrs	Client Info		8858	8427	---
Oil Age	hrs	Client Info		0	8427	---
Oil Changed		Client Info		N/A	Changed	---
Sample Status				SEVERE	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	6	1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	<1	<1	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	<1	0	---
Lead	ppm	ASTM D5185m	>10	<1	0	---
Copper	ppm	ASTM D5185m	>50	8	21	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	90	1	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		2	<1	---
Magnesium	ppm	ASTM D5185m	100	47	<1	---
Calcium	ppm	ASTM D5185m	0	3	0	---
Phosphorus	ppm	ASTM D5185m	0	39	140	---
Zinc	ppm	ASTM D5185m	0	64	127	---
Sulfur	ppm	ASTM D5185m	23500	18350	16698	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	137	32	---
Sodium	ppm	ASTM D5185m		11	0	---
Potassium	ppm	ASTM D5185m	>20	2	0	---
Water	%	ASTM D6304	>0.05	0.014	0.006	---
ppm Water	ppm	ASTM D6304	>500	146	61.8	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		129615	31507	---
Particles >6µm		ASTM D7647	>1300	25340	7827	---
Particles >14µm		ASTM D7647	>80	552	342	---
Particles >21µm		ASTM D7647	>20	114	38	---
Particles >38µm		ASTM D7647	>4	1	1	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	24/22/16	22/20/16	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36	0.33	---


OIL ANALYSIS REPORT

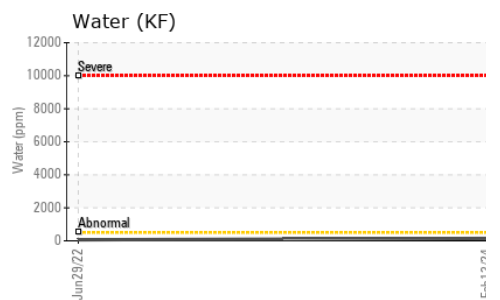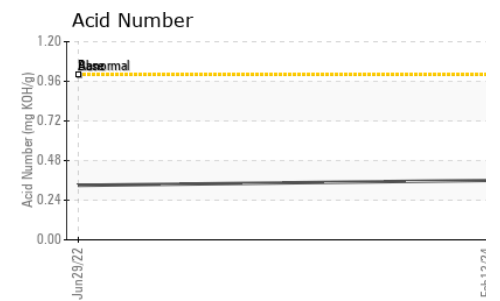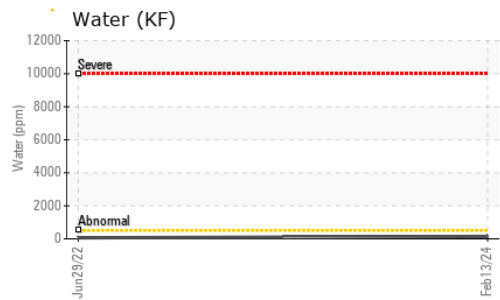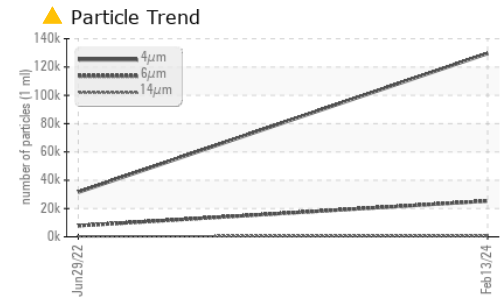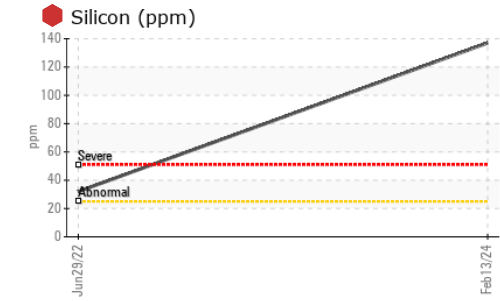





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	VLITE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	45	46.4	49.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

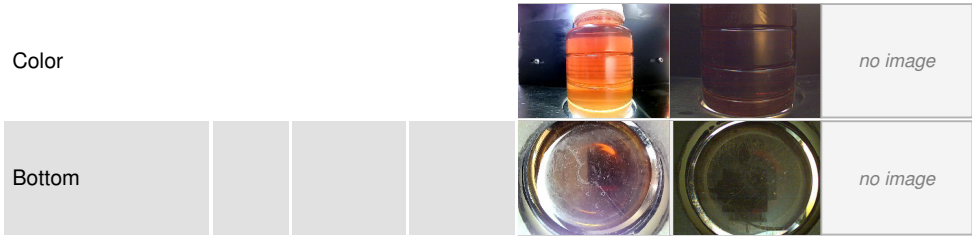

GRAPHS

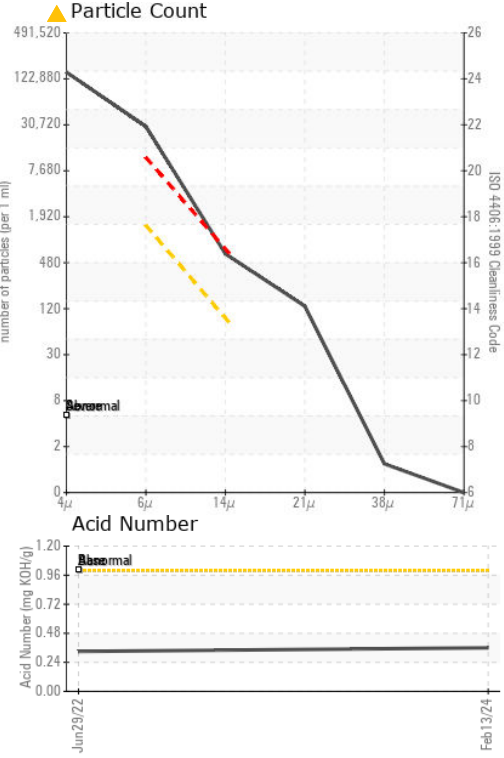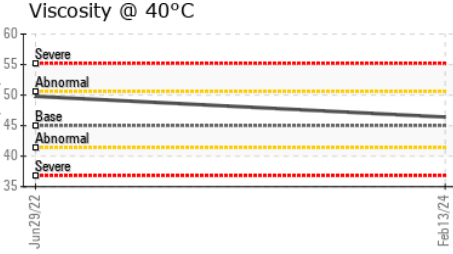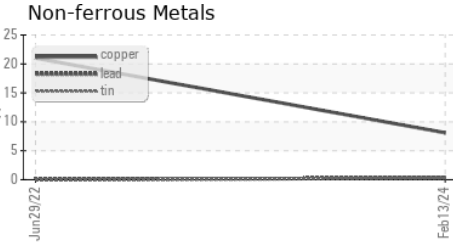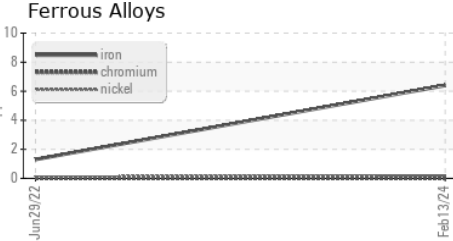

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA008532 **Received** : 22 Feb 2024
Lab Number : 06097704 **Tested** : 23 Feb 2024
Unique Number : 10890557 **Diagnosed** : 25 Feb 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

NICRO INC
 635 DELANO DR
 OAKDALE, CA
 US 95361
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)