

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



FRICK C-4 1100 (S/N 2284DD)

Refrigeration Compressor

USPI 1009-68 SC (15 GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


| v2013 Aug/2014 Nov/2015 Dec2017 Agv/2019 Agv/2020 Jul/2021 Dec2022 | | | | | | |
|--|----------|--------------|------------|-------------|-------------|-------------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | USP0007745 | USP0003484 | USP249594 |
| Sample Date | | Client Info | | 21 Feb 2024 | 02 Nov 2023 | 06 Jul 2023 |
| Machine Age | hrs | Client Info | | 73438 | 71241 | 69396 |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Changed | | Client Info | | N/A | N/A | Not Changd |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >8 | 0 | 0 | 0 |
| Chromium | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >3 | 0 | 0 | <1 |
| Lead | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >8 | 0 | <1 | 0 |
| Tin | ppm | ASTM D5185m | >4 | <1 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | <1 | 0 | <1 |
| Magnesium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | | 1 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Zinc | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Sulfur | ppm | ASTM D5185m | 50 | 0 | 0 | 0 |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >15 | 2 | 1 | <1 |
| Sodium | ppm | ASTM D5185m | | <1 | <1 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | <1 | 0 | 0 |
| Water | % | ASTM D6304 | >0.01 | 0.001 | 0.007 | 0.004 |
| ppm Water | ppm | ASTM D6304 | >100 | 9 | 76 | 42.6 |
| FLUID CLEANLIN | ESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | >10000 | 3064 | 2312 | 681 |
| Particles >6µm | | ASTM D7647 | >2500 | 724 | 545 | 183 |
| Particles >14µm | | ASTM D7647 | >320 | 31 | 25 | 9 |
| Particles >21µm | | ASTM D7647 | >80 | 6 | 5 | 3 |
| Particles >38µm | | ASTM D7647 | >20 | 0 | 0 | 1 |
| Particles >71µm | | ASTM D7647 | >4 | 0 | 0 | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >20/18/15 | 19/17/12 | 18/16/12 | 17/15/10 |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D974 | 0.005 | 0.014 | 0.01 | 0.015 |





OIL ANALYSIS REPORT




| ***** | | um) | | 1 | | | | |
|-------|----------|-----------|----------|---------|---------|---------|----------|--|
| | | | | 1 | 1 | | | |
| Abnor | rmal | | . , | \prod | 1 | | | |
| | _ | Bell Live | 1 | N | 1 | | | 64 |
| 73 | Aug21/14 | Nov12/15 | Dec21/17 | /19 | Apr8/20 | ul26/21 | Dec15/22 | |
| | //3 | Abnormal | Abnomal | Abnomal | Δbnomal | Δbnomal | Δbnomal | Abnormal 6µm 14µm 14µm 1 6µm 1 |







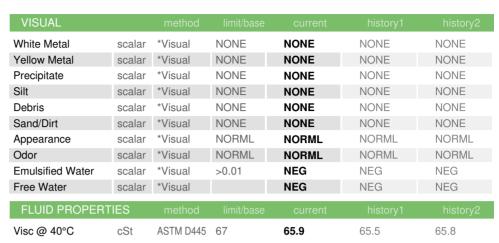


| SAMPLE IMAGES | method |
|---------------|--------|
| | |



Color



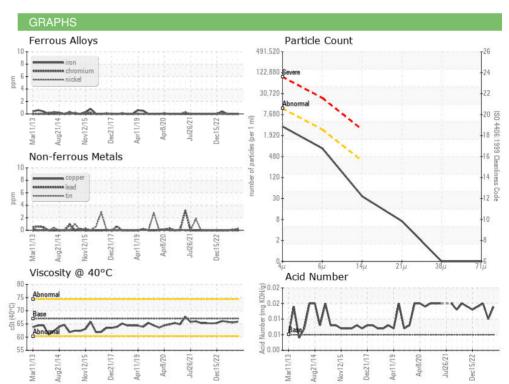





Certificate L2367

Laboratory Sample No. Lab Number Unique Number: 10890600

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : USP0007745 : 06097747

Received : 22 Feb 2024 **Tested** : 25 Feb 2024 Diagnosed

: 25 Feb 2024 - Doug Bogart

CARGILL MEATS

SPRUCE GROVE, AB

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: