




# OIL ANALYSIS REPORT

Sample Rating Trend

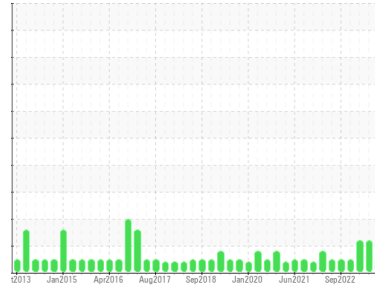

**NORMAL**



Area

## Refrigeration Compressor

Machine Id

### FRICK TYSLEX 5 FRK (S/N S0095HFMPTOAA3)

Component

Refrigeration Compressor

Fluid

USPI 1009-68 SC (--- GAL)

#### DIAGNOSIS

##### Recommendation

Resample at the next service interval to monitor.

##### Wear

All component wear rates are normal.

##### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

##### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

#### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0007784</b>	USP243925	USP183536
Sample Date	Client Info		<b>21 Feb 2024</b>	17 Oct 2023	18 Jul 2023
Machine Age	hrs	Client Info	<b>1331</b>	28976	27535
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ABNORMAL	ATTENTION

#### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >4	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

#### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>1</b>	1	0
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 50	<b>4</b>	0	11

#### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>7</b>	10	2
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304 >0.01	<b>0.002</b>	0.006	0.004
ppm Water	ppm	ASTM D6304 >100	<b>21</b>	64.0	43.2

#### FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>7207</b>	▲ 20379	▲ 10375
Particles >6µm	ASTM D7647	>2500	<b>1630</b>	▲ 4883	▲ 3032
Particles >14µm	ASTM D7647	>320	<b>62</b>	112	148
Particles >21µm	ASTM D7647	>80	<b>10</b>	13	25
Particles >38µm	ASTM D7647	>20	<b>0</b>	0	1
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>20/18/13</b>	▲ 22/19/14	▲ 21/19/14

#### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.014</b>	0.014	0.015




# OIL ANALYSIS REPORT

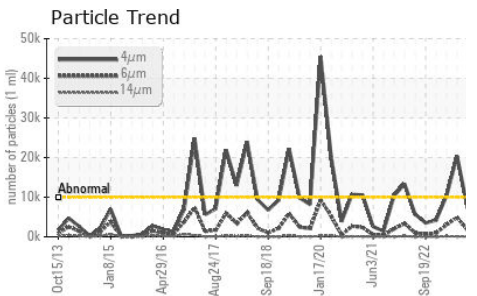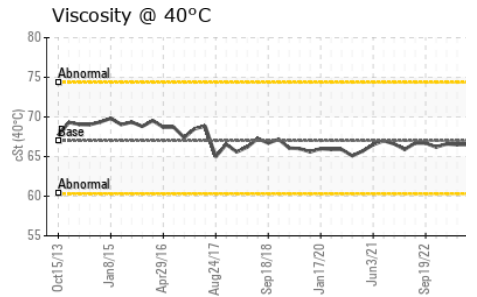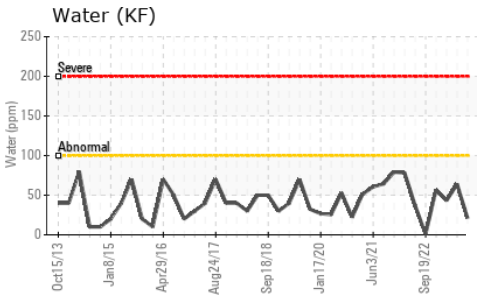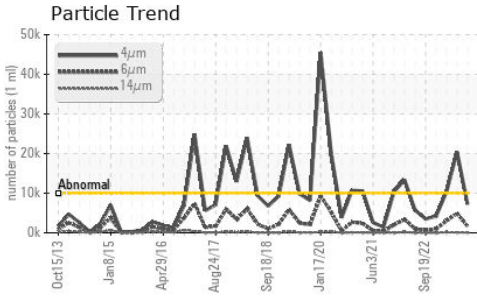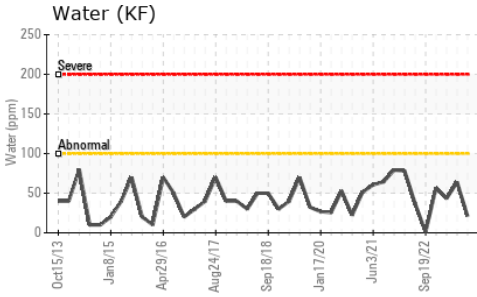






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67	66.5	66.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

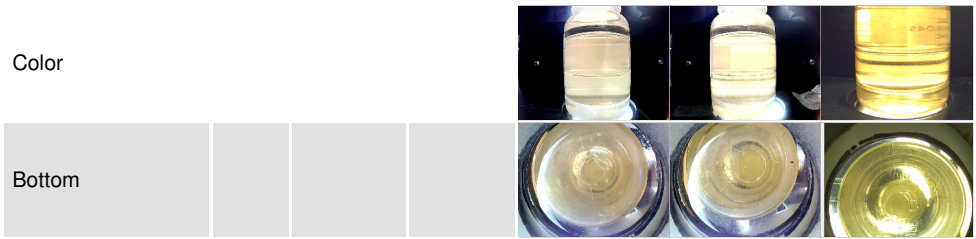

## GRAPHS

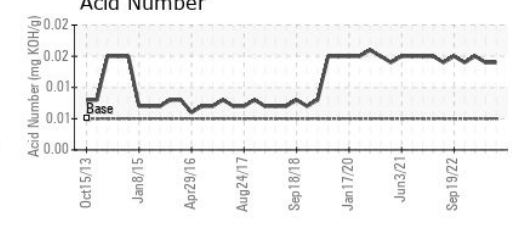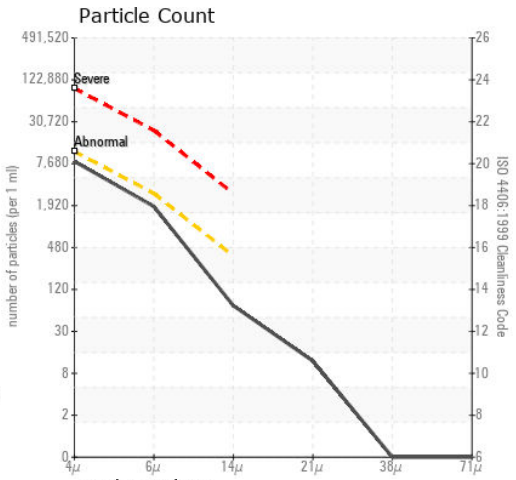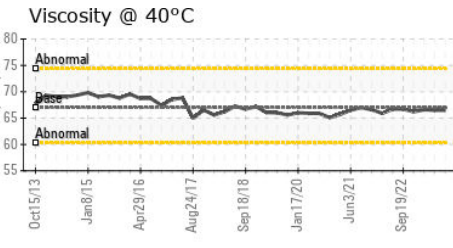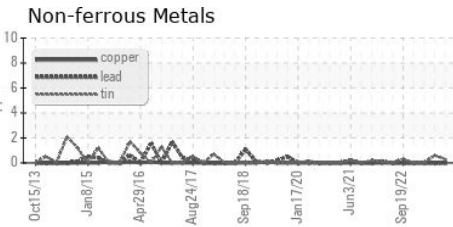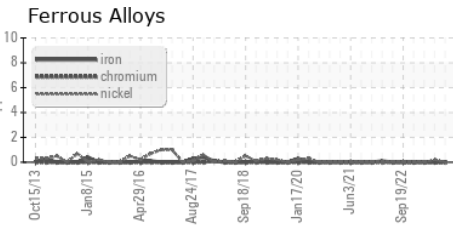

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0007784  
**Lab Number** : 06097754  
**Unique Number** : 10890607  
**Test Package** : IND 2

**TYSON-LEXINGTON-USP - MAIN PLANT**  
 PO BOX 920, PROSPECT ROAD US 283  
 LEXINGTON, NE  
 US 68850  
 Contact: SCOTT NIERMAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (308)324-8221  
 F: (308)324-8233