




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

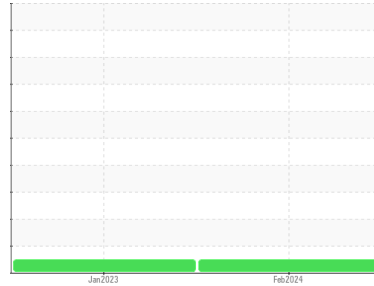

Machine Id
KYSER MARKETPLACE HERON BAY RACK A (S/N 010115646)

Component
Refrigeration Compressor
Fluid
POE (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a trace of moisture present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0763585	WC0763565	---
Sample Date	Client Info	06 Feb 2024	30 Jan 2023	---
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	Not Changed	Not Changed	---
Sample Status		NORMAL	NORMAL	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	2	4
Chromium	ppm	ASTM D5185m >2	0	0
Nickel	ppm	ASTM D5185m	<1	0
Titanium	ppm	ASTM D5185m	0	0
Silver	ppm	ASTM D5185m >2	0	0
Aluminum	ppm	ASTM D5185m >3	<1	0
Lead	ppm	ASTM D5185m >2	<1	<1
Copper	ppm	ASTM D5185m >8	3	<1
Tin	ppm	ASTM D5185m >4	1	<1
Vanadium	ppm	ASTM D5185m	0	0
Cadmium	ppm	ASTM D5185m	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0
Barium	ppm	ASTM D5185m	0	<1
Molybdenum	ppm	ASTM D5185m	0	0
Manganese	ppm	ASTM D5185m	<1	0
Magnesium	ppm	ASTM D5185m	<1	<1
Calcium	ppm	ASTM D5185m	<1	0
Phosphorus	ppm	ASTM D5185m	1	3
Zinc	ppm	ASTM D5185m	0	<1
Sulfur	ppm	ASTM D5185m	13	51

CONTAMINANTS




method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	3	10
Sodium	ppm	ASTM D5185m	0	0
Potassium	ppm	ASTM D5185m >20	<1	0
Water	%	ASTM D6304 >0.01	0.021	0.010
ppm Water	ppm	ASTM D6304 >100	216	108.3

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.015	0.229




OIL ANALYSIS REPORT

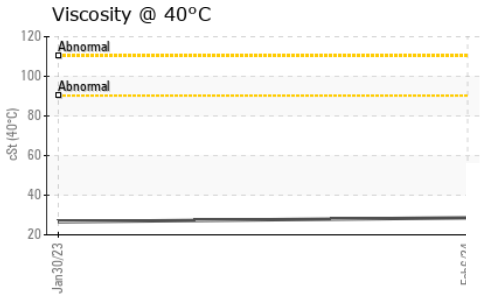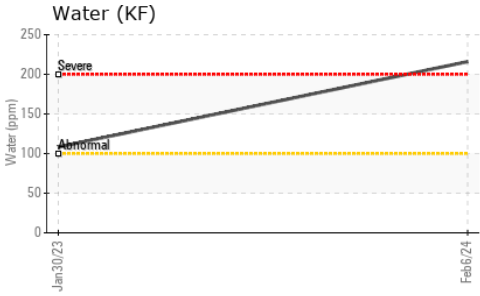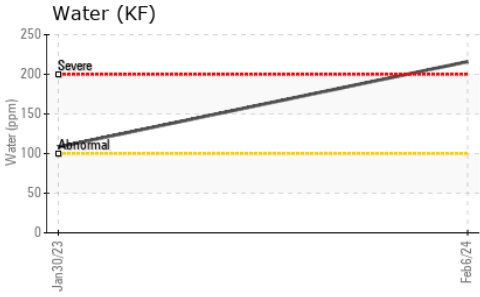





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	28.6	26.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

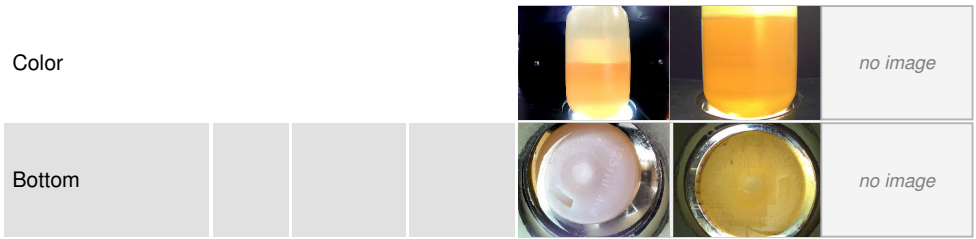

GRAPHS

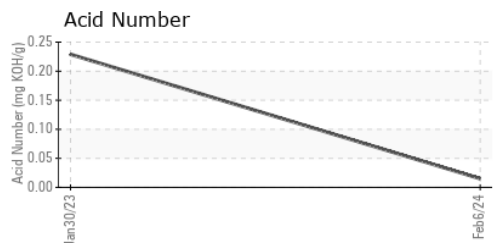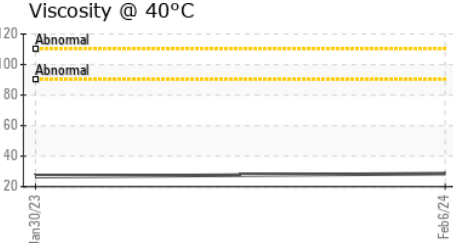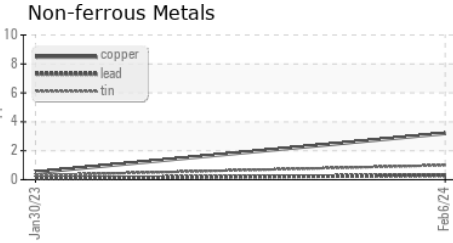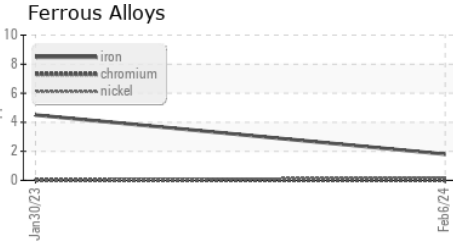

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0763585 **Received** : 22 Feb 2024
Lab Number : 06097774 **Tested** : 25 Feb 2024
Unique Number : 10896004 **Diagnosed** : 25 Feb 2024 - Doug Bogart
Test Package : PLANT

CHILLTECH
 PO BOX 225
 MANGROVE BAY, ZZ
 BM
 Contact: KEVIN ROBERTS
 kevin.roberts@chilltech.bm
 T: (441)536-9002
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)