




OIL ANALYSIS REPORT

Sample Rating Trend

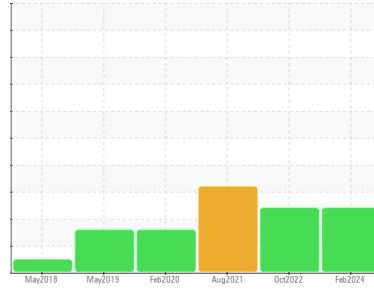

WATER



Machine Id
TYLER RACK 3 - LINDOS MARKET (S/N 381557-3)

Component
Refrigeration Compressor
Fluid
POE (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear

The iron level has decreased, but is still abnormal. All other component wear rates are normal.

▲ Contamination

There is a trace of moisture present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0884622	WC0541683	WC0541672
Sample Date	Client Info		16 Feb 2024	30 Oct 2022	13 Aug 2021
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	Not Changd
Sample Status			MARGINAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	▲ 68	▲ 88	▲ 62
Chromium	ppm	ASTM D5185m >2	<1	<1	<1
Nickel	ppm	ASTM D5185m	<1	0	0
Titanium	ppm	ASTM D5185m	<1	<1	<1
Silver	ppm	ASTM D5185m >2	0	2	<1
Aluminum	ppm	ASTM D5185m >3	2	2	1
Lead	ppm	ASTM D5185m >2	<1	2	2
Copper	ppm	ASTM D5185m >8	2	6	▲ 52
Tin	ppm	ASTM D5185m >4	2	2	2
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	<1
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	0	0	0
Calcium	ppm	ASTM D5185m	1	0	0
Phosphorus	ppm	ASTM D5185m	5	8	7
Zinc	ppm	ASTM D5185m	8	23	16
Sulfur	ppm	ASTM D5185m	8	31	8

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	9	10	5
Sodium	ppm	ASTM D5185m	<1	0	<1
Potassium	ppm	ASTM D5185m >20	<1	1	0
Water	%	ASTM D6304 >0.01	▲ 0.011	▲ 0.013	▲ 0.021
ppm Water	ppm	ASTM D6304 >100	▲ 116	▲ 135.2	▲ 214.8


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.061	0.046	0.078




OIL ANALYSIS REPORT


Water (KF)

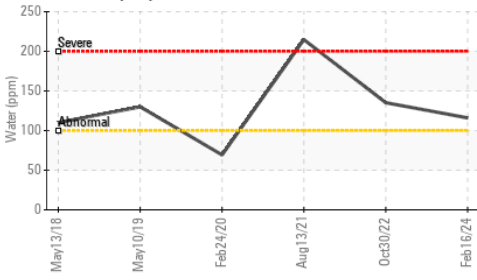


Ferrous Alloys

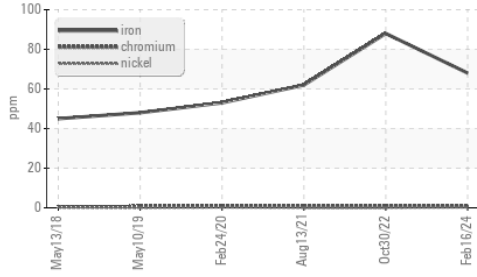

Acid Number

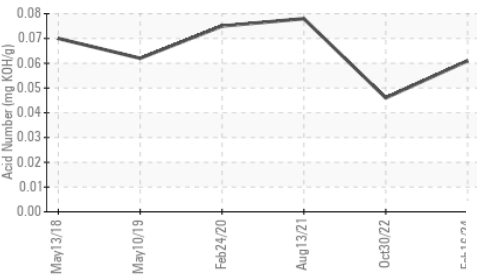

Viscosity @ 40°C

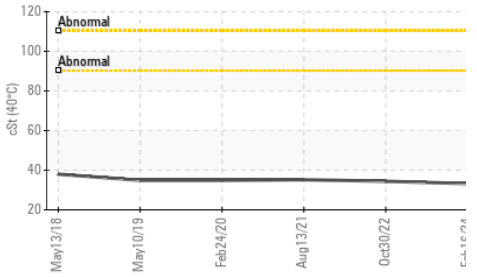

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	33.2	34.4	35.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

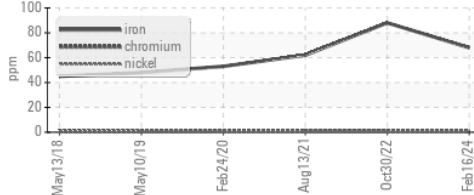


Non-ferrous Metals

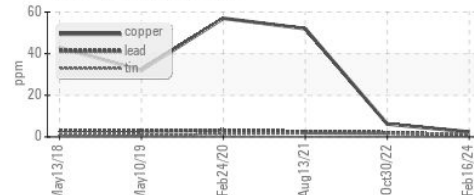

Viscosity @ 40°C

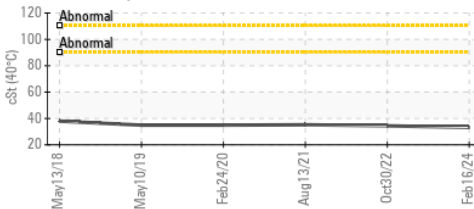

Acid Number

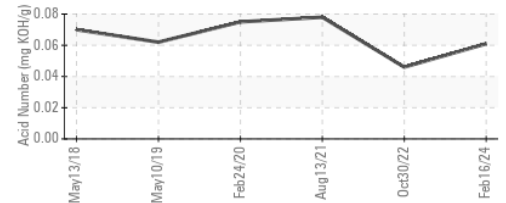

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0884622
 Lab Number : 06097777
 Unique Number : 10896007
 Test Package : PLANT

Received : 22 Feb 2024
 Tested : 25 Feb 2024
 Diagnosed : 25 Feb 2024 - Doug Bogart

CHILLTECH
 PO BOX 225
 MANGROVE BAY, ZZ
 BM

Contact: KEVIN ROBERTS
 kevin.roberts@chilltech.bm

T: (441)536-9002

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)