




# OIL ANALYSIS REPORT

Sample Rating Trend

**WATER**



Machine Id  
**HILL PHOENIX RACK B - LOW TEMP - HARRINGTON HUNDREDS (S/N 63777)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**POE (--- GAL)**

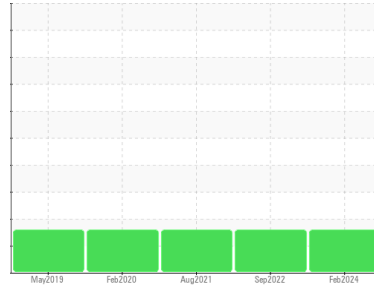

## DIAGNOSIS

**Recommendation**  
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a trace of moisture present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0763576</b>	WC0541687	WC0423452
Sample Date	Client Info		<b>07 Feb 2024</b>	21 Sep 2022	27 Aug 2021
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	Not Changd
Sample Status			<b>MARGINAL</b>	MARGINAL	MARGINAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	2	<1
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	2	<1
Aluminum	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m >4	<b>1</b>	<1	1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	<1	1
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>2</b>	4	2
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>0</b>	123	12

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	3	3
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	1	0
Water	%	ASTM D6304 >0.01	<b>▲ 0.014</b>	▲ 0.043	▲ 0.014
ppm Water	ppm	ASTM D6304 >100	<b>▲ 145</b>	▲ 431.1	▲ 144.3

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.028</b>	0.015	0.027




# OIL ANALYSIS REPORT

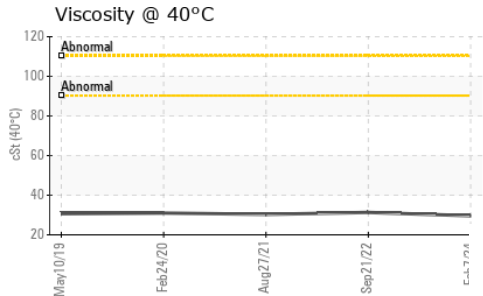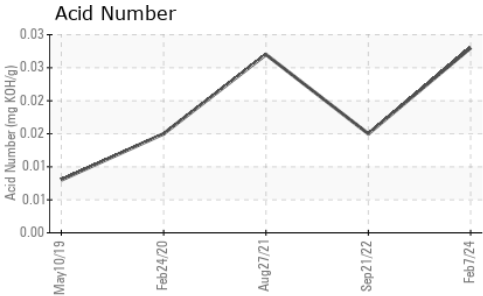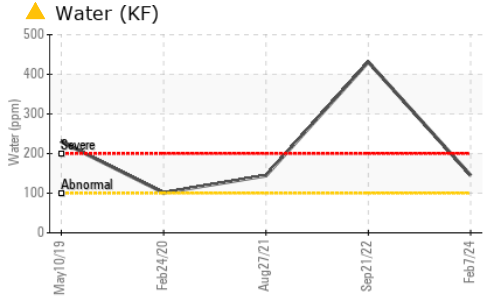





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	29.6	31.3	30.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

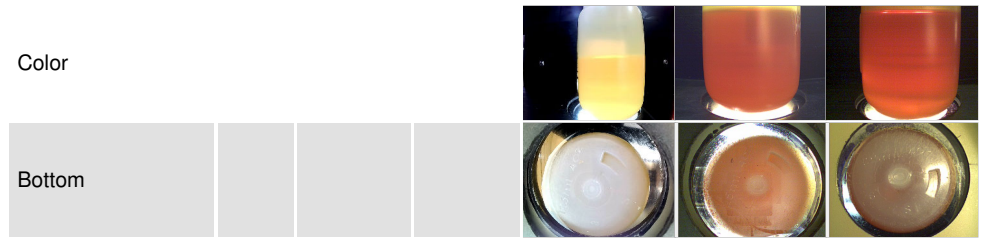

## GRAPHS

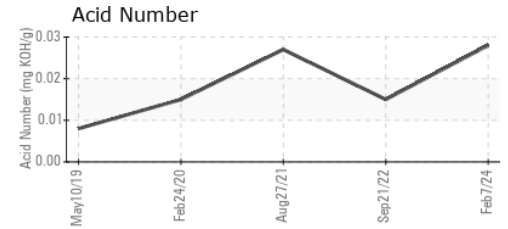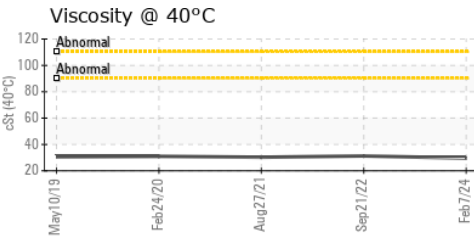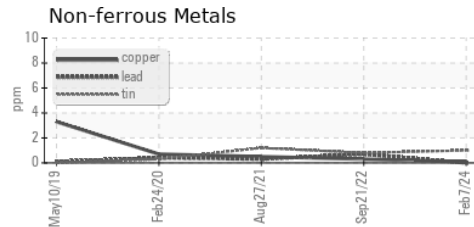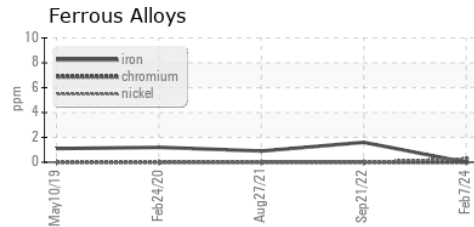

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0763576  
**Lab Number** : 06097780  
**Unique Number** : 10896010  
**Test Package** : PLANT  
**Received** : 22 Feb 2024  
**Tested** : 25 Feb 2024  
**Diagnosed** : 25 Feb 2024 - Doug Bogart

**CHILLTECH**  
 PO BOX 225  
 MANGROVE BAY, ZZ  
 BM  
 Contact: KEVIN ROBERTS  
 kevin.roberts@chilltech.bm  
 T: (441)536-9002  
 F: x:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)