




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

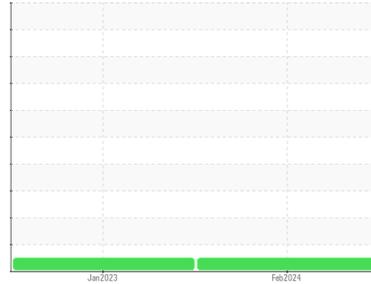

Machine Id  
**KYSER MARKETPLACE MODERN MEAT RACK A (S/N 0203000430)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**POE (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

An increase in the AN level is noted. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0763575</b>	WC0763567	---
Sample Date	Client Info		<b>06 Feb 2024</b>	30 Jan 2023	---
Machine Age	hrs	Client Info	<b>0</b>	0	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	Not Changd	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>4</b>	5	---
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Lead	ppm	ASTM D5185m >2	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m >8	<b>15</b>	6	---
Tin	ppm	ASTM D5185m >4	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>0</b>	<1	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	---
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	2	---
Zinc	ppm	ASTM D5185m	<b>0</b>	<1	---
Sulfur	ppm	ASTM D5185m	<b>&lt;1</b>	0	---

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>3</b>	2	---
Sodium	ppm	ASTM D5185m	<b>0</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	---
Water	%	ASTM D6304 >0.01	<b>0.008</b>	0.006	---
ppm Water	ppm	ASTM D6304 >100	<b>86</b>	60.0	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.135</b>	0.092	---




# OIL ANALYSIS REPORT

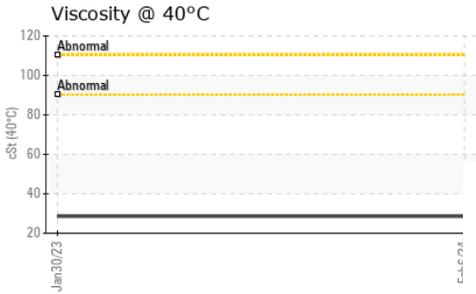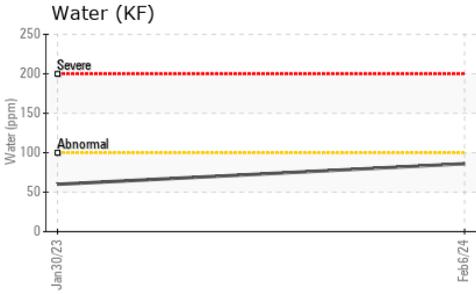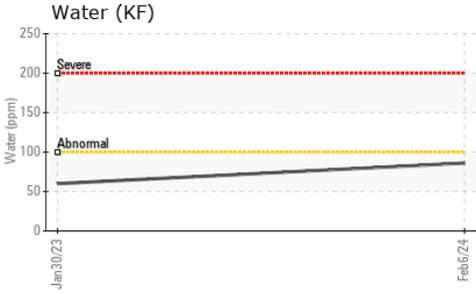





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>28.6</b>	28.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

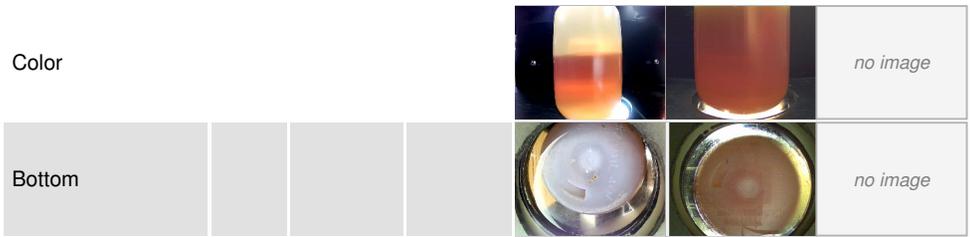

## GRAPHS

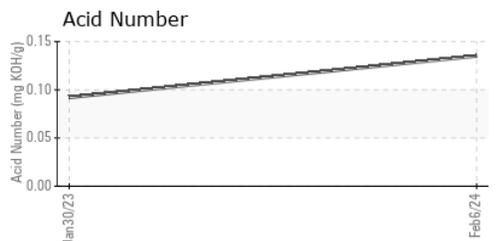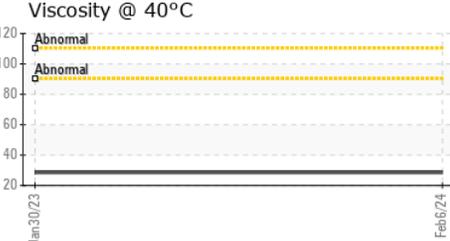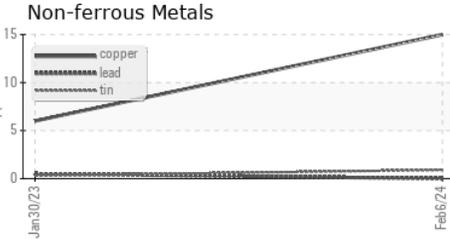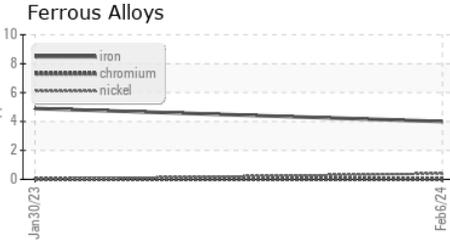

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0763575 **Received** : 22 Feb 2024  
**Lab Number** : 06097785 **Tested** : 25 Feb 2024  
**Unique Number** : 10896015 **Diagnosed** : 25 Feb 2024 - Doug Bogart  
**Test Package** : PLANT

**CHILLTECH**  
 PO BOX 225  
 MANGROVE BAY, ZZ  
 BM  
 Contact: KEVIN ROBERTS  
 kevin.roberts@chilltech.bm  
 T: (441)536-9002  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)