

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area
ULTRA COOLANT [58647]
 Machine Id
INGERSOLL RAND CK3761U00272 - ITW-ALPINE
 Component
Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info	UCH06097844	---	---
Sample Date	Client Info	09 Feb 2024	---	---
Machine Age	hrs Client Info	47353	---	---
Oil Age	hrs Client Info	5805	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		NORMAL	---	---

CONTAMINATION method limit/base current history1 history2

Water	WC Method	>0.1	NEG	---	---
-------	-----------	------	------------	-----	-----

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	1	---	---
Chromium	ppm	ASTM D5185m	>10	<1	---	---
Nickel	ppm	ASTM D5185m		<1	---	---
Titanium	ppm	ASTM D5185m		<1	---	---
Silver	ppm	ASTM D5185m		<1	---	---
Aluminum	ppm	ASTM D5185m	>25	<1	---	---
Lead	ppm	ASTM D5185m	>25	<1	---	---
Copper	ppm	ASTM D5185m	>50	2	---	---
Tin	ppm	ASTM D5185m	>15	1	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
Cadmium	ppm	ASTM D5185m		<1	---	---

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m	0	0	---	---
Barium	ppm	ASTM D5185m	500	547	---	---
Molybdenum	ppm	ASTM D5185m	0	<1	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m	0	3	---	---
Calcium	ppm	ASTM D5185m	0	1	---	---
Phosphorus	ppm	ASTM D5185m	20	0	---	---
Zinc	ppm	ASTM D5185m	0	7	---	---
Sulfur	ppm	ASTM D5185m	200	213	---	---



CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	2	---	---
Sodium	ppm	ASTM D5185m		17	---	---
Potassium	ppm	ASTM D5185m	>20	2	---	---

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045		0.04	---	---
------------------	----------	------------	--	-------------	-----	-----

OIL ANALYSIS REPORT

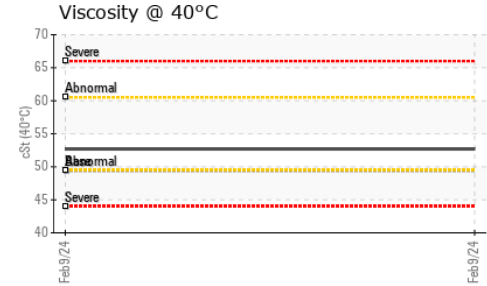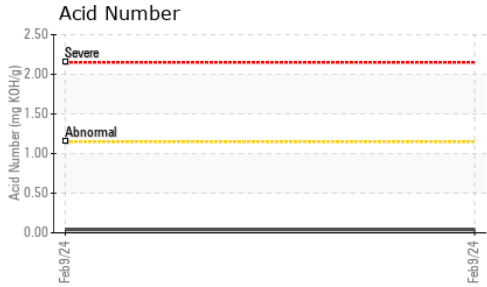





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.4	52.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

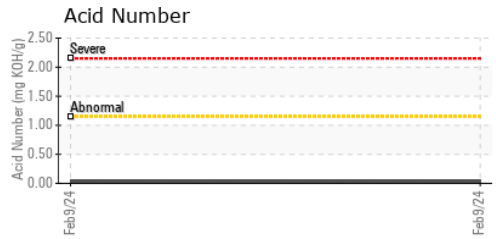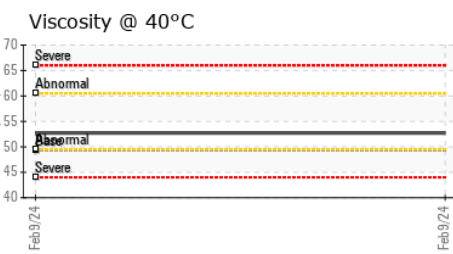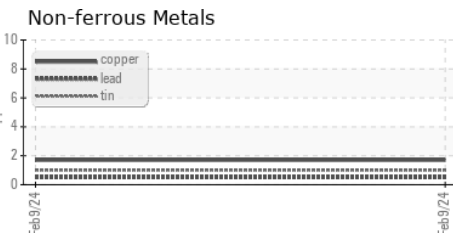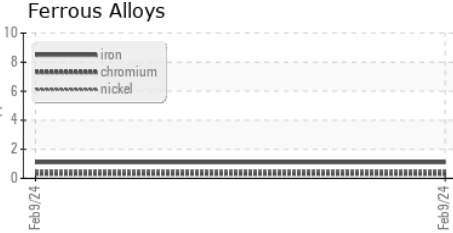

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : UCH06097844
 Lab Number : **06097844**
 Unique Number : 10896074
 Test Package : IND 2

Received : 22 Feb 2024
 Tested : 23 Feb 2024
 Diagnosed : 25 Feb 2024 - Don Baldrige

JOHN HENRY FOSTER COMPANY
 4700 LEBOURGET STREET
 SAINT LOUIS, MO
 US 63134
 Contact: RACHEL VON HATTEN
 rvonhatten@jhf.com
 T: (314)593-1267
 F: (314)874-0965

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)