


PROBLEM SUMMARY

Area
DIAMOND BLUE 10K [OIL-46982]
Machine Id
INGERSOLL RAND MOX1006026 - GREENBRIER
Component
Compressor

Sample Rating Trend

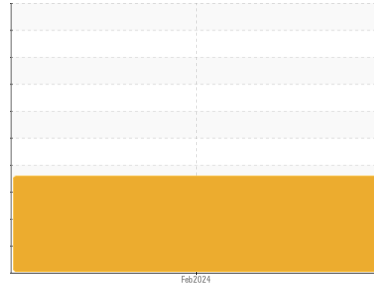


DEGRADATION




COMPONENT CONDITION SUMMARY

Acid Number

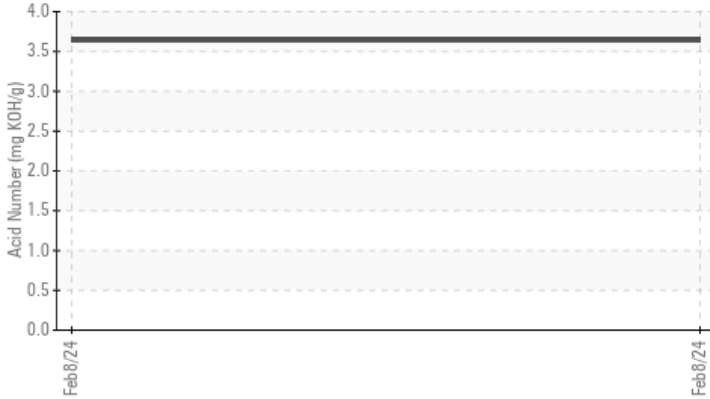

Viscosity @ 40°C

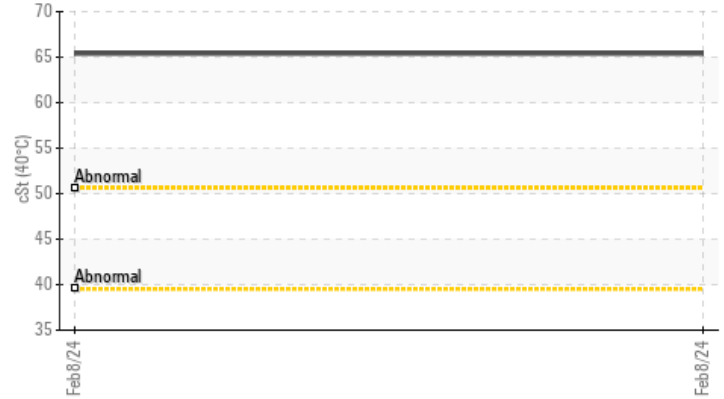

RECOMMENDATION

We advise that you check for a possible overheat condition. Recommend drain oil if not already done and flush with cleaner before refilling with oil. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status	mg KOH/g	ASTM D8045	SEVERE	---	---
Acid Number (AN)	3.64		3.64	---	---

Customer Id: UCJOHSAI
Sample No.: UCH06097866
Lab Number: 06097866
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Recommend drain oil if not already done and flush with cleaner before refilling with oil.
Flush System	---	---	?	Recommend drain oil if not already done and flush with cleaner before refilling with oil.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check For Overheating	---	---	?	We advise that you check for a possible overheat condition.

HISTORICAL DIAGNOSIS

OIL ANALYSIS REPORT

Sample Rating Trend

DEGRADATION

Area
DIAMOND BLUE 10K [OIL-46982]
Machine Id
INGERSOLL RAND MOX1006026 - GREENBRIER
Component
Compressor



DIAGNOSIS

Recommendation

We advise that you check for a possible overheat condition. Recommend drain oil if not already done and flush with cleaner before refilling with oil. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is above the recommended limit. The oil viscosity is higher than normal. TAN level indicates possible presence of varnish. The oil is no longer serviceable.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCH06097866	---	---
Sample Date	Client Info		08 Feb 2024	---	---
Machine Age	hrs	Client Info	9555	---	---
Oil Age	hrs	Client Info	5276	---	---
Oil Changed	Client Info		Not Chngd	---	---
Sample Status			SEVERE	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	---	---
Chromium	ppm	ASTM D5185m >10	<1	---	---
Nickel	ppm	ASTM D5185m	<1	---	---
Titanium	ppm	ASTM D5185m	<1	---	---
Silver	ppm	ASTM D5185m	<1	---	---
Aluminum	ppm	ASTM D5185m >25	<1	---	---
Lead	ppm	ASTM D5185m >25	<1	---	---
Copper	ppm	ASTM D5185m >50	<1	---	---
Tin	ppm	ASTM D5185m >15	<1	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	<1	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	13	---	---
Molybdenum	ppm	ASTM D5185m	<1	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m	0	---	---
Calcium	ppm	ASTM D5185m	0	---	---
Phosphorus	ppm	ASTM D5185m	143	---	---
Zinc	ppm	ASTM D5185m	2	---	---
Sulfur	ppm	ASTM D5185m	0	---	---



CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	---	---
Sodium	ppm	ASTM D5185m	0	---	---
Potassium	ppm	ASTM D5185m >20	<1	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	3.64	---	---

OIL ANALYSIS REPORT

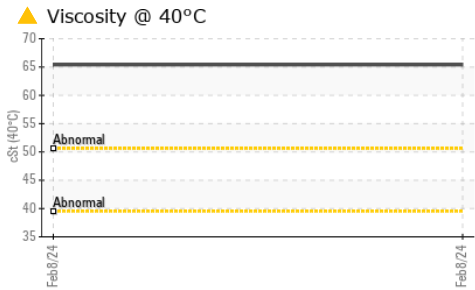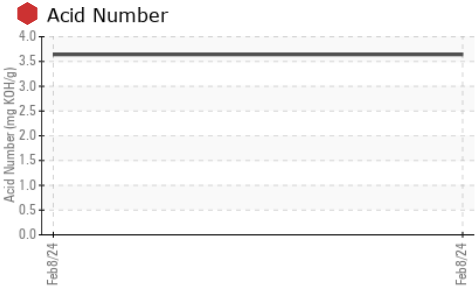





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	▲ 65.4	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

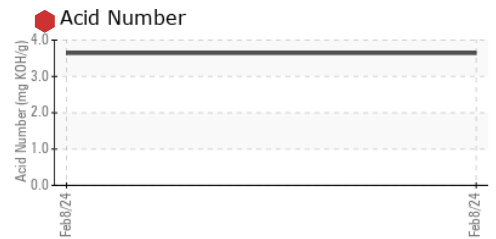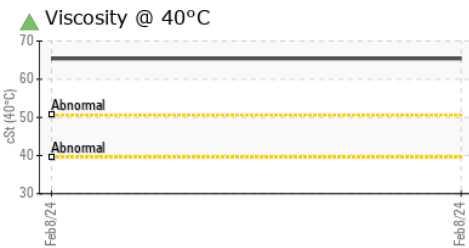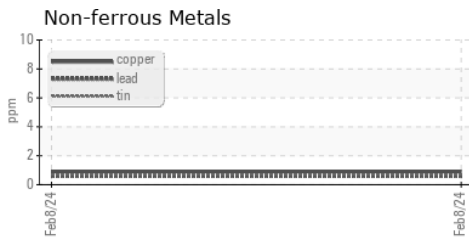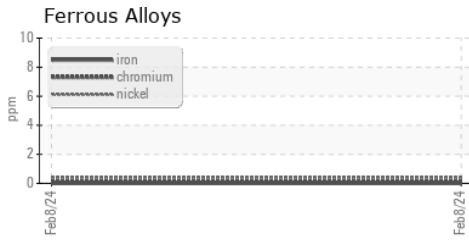

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06097866 **Received** : 22 Feb 2024
Lab Number : 06097866 **Tested** : 23 Feb 2024
Unique Number : 10896096 **Diagnosed** : 26 Feb 2024 - Jonathan Hester
Test Package : IND 2

JOHN HENRY FOSTER COMPANY
 4700 LEBOURGET STREET
 SAINT LOUIS, MO
 US 63134
 Contact: RACHEL VON HATTEN
 rvonhatten@jhf.com
 T: (314)593-1267
 F: (314)874-0965

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)