


# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

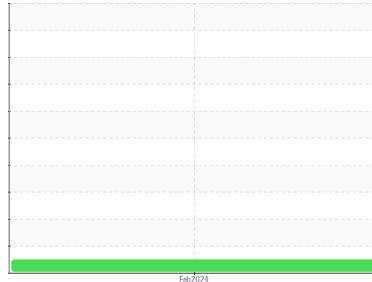

Machine Id

**T259**

Component

**Gearbox**

Fluid

**TULCO LUBSOIL 4220 SYN GEAR 220 (150 GAL)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The condition of the oil is acceptable for the time in service.

**SAMPLE INFORMATION** method limit/base current history1 history2

Sample Number	Client Info	<b>TO50002069</b>	---	---
Sample Date	Client Info	<b>13 Feb 2024</b>	---	---
Machine Age	hrs	Client Info	<b>4470</b>	---
Oil Age	hrs	Client Info	<b>0</b>	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>NORMAL</b>	---	---

**CONTAMINATION** method limit/base current history1 history2

Water	WC Method	>0.2	<b>NEG</b>	---	---
-------	-----------	------	------------	-----	-----

**WEAR METALS** method limit/base current history1 history2

PQ		ASTM D8184		<b>12</b>	---	---
Iron	ppm	ASTM D5185m	>200	<b>101</b>	---	---
Chromium	ppm	ASTM D5185m	>15	<b>1</b>	---	---
Nickel	ppm	ASTM D5185m	>15	<b>2</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>5</b>	---	---
Lead	ppm	ASTM D5185m	>100	<b>10</b>	---	---
Copper	ppm	ASTM D5185m	>200	<b>4</b>	---	---
Tin	ppm	ASTM D5185m	>25	<b>2</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---

**ADDITIVES** method limit/base current history1 history2

Boron	ppm	ASTM D5185m		<b>2</b>	---	---
Barium	ppm	ASTM D5185m		<b>7</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>430</b>	---	---
Manganese	ppm	ASTM D5185m		<b>2</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>1</b>	---	---
Calcium	ppm	ASTM D5185m		<b>4</b>	---	---
Phosphorus	ppm	ASTM D5185m	230	<b>810</b>	---	---
Zinc	ppm	ASTM D5185m		<b>33</b>	---	---
Sulfur	ppm	ASTM D5185m	2530	<b>26551</b>	---	---



**CONTAMINANTS** method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>50	<b>9</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	---	---

**VISUAL** method limit/base current history1 history2

White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---





# OIL ANALYSIS REPORT

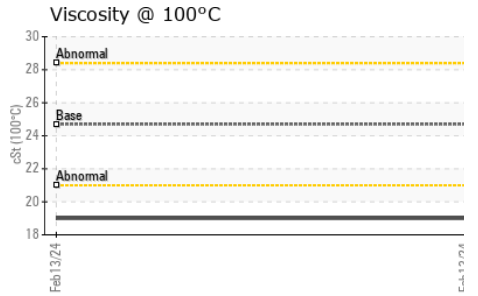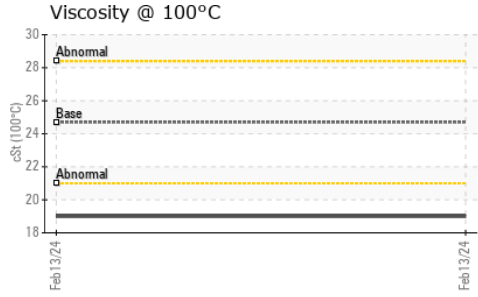

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	212	<b>221</b>	---
Visc @ 100°C	cSt	ASTM D445	24.7	<b>19.0</b>	---
Viscosity Index (VI)	Scale	ASTM D2270	146	<b>96</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS

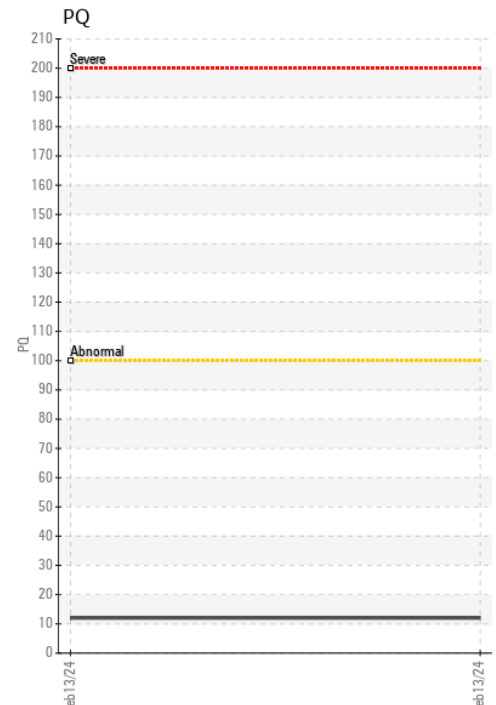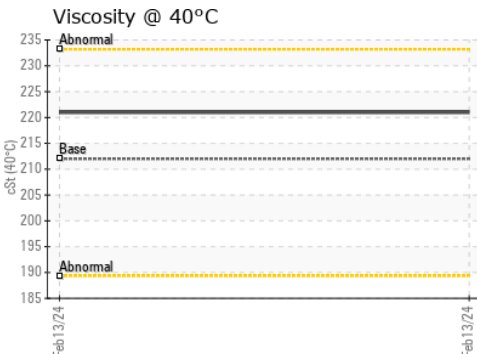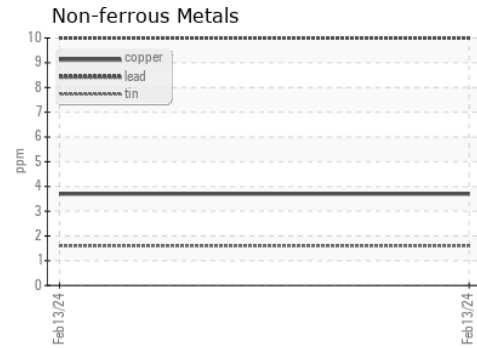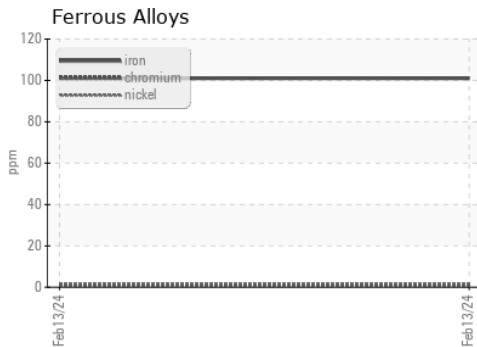

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TO50002069 **Received** : 22 Feb 2024  
**Lab Number** : **06097998** **Tested** : 26 Feb 2024  
**Unique Number** : 10896228 **Diagnosed** : 26 Feb 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KV100, PQ, VI )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**KLX ENERGY SERVICES**  
 5104 ESTES PKWY  
 LONGVIEW, TX  
 US 75603  
 Contact: DUSTIN TREST  
 dustin.trest@klx.com

T:  
F: