




FUEL REPORT

Sample Rating Trend

NORMAL

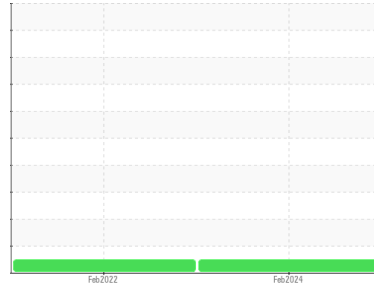

Area
[3186660]
 Machine Id
3039557

Component
Diesel Fuel
 Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			DC0034676	DC0019291	---
Sample Date	Client Info			21 Feb 2024	01 Feb 2022	---
Machine Age	hrs	Client Info		0	380	---
Sample Status				NORMAL	NORMAL	---

PHYSICAL PROPERTIES

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		L4.5	L5.5	---
Visc @ 40°C	cSt	ASTM D445	3.0	2.27	2.48	---

SULFUR CONTENT

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	<1	2	---
Sulfur (UVF)	ppm	ASTM D5453		8	7	---

IGNITION QUALITY

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	37.1	36.9	---

CONTAMINANTS

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	0	---
Sodium	ppm	ASTM D5185m	<0.1	<1	0	---
Potassium	ppm	ASTM D5185m	<0.1	<1	0	---
Water	%	ASTM D6304	<0.05	0.002	0.003	---
ppm Water	ppm	ASTM D6304	<500	21	29.8	---
% Gasoline	%	*In-House	<0.50	0.0	0.0	---
% Biodiesel	%	*In-House	<20.0	0.0	0.0	---

FLUID CLEANLINESS



FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	---	292	---
Particles >6µm		ASTM D7647	>640	---	86	---
Particles >14µm		ASTM D7647	>80	---	8	---
Particles >21µm		ASTM D7647	>20	---	2	---
Particles >38µm		ASTM D7647	>4	---	0	---
Particles >71µm		ASTM D7647	>3	---	0	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	---	15/14/10	---

HEAVY METALS

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	0	---
Nickel	ppm	ASTM D5185m	<0.1	<1	0	---
Lead	ppm	ASTM D5185m	<0.1	0	0	---
Vanadium	ppm	ASTM D5185m	<0.1	0	0	---
Iron	ppm	ASTM D5185m	<0.1	0	0	---
Calcium	ppm	ASTM D5185m	<0.1	<1	0	---
Magnesium	ppm	ASTM D5185m	<0.1	0	0	---
Phosphorus	ppm	ASTM D5185m	<0.1	<1	1	---
Zinc	ppm	ASTM D5185m	<0.1	0	0	---




FUEL REPORT

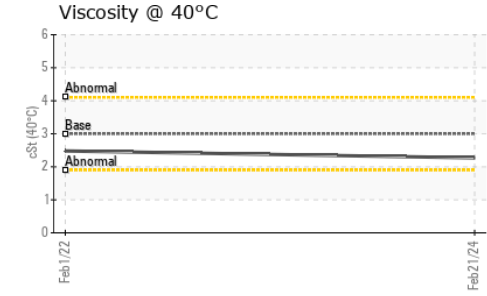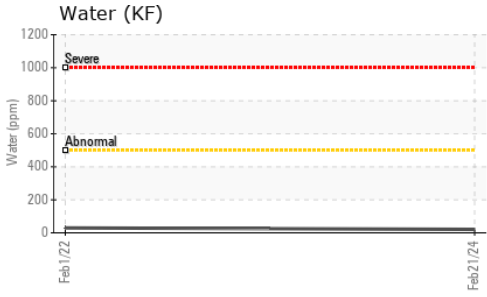

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					no image
Bottom					no image

GRAPHS

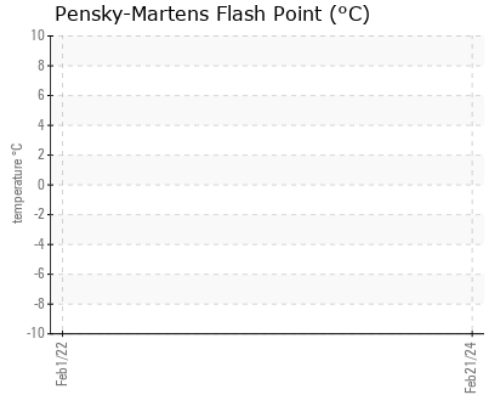

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0034676 **Received** : 22 Feb 2024
Lab Number : 06098060 **Tested** : 27 Feb 2024
Unique Number : 10896290 **Diagnosed** : 27 Feb 2024 - Doug Bogart
Test Package : DF-5 (Additional Tests: API, Cetane, Fuel, Screen)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)