



OIL ANALYSIS REPORT

Sample Rating Trend


NORMAL



Machine Id
AC 6 (S/N 1634-00327)

Component
Air Compressor

Fluid
PALASYN FG 32 (--- GAL)

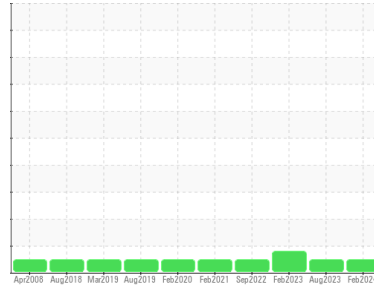

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0903039	WC0847584	WC0789715
Sample Date	Client Info	01 Feb 2024	19 Aug 2023	25 Feb 2023
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.6	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<1	<1	0
Chromium	ppm ASTM D5185m >4	<1	0	0
Nickel	ppm ASTM D5185m >4	<1	0	0
Titanium	ppm ASTM D5185m	<1	0	0
Silver	ppm ASTM D5185m	<1	0	0
Aluminum	ppm ASTM D5185m >10	<1	0	0
Lead	ppm ASTM D5185m >20	<1	0	0
Copper	ppm ASTM D5185m >40	3	1	<1
Tin	ppm ASTM D5185m >5	<1	0	0
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m	5	3	0
Molybdenum	ppm ASTM D5185m	<1	0	0
Manganese	ppm ASTM D5185m	<1	0	0
Magnesium	ppm ASTM D5185m	0	<1	0
Calcium	ppm ASTM D5185m	1	0	0
Phosphorus	ppm ASTM D5185m	254	305	334
Zinc	ppm ASTM D5185m	12	16	2
Sulfur	ppm ASTM D5185m	694	876	1186

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<1	<1	<1
Sodium	ppm ASTM D5185m	0	0	<1
Potassium	ppm ASTM D5185m >20	<1	<1	0

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	1377	458	36606
Particles >6µm	ASTM D7647 >2500	196	113	▲ 6646
Particles >14µm	ASTM D7647 >320	13	7	316
Particles >21µm	ASTM D7647 >80	3	2	82
Particles >38µm	ASTM D7647 >20	0	0	10
Particles >71µm	ASTM D7647 >4	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/18/15	18/15/11	16/14/10	▲ 22/20/15


FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	0.93	0.65	0.51




OIL ANALYSIS REPORT


Particle Trend

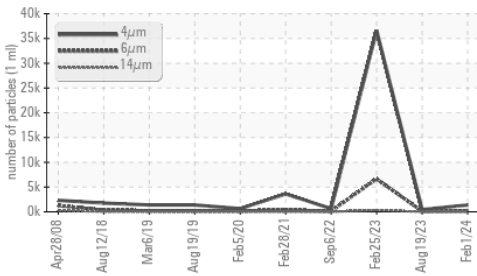


Acid Number

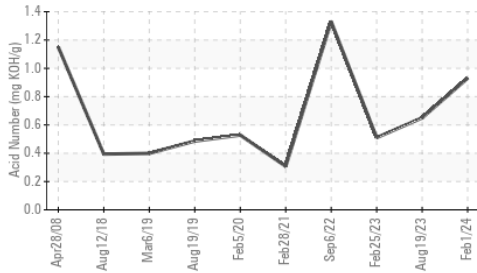

Viscosity @ 40°C

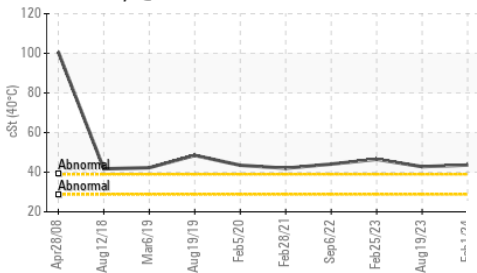


Particle Trend

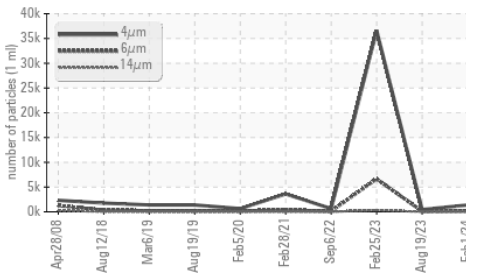






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	43.6	42.8	46.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

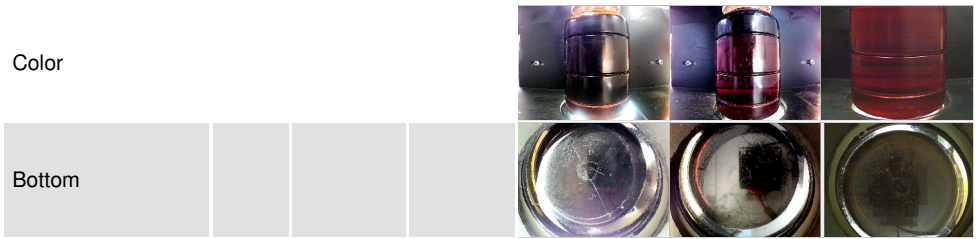

GRAPHS

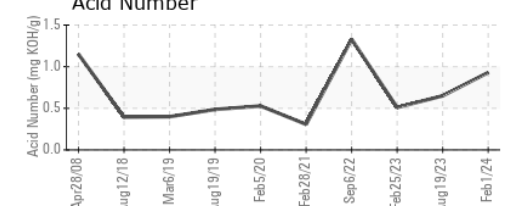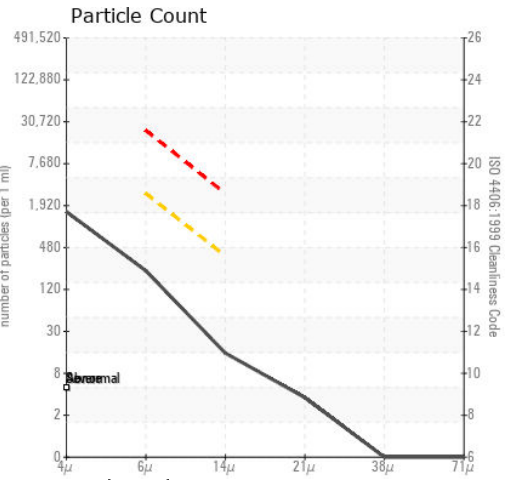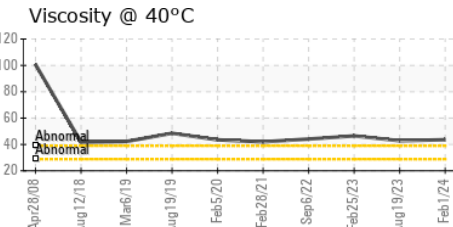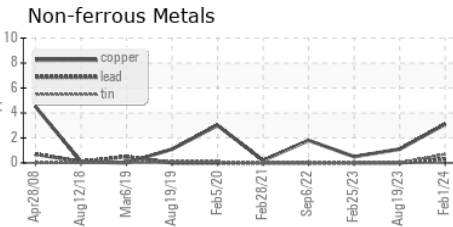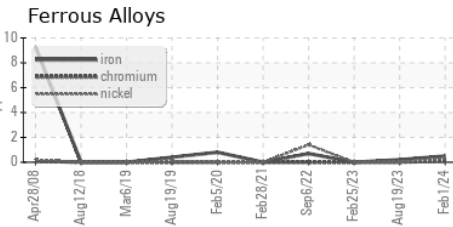

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0903039 **Received** : 23 Feb 2024
Lab Number : 06098383 **Tested** : 26 Feb 2024
Unique Number : 10896613 **Diagnosed** : 26 Feb 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

BRAUM'S ICE CREAM PLANT
 PO BOX 725
 TUTTLE, OK
 US 73089
 Contact: SCOTTY SCOTT
 sscott@braums.com; maintenanceoffice@braums.com
 T: (405)381-4427
 F: (405)381-2051

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)