




OIL ANALYSIS REPORT

Sample Rating Trend

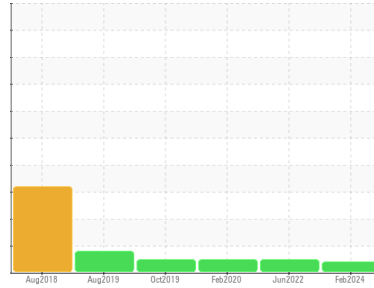

VISCOSITY



Machine Id
C-50 (S/N 4235555)

Component
Gearbox

Fluid
MOBIL SHC 632 (--- GAL)

DIAGNOSIS

▲ Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

▲ Fluid Condition

Viscosity of sample indicates oil is within ISO 220 range, advise investigate. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0903062	WC0733858	WC0430466
Sample Date	Client Info			01 Feb 2024	10 Jun 2022	05 Feb 2020
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ATTENTION	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	2	11	6
Chromium	ppm	ASTM D5185m	>15	<1	<1	0
Nickel	ppm	ASTM D5185m	>15	<1	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	<1	<1
Lead	ppm	ASTM D5185m	>100	<1	0	0
Copper	ppm	ASTM D5185m	>200	1	2	3
Tin	ppm	ASTM D5185m	>25	1	0	0
Antimony	ppm	ASTM D5185m	>5	---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		28	0	0
Barium	ppm	ASTM D5185m		5	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	<1
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		<1	<1	0
Phosphorus	ppm	ASTM D5185m		312	386	350
Zinc	ppm	ASTM D5185m		7	3	1
Sulfur	ppm	ASTM D5185m		11408	50	11

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	6	8	8
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	1	0	<1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	2634	---	---
Particles >6µm		ASTM D7647	>5000	408	---	---
Particles >14µm		ASTM D7647	>640	73	---	---
Particles >21µm		ASTM D7647	>160	15	---	---
Particles >38µm		ASTM D7647	>40	1	---	---
Particles >71µm		ASTM D7647	>10	0	---	---
Oil Cleanliness		ISO 4406 (c)	>21/19/16	19/16/13	---	---



OIL ANALYSIS REPORT

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	0.80	0.32	0.387


VISUAL

method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE
Debris	scalar *Visual	NONE	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML
Emulsified Water	scalar *Visual	>0.2 NEG	NEG	NEG
Free Water	scalar *Visual	NEG	NEG	NEG

FLUID PROPERTIES


method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445	▲ 229	332	332

SAMPLE IMAGES

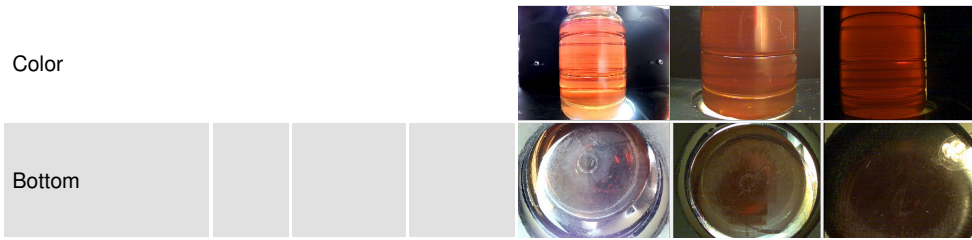


GRAPHS


Ferrous Alloys

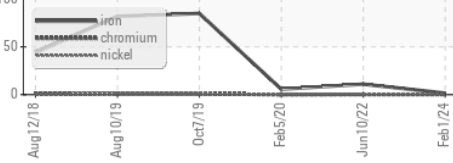


Non-ferrous Metals

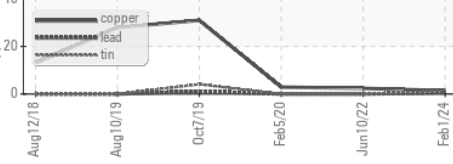




Viscosity @ 40°C

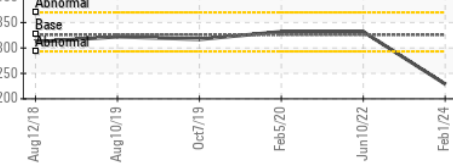

Particle Count

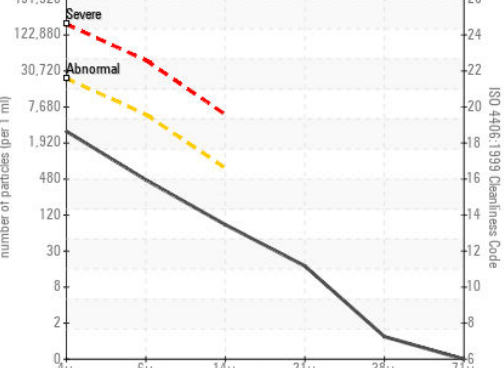

Acid Number

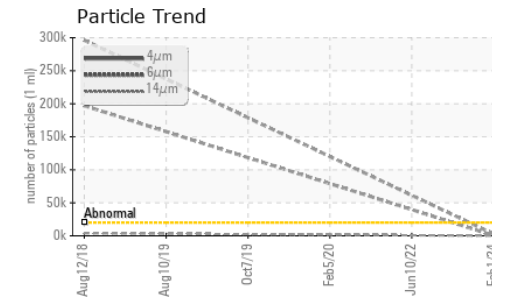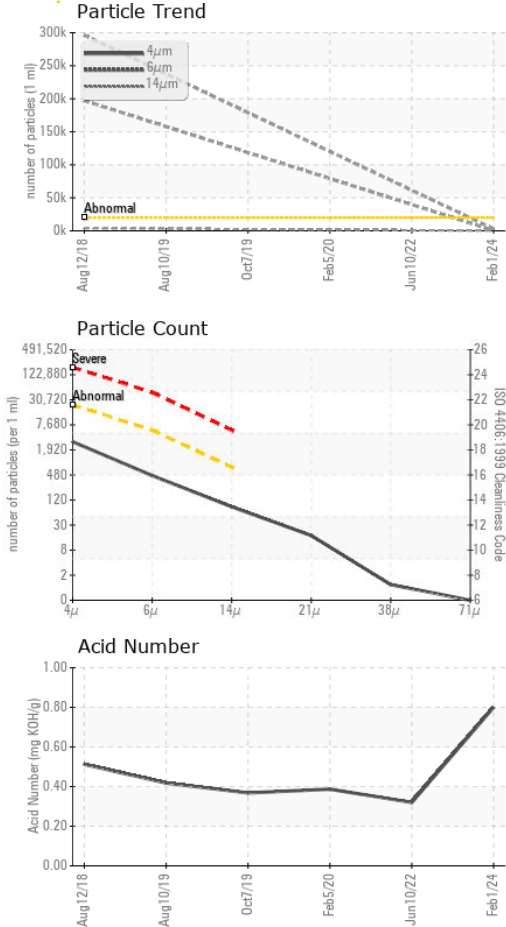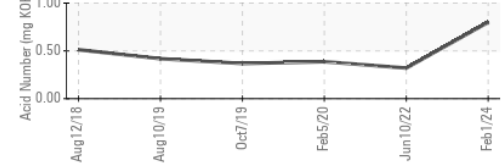

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0903062 **Received** : 23 Feb 2024
Lab Number : 06098385 **Tested** : 26 Feb 2024
Unique Number : 10896615 **Diagnosed** : 26 Feb 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

BRAUM'S ICE CREAM PLANT
 PO BOX 725
 TUTTLE, OK
 US 73089
 Contact: SCOTTY SCOTT
 sscott@braums.com; maintenanceoffice@braums.com
 T: (405)381-4427
 F: (405)381-2051

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)