




# OIL ANALYSIS REPORT

Sample Rating Trend

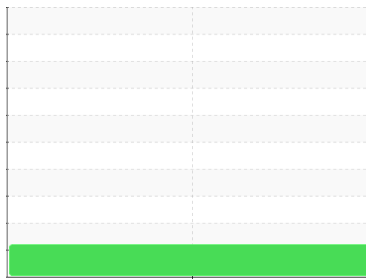

Machine Id  
**KAESER 7854297**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCP50386</b>	---	---
Sample Date	Client Info		<b>07 Feb 2024</b>	---	---
Machine Age	hrs	Client Info	<b>18831</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>Changed</b>	---	---
Sample Status			<b>ATTENTION</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m >2	<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>4</b>	---	---
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 90	<b>10</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m 90	<b>59</b>	---	---
Calcium	ppm	ASTM D5185m 2	<b>1</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>0</b>	---	---
Zinc	ppm	ASTM D5185m	<b>4</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>18419</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>19</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>4</b>	---	---
Water	%	ASTM D6304 >0.05	<b>0.021</b>	---	---
ppm Water	ppm	ASTM D6304 >500	<b>214</b>	---	---

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>5147</b>	---	---
Particles >6µm	ASTM D7647	>1300	<b>▲ 1534</b>	---	---
Particles >14µm	ASTM D7647	>80	<b>▲ 93</b>	---	---
Particles >21µm	ASTM D7647	>20	<b>19</b>	---	---
Particles >38µm	ASTM D7647	>4	<b>0</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 20/18/14</b>	---	---

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.32</b>	---	---

# OIL ANALYSIS REPORT


## ▲ Particle Trend

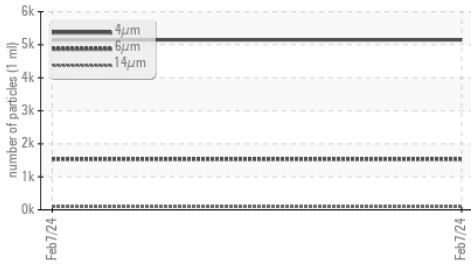


## Water (KF)

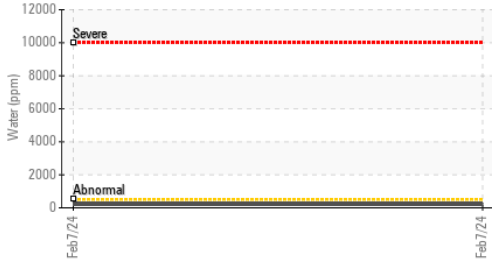


## Acid Number

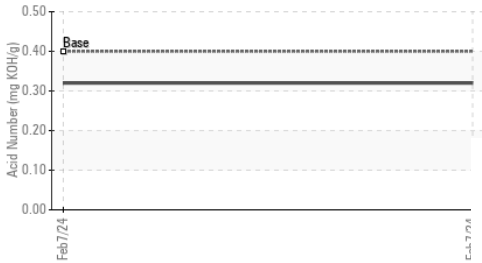

## Water (KF)

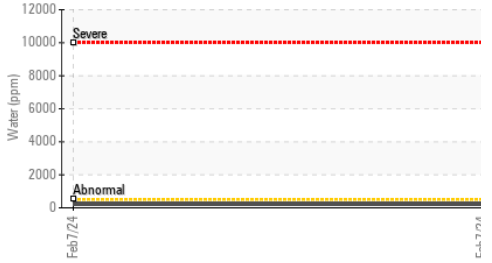

## Viscosity @ 40°C

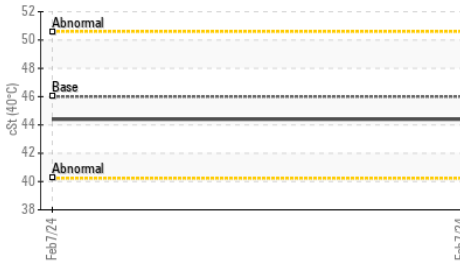

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.4	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

### Ferrous Alloys

### Non-ferrous Metals

### Viscosity @ 40°C

### ▲ Particle Count

### Acid Number



Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCP50386 **Received** : 23 Feb 2024  
**Lab Number** : 06098401 **Tested** : 26 Feb 2024  
**Unique Number** : 10896631 **Diagnosed** : 26 Feb 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON.COM SERVICES LLC**  
 3200 SAWYER RD  
 REPUBLIC, MO  
 US 65738  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: