


# **OIL ANALYSIS REPORT**

# Machine Id KAESER 2625383 (S/N 1105)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)





## **DIAGNOSIS**

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Sep2023	Feb 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCP47435D	KCPA003664	
Sample Date		Client Info		05 Feb 2024	08 Sep 2023	
Machine Age	hrs	Client Info		97393	73797	
Oil Age	hrs	Client Info		3000	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	<1	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	12	27	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	7	0	
Molybdenum	ppm	ASTM D5185m	0	<1	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	3	13	
Calcium	ppm	ASTM D5185m	0	0	<1	
Phosphorus	ppm	ASTM D5185m	0	0	4	
Zinc	ppm	ASTM D5185m	0	27	17	
Sulfur	ppm	ASTM D5185m	23500	21353	19591	
CONTAMINANTS	)	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		0	6	
Potassium	ppm	ASTM D5185m	>20	<1	2	
Water	%	ASTM D6304	>0.05	0.012	0.010	
ppm Water	ppm	ASTM D6304	>500	130	108.8	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		44091		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14μm		ASTM D7647	>80	<u>^</u> 649		
Particles >21μm		ASTM D7647	>20	<u> </u>		
Particles >38μm		ASTM D7647	>4	<u>^</u> 7		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 23/21/17		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.42	0.641	



# **OIL ANALYSIS REPORT**

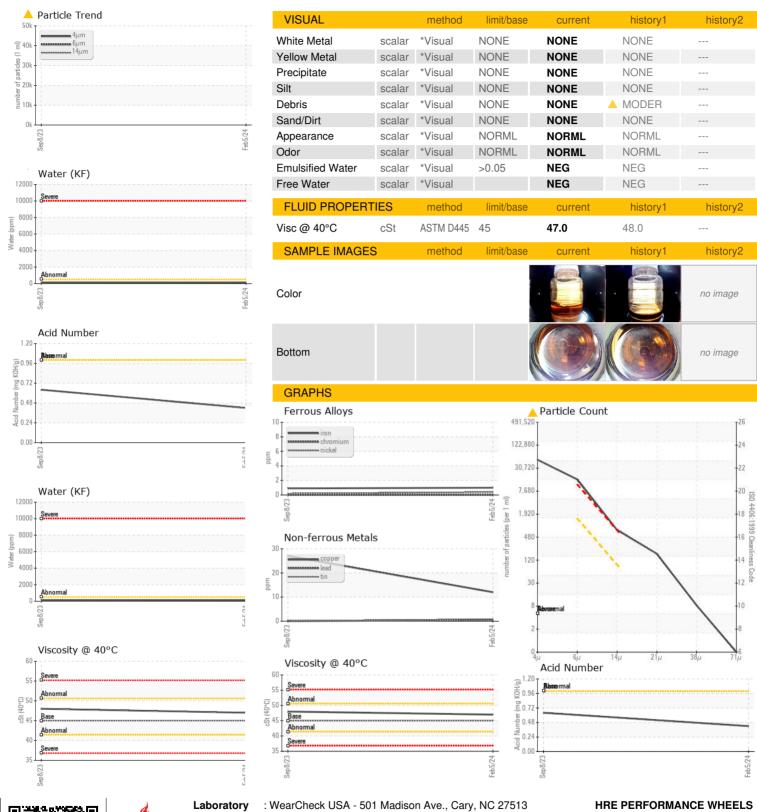





Certificate L2367

Sample No. Lab Number

: KCP47435D : 06098414

Received **Tested Unique Number** : 10896644 Diagnosed : 23 Feb 2024

: 26 Feb 2024

: 26 Feb 2024 - Don Baldridge

Test Package: IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

2611 COMMERCE WAY VISTA, CA

US 92081

Contact: Service Manager

F:

T: