




# OIL ANALYSIS REPORT

Sample Rating Trend

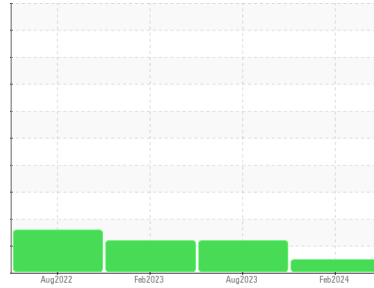

**NORMAL**



Machine Id  
**KAESER 7808797 (S/N 1054)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC111544</b>	KC105971	KC96826
Sample Date	Client Info			<b>06 Feb 2024</b>	04 Aug 2023	21 Feb 2023
Machine Age	hrs	Client Info		<b>3905</b>	3375	2956
Oil Age	hrs	Client Info		<b>949</b>	0	782
Oil Changed	Client Info			<b>Changed</b>	N/A	Changed
Sample Status				<b>NORMAL</b>	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	1	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	<b>1</b>	<1	1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>8</b>	9	<1
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	<b>59</b>	70	56
Calcium	ppm	ASTM D5185m	2	<1	2	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	12	2
Zinc	ppm	ASTM D5185m		<b>10</b>	0	10

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		<b>13</b>	15	12
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	2
Water	%	ASTM D6304	>0.05	<b>0.014</b>	0.012	0.008
ppm Water	ppm	ASTM D6304	>500	<b>144</b>	130	89.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>2231</b>	4279	4825
Particles >6µm		ASTM D7647	>1300	<b>914</b>	▲ 2372	▲ 2566
Particles >14µm		ASTM D7647	>80	<b>32</b>	▲ 131	▲ 128
Particles >21µm		ASTM D7647	>20	<b>4</b>	10	11
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>18/17/12</b>	▲ 19/18/14	▲ 19/19/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.31</b>	0.350	0.33


# OIL ANALYSIS REPORT

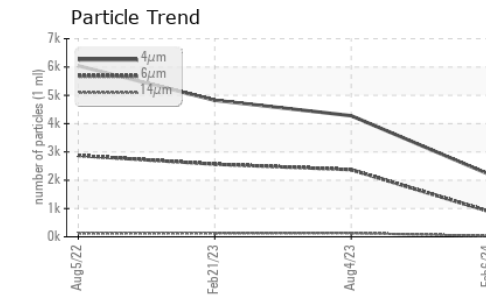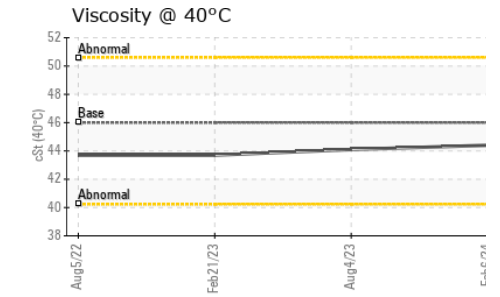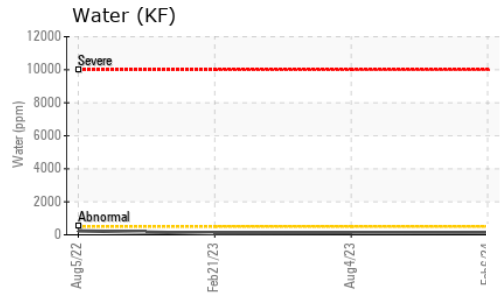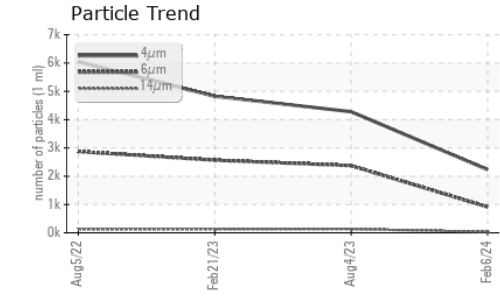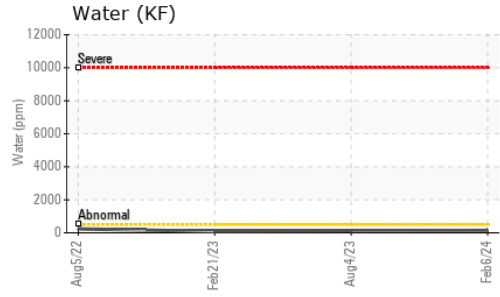






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.4	44.1	43.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

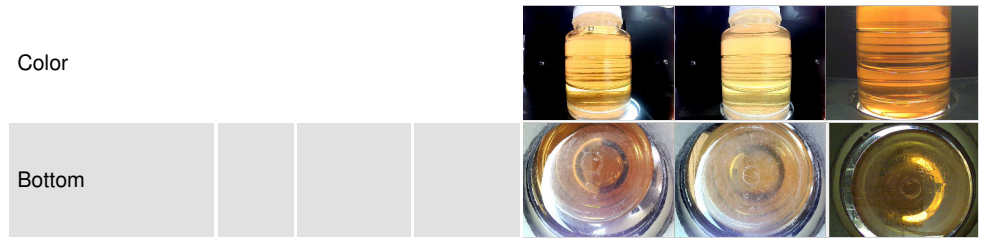

## GRAPHS

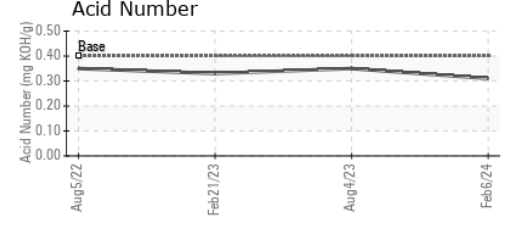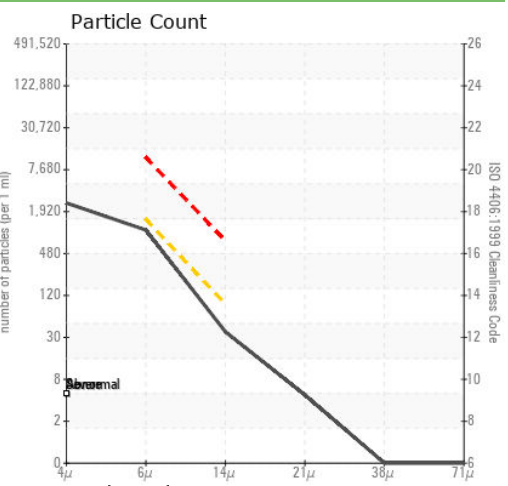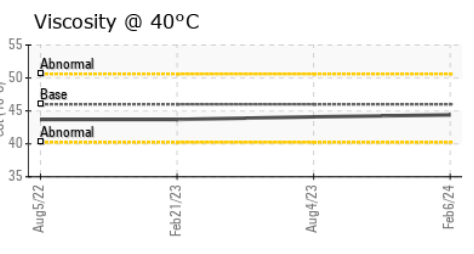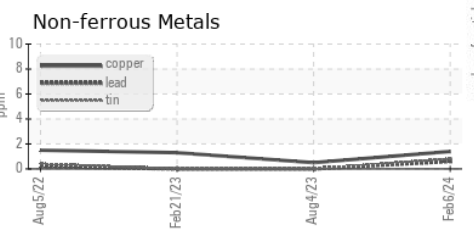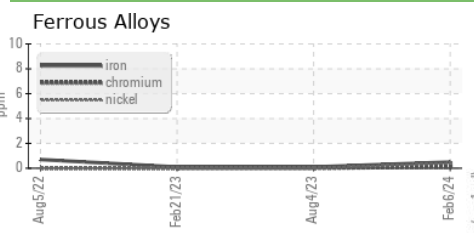

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC111544  
**Lab Number** : 06098420  
**Unique Number** : 10896650  
**Test Package** : IND 2  
**Received** : 23 Feb 2024  
**Tested** : 26 Feb 2024  
**Diagnosed** : 26 Feb 2024 - Don Baldrige

**ADESA INDIANAPOLIS**  
 2950 E MAIN ST  
 PLAINFIELD, IN  
 US 46168  
 Contact: HECTOR BONET  
 hector.bonet@adesa.com  
 T:  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)