




OIL ANALYSIS REPORT

Sample Rating Trend

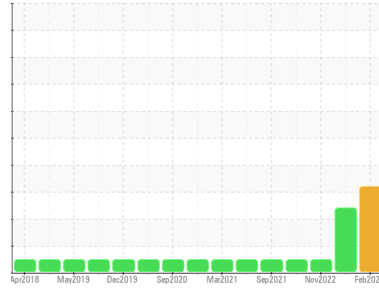

Machine Id
AERZEN BLOWER 1 (S/N 15729)

Component
Blower
Fluid
USPI AIR 46 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a moderate amount of particulates present in the oil. Elemental level of silicon (Si) above normal.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USPM30104	USPM27226	USPM25704
Sample Date	Client Info		22 Feb 2024	27 Jul 2023	10 Nov 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	9	▲ 112	1
Chromium	ppm	ASTM D5185m >20	<1	3	0
Nickel	ppm	ASTM D5185m >20	<1	0	0
Titanium	ppm	ASTM D5185m	<1	<1	0
Silver	ppm	ASTM D5185m	<1	0	0
Aluminum	ppm	ASTM D5185m >20	<1	2	<1
Lead	ppm	ASTM D5185m >20	<1	0	0
Copper	ppm	ASTM D5185m >20	2	2	0
Tin	ppm	ASTM D5185m >20	1	<1	<1
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	<1	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m 0	0	<1	0
Calcium	ppm	ASTM D5185m 0	1	1	0
Phosphorus	ppm	ASTM D5185m 1	0	6	0
Zinc	ppm	ASTM D5185m 0	3	0	0
Sulfur	ppm	ASTM D5185m 0	0	0	0

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	▲ 29	7	4
Sodium	ppm	ASTM D5185m	0	<1	0
Potassium	ppm	ASTM D5185m >20	2	1	0
Water	%	ASTM D6304 >0.2	0.014	0.152	0.025
ppm Water	ppm	ASTM D6304 >2000	146	1520	259.6

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		11655	134789	50174
Particles >6µm	ASTM D7647	>2500	▲ 3983	▲ 49449	2026
Particles >14µm	ASTM D7647	>320	▲ 554	▲ 739	34
Particles >21µm	ASTM D7647	>80	▲ 122	▲ 93	7
Particles >38µm	ASTM D7647	>20	2	1	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/18/15	▲ 21/19/16	▲ 24/23/17	23/18/12


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	0.19	0.176	0.09




OIL ANALYSIS REPORT


▲ Silicon (ppm)

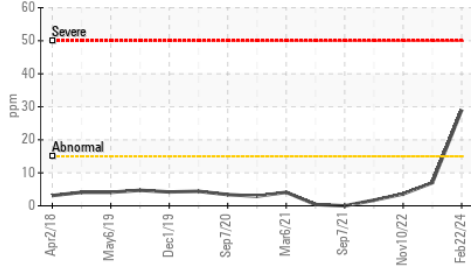


▲ Particle Trend

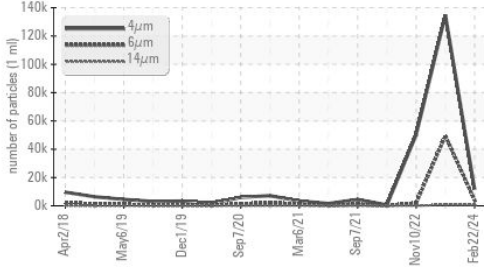


Water (KF)

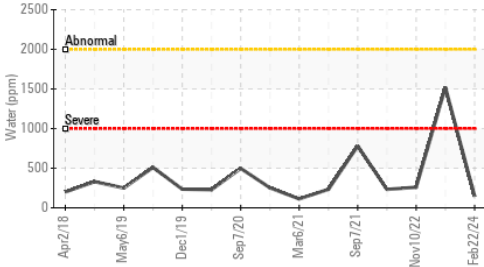

Acid Number

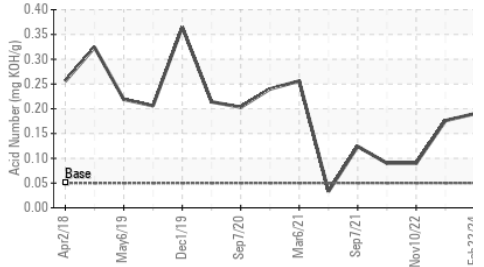


Water (KF)

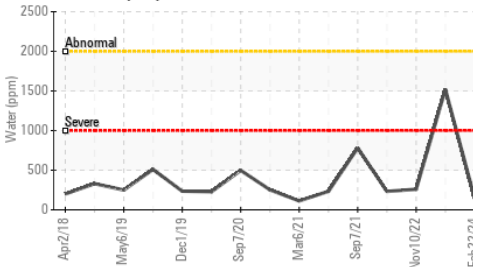

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.7	46.6	51.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

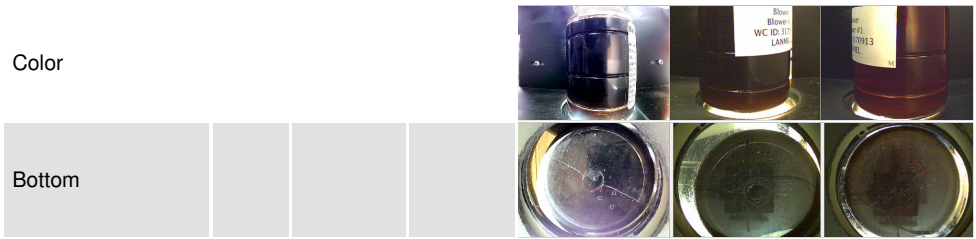


GRAPHS


Ferrous Alloys

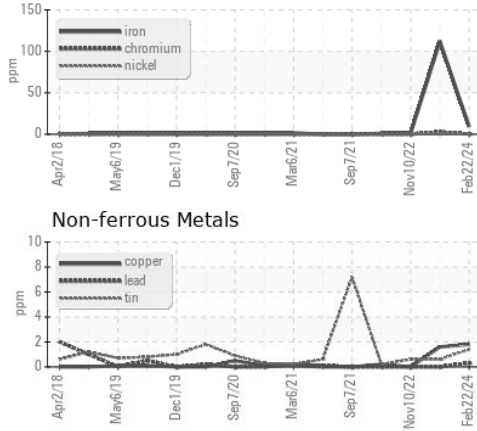


Non-ferrous Metals

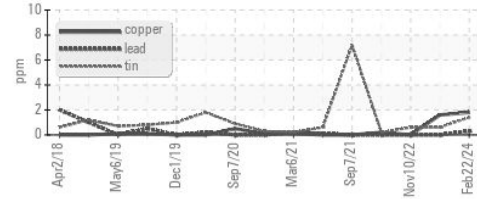


Viscosity @ 40°C

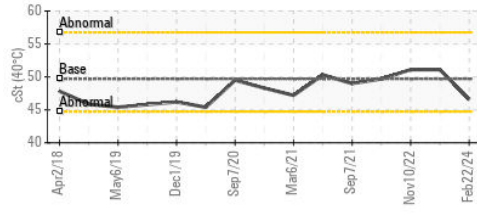

▲ Particle Count

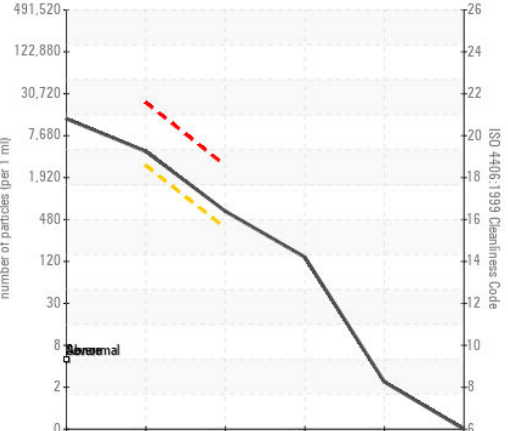

Acid Number

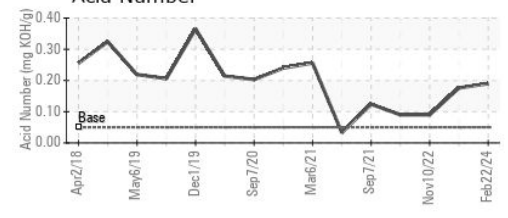

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USPM30104
 Lab Number : 06098468
 Unique Number : 10896698
 Test Package : IND 2
 Received : 23 Feb 2024
 Tested : 26 Feb 2024
 Diagnosed : 26 Feb 2024 - Doug Bogart

LAND O LAKES INC
 1000 KRAFT DRIVE SE
 MELROSE, MN
 US
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: