


Area
PALEXTRA 44
Machine Id
SULLIVAN PALATEK 23JE004514 - SILGAN CONTAINERS
Component
Compressor

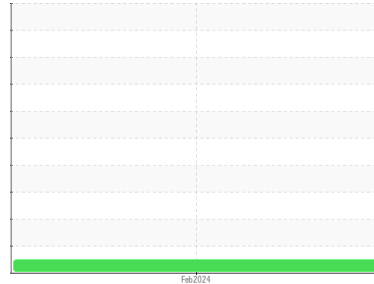

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

| | | | | | |
|---------------|-------------|-------------|--------------------|-----|-----|
| Sample Number | Client Info | | UCS06098504 | --- | --- |
| Sample Date | Client Info | | 19 Feb 2024 | --- | --- |
| Machine Age | hrs | Client Info | 2766 | --- | --- |
| Oil Age | hrs | Client Info | 2766 | --- | --- |
| Oil Changed | | Client Info | Not Changed | --- | --- |
| Sample Status | | | NORMAL | --- | --- |

CONTAMINATION method limit/base current history1 history2

| | | | | | |
|-------|-----------|------|------------|-----|-----|
| Water | WC Method | >0.1 | NEG | --- | --- |
|-------|-----------|------|------------|-----|-----|

WEAR METALS method limit/base current history1 history2

| | | | | | | |
|----------|-----|-------------|-----|--------------|-----|-----|
| Iron | ppm | ASTM D5185m | >50 | 0 | --- | --- |
| Chromium | ppm | ASTM D5185m | >10 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m | | <1 | --- | --- |
| Titanium | ppm | ASTM D5185m | | 0 | --- | --- |
| Silver | ppm | ASTM D5185m | | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185m | >25 | <1 | --- | --- |
| Lead | ppm | ASTM D5185m | >25 | 0 | --- | --- |
| Copper | ppm | ASTM D5185m | >50 | <1 | --- | --- |
| Tin | ppm | ASTM D5185m | >15 | <1 | --- | --- |
| Vanadium | ppm | ASTM D5185m | | 0 | --- | --- |
| Cadmium | ppm | ASTM D5185m | | 0 | --- | --- |

ADDITIVES method limit/base current history1 history2

| | | | | | | |
|------------|-----|-------------|------|--------------|-----|-----|
| Boron | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Barium | ppm | ASTM D5185m | 0.3 | 0 | --- | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Manganese | ppm | ASTM D5185m | 0.3 | <1 | --- | --- |
| Magnesium | ppm | ASTM D5185m | 0.4 | 2 | --- | --- |
| Calcium | ppm | ASTM D5185m | 0 | 1 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | 689 | 445 | --- | --- |
| Zinc | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Sulfur | ppm | ASTM D5185m | 1237 | 567 | --- | --- |


CONTAMINANTS method limit/base current history1 history2

| | | | | | | |
|-----------|-----|-------------|-----|--------------|-----|-----|
| Silicon | ppm | ASTM D5185m | >25 | 2 | --- | --- |
| Sodium | ppm | ASTM D5185m | | <1 | --- | --- |
| Potassium | ppm | ASTM D5185m | >20 | <1 | --- | --- |

FLUID DEGRADATION method limit/base current history1 history2

| | | | | | | |
|------------------|----------|------------|-------|-------------|-----|-----|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.135 | 0.52 | --- | --- |
|------------------|----------|------------|-------|-------------|-----|-----|

OIL ANALYSIS REPORT

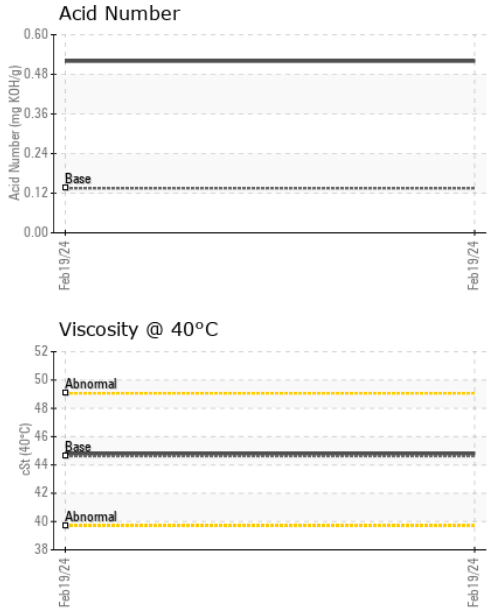





| VISUAL | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|--------------|----------|-----|
| White Metal | scalar | *Visual | NONE | NONE | --- | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- | --- |
| Silt | scalar | *Visual | NONE | NONE | --- | --- |
| Debris | scalar | *Visual | NONE | NONE | --- | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- | --- |
| Odor | scalar | *Visual | NORML | NORML | --- | --- |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | --- | --- |
| Free Water | scalar | *Visual | | NEG | --- | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|-------------|----------|-----|
| Visc @ 40°C | cSt | ASTM D445 | 44.62 | 44.8 | --- | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | | | |
|--------|--|--|--|----------|----------|
| Color | | | | no image | no image |
| Bottom | | | | no image | no image |

GRAPHS

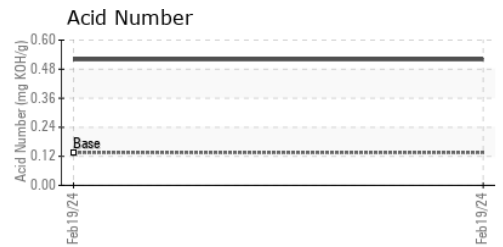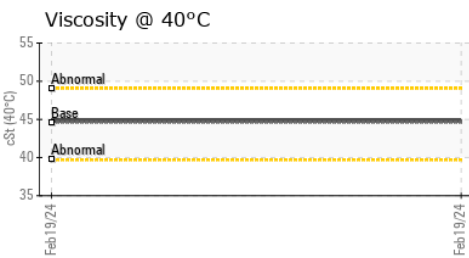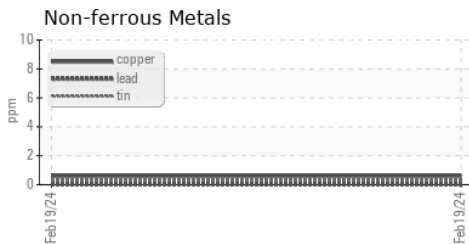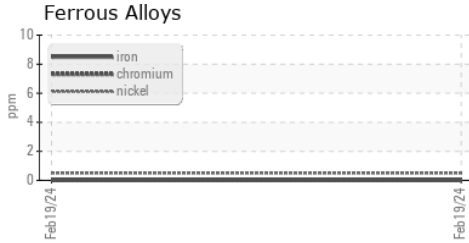

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCS06098504
Lab Number : 06098504
Unique Number : 10896734
Test Package : IND 2

Received : 23 Feb 2024
Tested : 26 Feb 2024
Diagnosed : 26 Feb 2024 - Don Baldrige

ADVANCED COMPRESSOR TECHNOLOGIES
 2315 B GLENVIEW DR
 EVANSVILLE, IN
 US 47720
 Contact: TODD RILEY
 triley@advancedcompressortechnologies.com
 T: (812)401-1420
 F: (812)401-1451

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)