


# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**AIRLUBE 228 [1405433]**  
Machine Id  
**ATLAS COPCO AII260758 - FERCO TECH**  
Component  
**Compressor**

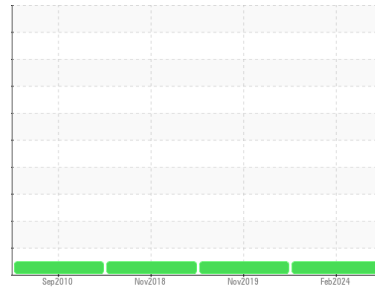

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>UCH06098528</b> | UCH04849265 | UCH04619575 |
| Sample Date   | Client Info |             | <b>20 Feb 2024</b> | 07 Nov 2019 | 28 Nov 2018 |
| Machine Age   | hrs         | Client Info | <b>0</b>           | 0           | 56479       |
| Oil Age       | hrs         | Client Info | <b>0</b>           | 0           | 4500        |
| Oil Changed   | Client Info |             | <b>N/A</b>         | Not Changd  | Not Changd  |
| Sample Status |             |             | <b>NORMAL</b>      | NORMAL      | NORMAL      |

## CONTAMINATION

|       | method    | limit/base | current    | history1 | history2 |
|-------|-----------|------------|------------|----------|----------|
| Water | WC Method | >0.1       | <b>NEG</b> | NEG      | NEG      |

## WEAR METALS

|          | method | limit/base      | current      | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron     | ppm    | ASTM D5185m >50 | <b>0</b>     | <1       | <1       |
| Chromium | ppm    | ASTM D5185m >10 | <b>0</b>     | 0        | <1       |
| Nickel   | ppm    | ASTM D5185m     | <b>&lt;1</b> | <1       | 0        |
| Titanium | ppm    | ASTM D5185m     | <b>0</b>     | 0        | 0        |
| Silver   | ppm    | ASTM D5185m     | <b>0</b>     | 0        | 0        |
| Aluminum | ppm    | ASTM D5185m >25 | <b>&lt;1</b> | <1       | <1       |
| Lead     | ppm    | ASTM D5185m >25 | <b>0</b>     | <1       | 0        |
| Copper   | ppm    | ASTM D5185m >50 | <b>&lt;1</b> | <1       | <1       |
| Tin      | ppm    | ASTM D5185m >15 | <b>&lt;1</b> | 0        | 0        |
| Antimony | ppm    | ASTM D5185m     | <b>---</b>   | 0        | 0        |
| Vanadium | ppm    | ASTM D5185m     | <b>&lt;1</b> | 0        | 0        |
| Cadmium  | ppm    | ASTM D5185m     | <b>0</b>     | 0        | 0        |

## ADDITIVES

|            | method | limit/base       | current      | history1 | history2 |
|------------|--------|------------------|--------------|----------|----------|
| Boron      | ppm    | ASTM D5185m 1.5  | <b>0</b>     | 0        | 0        |
| Barium     | ppm    | ASTM D5185m 0    | <b>2</b>     | 0        | 0        |
| Molybdenum | ppm    | ASTM D5185m 0    | <b>0</b>     | 1        | 3        |
| Manganese  | ppm    | ASTM D5185m 0.3  | <b>&lt;1</b> | <1       | 0        |
| Magnesium  | ppm    | ASTM D5185m 0    | <b>&lt;1</b> | 1        | 0        |
| Calcium    | ppm    | ASTM D5185m 0    | <b>&lt;1</b> | 0        | 0        |
| Phosphorus | ppm    | ASTM D5185m 406  | <b>20</b>    | 179      | 151      |
| Zinc       | ppm    | ASTM D5185m 0    | <b>3</b>     | 4        | 0        |
| Sulfur     | ppm    | ASTM D5185m 1283 | <b>67</b>    | 94       | 211      |


## CONTAMINANTS

|           | method | limit/base      | current      | history1 | history2 |
|-----------|--------|-----------------|--------------|----------|----------|
| Silicon   | ppm    | ASTM D5185m >25 | <b>&lt;1</b> | 3        | <1       |
| Sodium    | ppm    | ASTM D5185m     | <b>1</b>     | <1       | 0        |
| Potassium | ppm    | ASTM D5185m >20 | <b>&lt;1</b> | <1       | 0        |

## FLUID DEGRADATION

|                  | method   | limit/base       | current     | history1 | history2 |
|------------------|----------|------------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 0.463 | <b>0.31</b> | 0.163    | 0.186    |


# OIL ANALYSIS REPORT

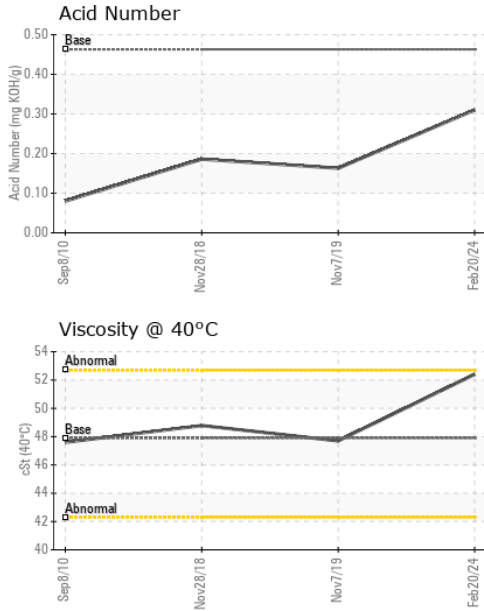



| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | LIGHT    |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.1    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1    | history2 |       |
|------------------|--------|------------|---------|-------------|----------|-------|
| Visc @ 40°C      | cSt    | ASTM D445  | 47.9    | <b>52.4</b> | 47.7     | 48.78 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

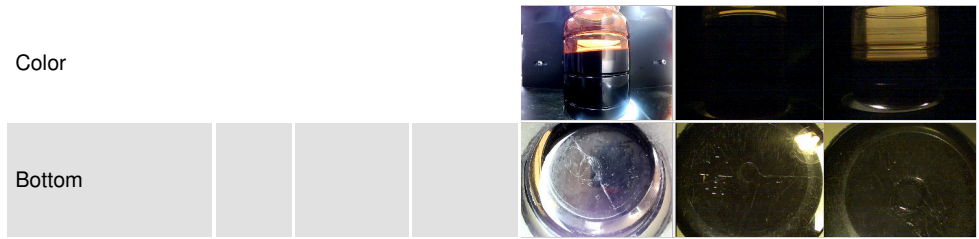

## GRAPHS

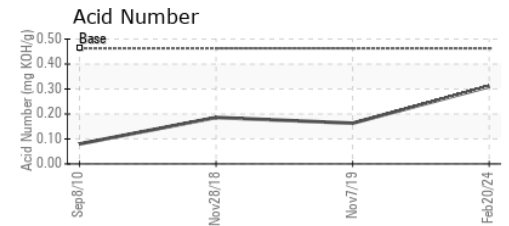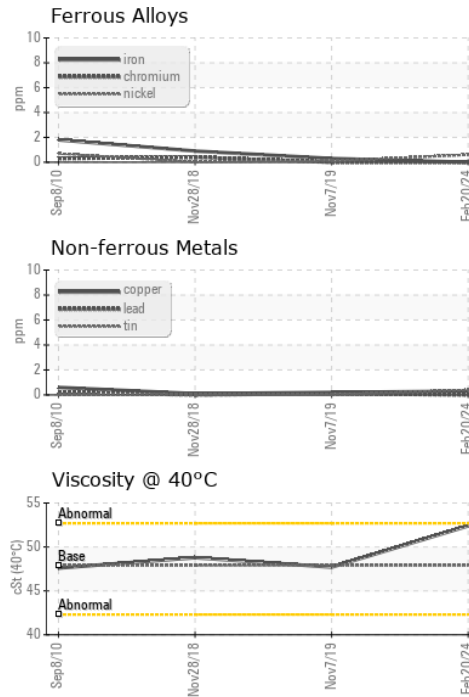

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06098528  
**Lab Number** : 06098528  
**Unique Number** : 10896758  
**Test Package** : IND 2

**Received** : 23 Feb 2024  
**Tested** : 26 Feb 2024  
**Diagnosed** : 26 Feb 2024 - Don Baldrige

**AIR TECHNOLOGIES INC (MID)**  
 400 WRIGHT AVE  
 MIDDLETOWN, OH  
 US 45044  
 Contact: KEITH HAYES  
 Keith.Hayes@aircompressors.com  
 T: (513)615-6378  
 F: (513)539-6040

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)