




# OIL ANALYSIS REPORT

Sample Rating Trend

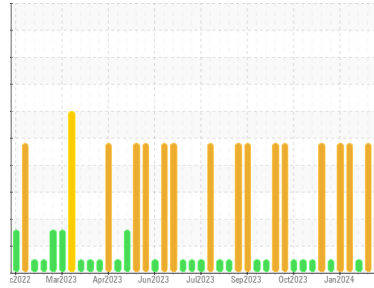

**DIRT**



Machine Id  
**Brent Run CAT 3 BRRM03BE**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend that you drain the oil and perform a filter service on this component if not already done. We recommend an early resample to monitor this condition. ( Customer Sample Comment: 600 hour service )

### Wear

All component wear rates are normal.

### Contamination

Elemental level of silicon (Si) above normal indicating ingress of seal material.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0776704</b>	WC0776737	WC0776732
Sample Date	Client Info		<b>20 Feb 2024</b>	09 Feb 2024	01 Feb 2024
Machine Age	hrs	Client Info	<b>49973</b>	49713	49534
Oil Age	hrs	Client Info	<b>671</b>	411	232
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>SEVERE</b>	SEVERE	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	<b>2</b>	3	2
Chromium	ppm	ASTM D5185m >4	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >6	<b>3</b>	1	3
Lead	ppm	ASTM D5185m >9	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m >6	<b>2</b>	2	2
Tin	ppm	ASTM D5185m >4	<b>4</b>	4	3
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>6</b>	4	1
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	2	2
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>21</b>	17	12
Calcium	ppm	ASTM D5185m	<b>1942</b>	1929	1791
Phosphorus	ppm	ASTM D5185m	<b>296</b>	295	274
Zinc	ppm	ASTM D5185m	<b>377</b>	365	347
Sulfur	ppm	ASTM D5185m	<b>2889</b>	2781	2495

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	<b>222</b>	203	137
Sodium	ppm	ASTM D5185m	<b>1</b>	0	1
Potassium	ppm	ASTM D5185m >20	<b>1</b>	3	3

## INFRA-RED





	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.1</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624 >20	<b>6.7</b>	6.5	6.1
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>24.5</b>	22.9	20.4

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>17.6</b>	15.5	12.8
Acid Number (AN)	mg KOH/g	ASTM D8045 1.1	<b>1.86</b>	1.47	1.307
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	<b>3.16</b>	3.27	3.52











# OIL ANALYSIS REPORT

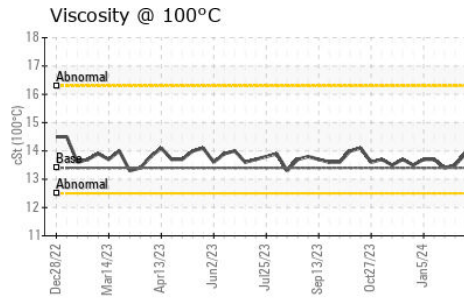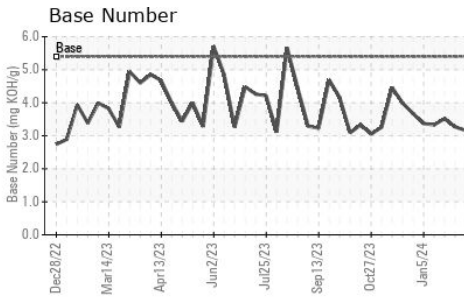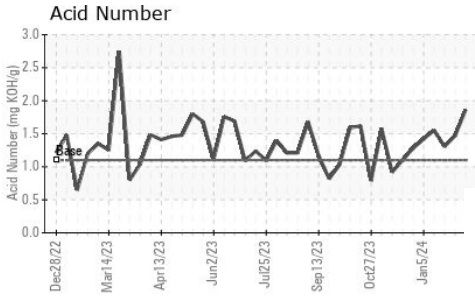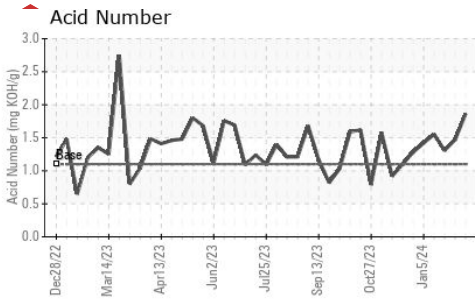

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.9	13.5

## GRAPHS

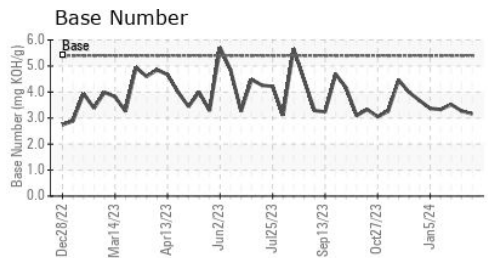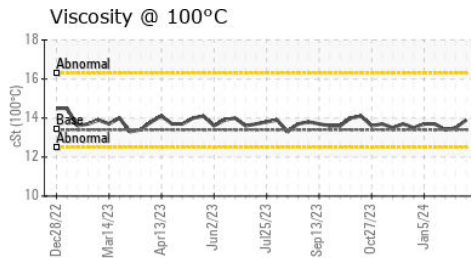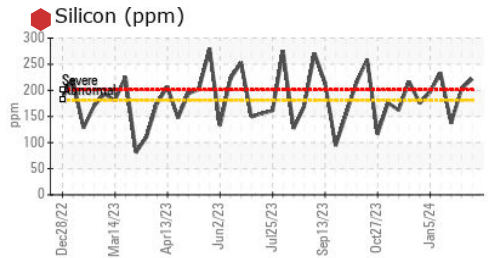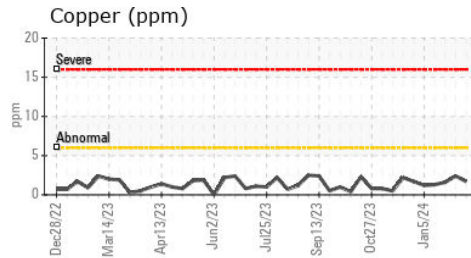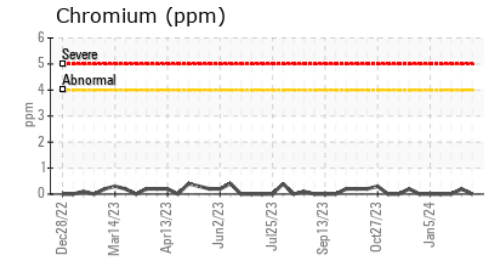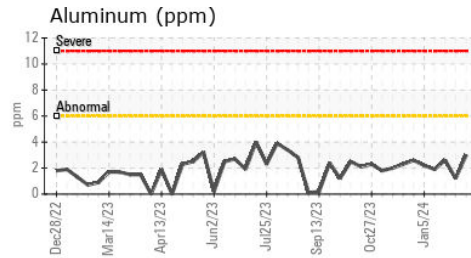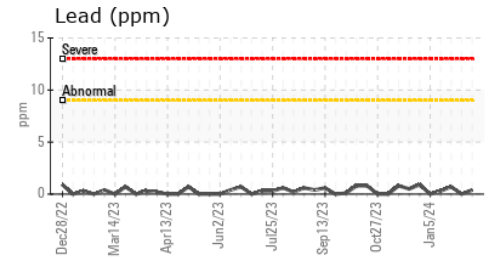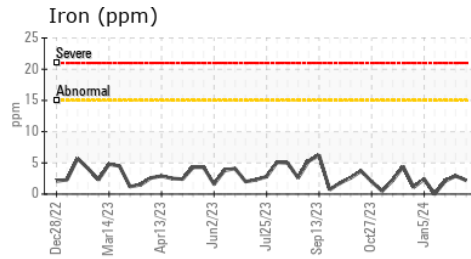

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0776704  
**Lab Number** : 06098621  
**Unique Number** : 10896851  
**Test Package** : MOB 2

**Received** : 23 Feb 2024  
**Tested** : 26 Feb 2024  
**Diagnosed** : 26 Feb 2024 - Sean Felton

**EDL NA Recips-Brent Run**  
 Brent Run Power Station, 8383 Vienna Road  
 Montrose, MI  
 US 48457-9141  
 Contact: Rob Stewart  
 Rob.Stewart@energydevelopments.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: