




OIL ANALYSIS REPORT

Sample Rating Trend

WEAR



Machine Id
Brent Run CAT 5 BRRM05BE
Component
Biogas Engine
Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

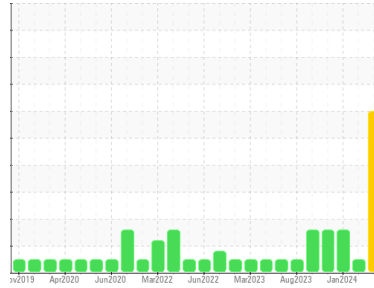

DIAGNOSIS

Recommendation

We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition. (Customer Sample Comment: 250 hour service 2 cylinder heads changed)

Wear

The lead level is severe.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0776740	WC0776734	WC0776728
Sample Date	Client Info		21 Feb 2024	01 Feb 2024	19 Jan 2024
Machine Age	hrs	Client Info	82819	82439	82135
Oil Age	hrs	Client Info	256	657	353
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			SEVERE	NORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>0.1	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>45	2	3	2
Chromium	ppm	ASTM D5185m	>2	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	<1	<1	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	4	5
Lead	ppm	ASTM D5185m	>5	10	6	3
Copper	ppm	ASTM D5185m	>14	9	2	1
Tin	ppm	ASTM D5185m	>13	3	4	5
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		9	4	4
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		4	4	4
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		23	14	8
Calcium	ppm	ASTM D5185m		1617	1760	1909
Phosphorus	ppm	ASTM D5185m		272	270	281
Zinc	ppm	ASTM D5185m		340	348	339
Sulfur	ppm	ASTM D5185m		2303	2216	2410

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>200	125	181	▲ 244
Sodium	ppm	ASTM D5185m		15	8	16
Potassium	ppm	ASTM D5185m	>20	1	2	0

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0	0	0.1
Nitration	Abs/cm	*ASTM D7624	>20	5.5	6.1	6.6
Sulfation	Abs/.1mm	*ASTM D7415	>30	17.6	18.5	20.3


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	9.7	10.9	13.9
Acid Number (AN)	mg KOH/g	ASTM D8045	1.1	1.06	1.026	1.45
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	4.64	4.22	3.47




OIL ANALYSIS REPORT


Non-ferrous Metals

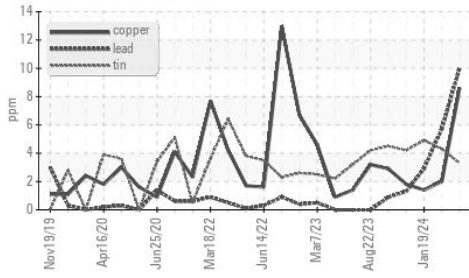


Acid Number

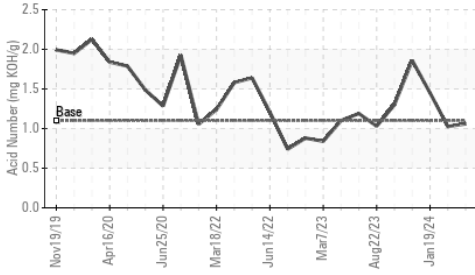

Base Number

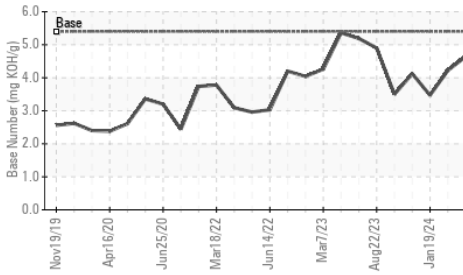

Viscosity @ 100°C

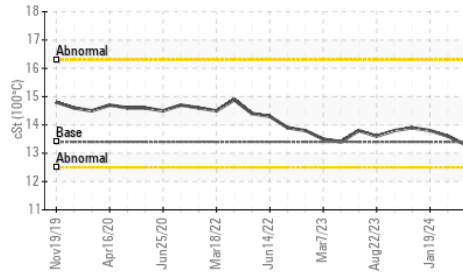


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.3	13.6

GRAPHS


Iron (ppm)

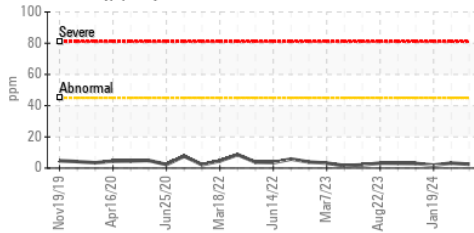


Aluminum (ppm)

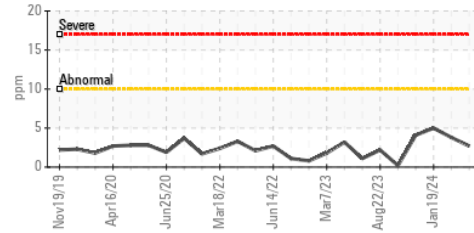


Copper (ppm)

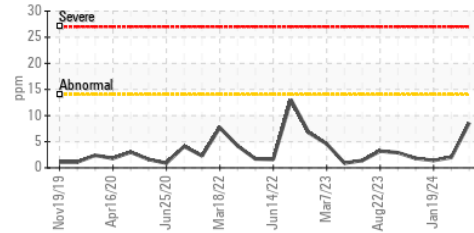


Viscosity @ 100°C

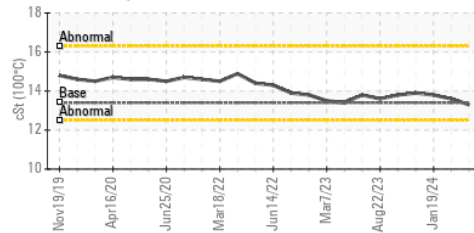


Lead (ppm)

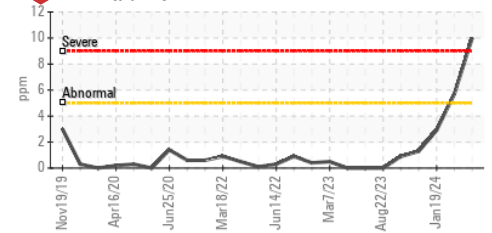


Chromium (ppm)

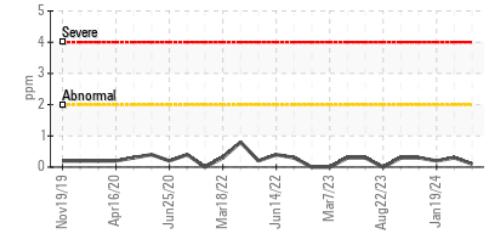

Silicon (ppm)

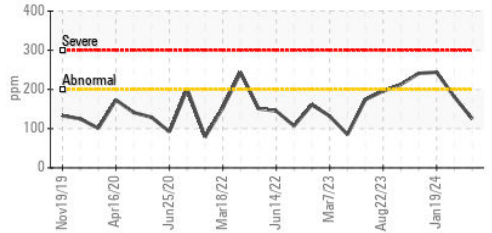

Base Number

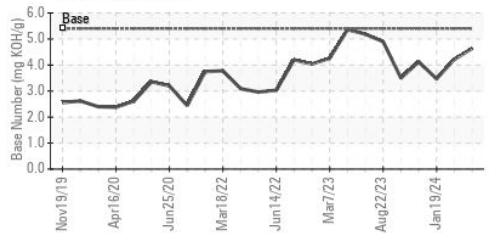

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0776740
 Lab Number : 06098622
 Unique Number : 10896852
 Test Package : MOB 2

Received : 23 Feb 2024
 Tested : 26 Feb 2024
 Diagnosed : 28 Feb 2024 - Jonathan Hester

EDL NA Recips-Brent Run
 Brent Run Power Station, 8383 Vienna Road
 Montrose, MI
 US 48457-9141
 Contact: Rob Stewart
 Rob.Stewart@energydevelopments.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: