




OIL ANALYSIS REPORT

Sample Rating Trend

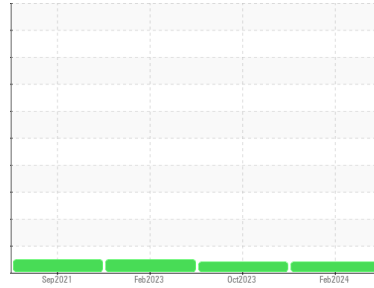

VISCOSITY



Area
INTERSTITIAL - PUMP ROOM
 Machine Id
B64247 - 5B (S/N 083012-1015943-001-24146-000)
 Component
Hydraulic Power Pack
 Fluid
AW HYDRAULIC OIL ISO 46 (--- GAL)

DIAGNOSIS

▲ Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

▲ Fluid Condition

The oil viscosity is higher than normal. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0866724	WC0850234	WC0781554
Sample Date	Client Info			22 Feb 2024	17 Oct 2023	26 Feb 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ATTENTION	ABNORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	3	0	3
Chromium	ppm	ASTM D5185m	>20	0	0	0
Nickel	ppm	ASTM D5185m	>20	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	<1	0	0
Lead	ppm	ASTM D5185m	>20	<1	<1	0
Copper	ppm	ASTM D5185m	>20	<1	0	0
Tin	ppm	ASTM D5185m	>20	0	0	0
Antimony	ppm	ASTM D5185m		---	---	---
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0	0	0
Barium	ppm	ASTM D5185m	5	0	0	0
Molybdenum	ppm	ASTM D5185m	5	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	25	<1	<1	0
Calcium	ppm	ASTM D5185m	200	39	99	54
Phosphorus	ppm	ASTM D5185m	300	492	458	411
Zinc	ppm	ASTM D5185m	370	252	511	255
Sulfur	ppm	ASTM D5185m	2500	2886	4752	2923

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2	1	2
Sodium	ppm	ASTM D5185m		3	<1	2
Potassium	ppm	ASTM D5185m	>20	2	0	0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	610	---	1715
Particles >6µm		ASTM D7647	>1300	68	---	428
Particles >14µm		ASTM D7647	>160	2	---	31
Particles >21µm		ASTM D7647	>40	0	---	5
Particles >38µm		ASTM D7647	>10	0	---	0
Particles >71µm		ASTM D7647	>3	0	---	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	16/13/9	---	18/16/12



OIL ANALYSIS REPORT

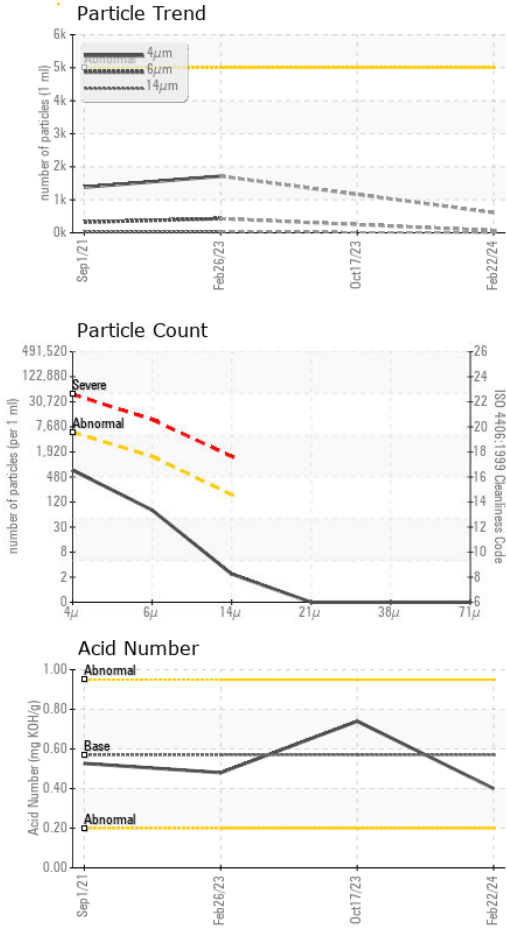


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	0.40	0.74	0.48
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	▲ 56.4	47.8	53.3

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

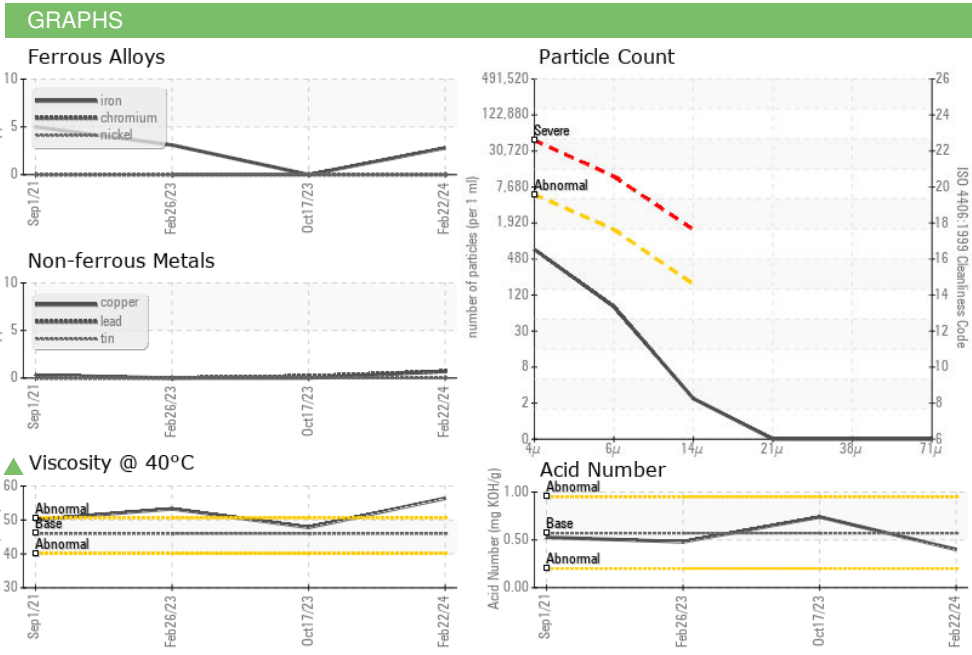

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0866724
Lab Number : 06099134
Unique Number : 10897364
Test Package : IND 2
Received : 23 Feb 2024
Tested : 26 Feb 2024
Diagnosed : 27 Feb 2024 - Don Baldrige

HORMEL - FONTANINI FOODS
 8751 W 50TH ST
 MCCOOK, IL
 US 60525
 Contact: PARTH AKOLIYA
 PBAKOLIYA@HORMEL.COM
 T: (708)485-4800
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)