




# OIL ANALYSIS REPORT

Sample Rating Trend

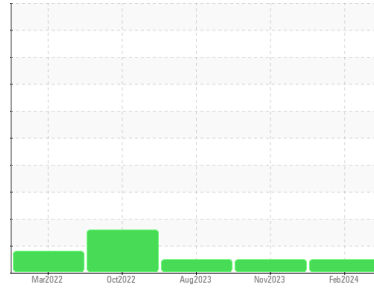

**NORMAL**



Machine Id  
**KAESER 7836196**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. We were unable to perform a particle count due to insufficient sample.

### Wear

All component wear rates are normal.

### Contamination

Insufficient sample was received to conduct all the routine laboratory tests. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA013119</b>	KCPA009981	KCPA002855
Sample Date	Client Info			<b>22 Feb 2024</b>	08 Nov 2023	14 Aug 2023
Machine Age	hrs	Client Info		<b>15316</b>	14810	13253
Oil Age	hrs	Client Info		<b>506</b>	0	0
Oil Changed	Client Info			<b>Not Changed</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	1	<1
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>78</b>	44	66
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	90	<b>89</b>	85	93
Calcium	ppm	ASTM D5185m	2	<b>3</b>	4	2
Phosphorus	ppm	ASTM D5185m		<b>1</b>	<1	3
Zinc	ppm	ASTM D5185m		<b>0</b>	0	<1
Sulfur	ppm	ASTM D5185m		<b>19219</b>	18526	23153

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	1
Sodium	ppm	ASTM D5185m		<b>6</b>	20	13
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	3	3
Water	%	ASTM D6304	>0.05	<b>0.016</b>	0.021	0.029
ppm Water	ppm	ASTM D6304	>500	<b>162</b>	216	297.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>---</b>	725	2970
Particles >6µm		ASTM D7647	>1300	<b>---</b>	236	761
Particles >14µm		ASTM D7647	>80	<b>---</b>	22	62
Particles >21µm		ASTM D7647	>20	<b>---</b>	6	18
Particles >38µm		ASTM D7647	>4	<b>---</b>	1	1
Particles >71µm		ASTM D7647	>3	<b>---</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>---</b>	17/15/12	19/17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.38</b>	0.34	0.35


# OIL ANALYSIS REPORT

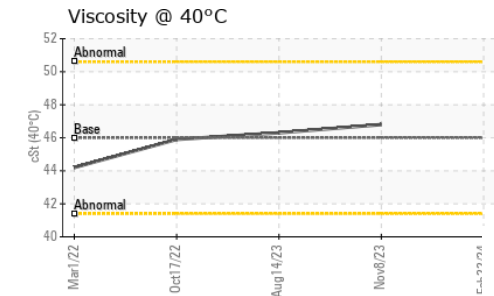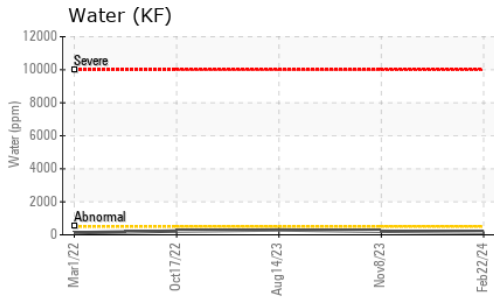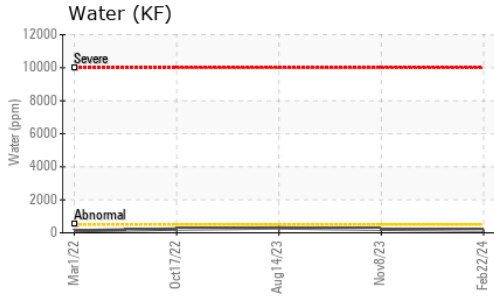





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	---	46.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

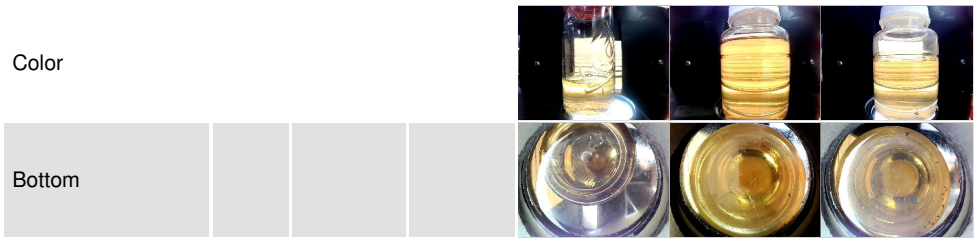

## GRAPHS

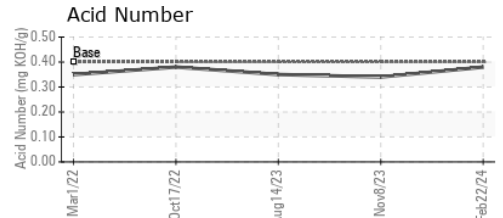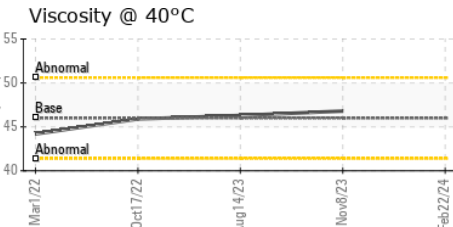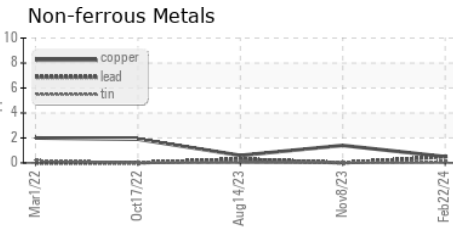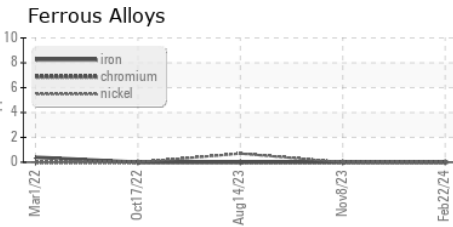

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA013119  
**Lab Number** : 06099151  
**Unique Number** : 10897381  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON.COM SERVICES LLC FOE 1**  
 9400 LEAVENWORTH RD  
 KANSAS CITY, KS  
 US 66102  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: