


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

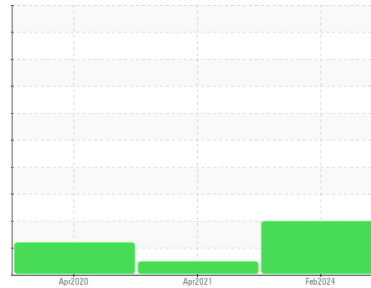

Machine Id  
**KAESER ASD 40ST 4937528 (S/N 1001)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is a high amount of particulates present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCPA014722</b>	KCP28245	KCP26024
Sample Date	Client Info	<b>06 Feb 2024</b>	16 Apr 2021	16 Apr 2020
Machine Age	hrs	<b>16364</b>	11546	10604
Oil Age	hrs	<b>4818</b>	950	0
Oil Changed	Client Info	<b>Changed</b>	Changed	Changed
Sample Status		<b>ABNORMAL</b>	NORMAL	ABNORMAL

**WEAR METALS**

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>3</b>	<1	1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	1	1
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>18</b>	4	9
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

**ADDITIVES**

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<b>0</b>	9	<1
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 100	<b>16</b>	32	<1
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m 0	<b>25</b>	87	311
Zinc	ppm	ASTM D5185m 0	<b>102</b>	116	96
Sulfur	ppm	ASTM D5185m 23500	<b>18192</b>	14377	1248

**CONTAMINANTS**

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>1</b>	1	<1
Sodium	ppm	ASTM D5185m	<b>10</b>	24	6
Potassium	ppm	ASTM D5185m >20	<b>4</b>	5	2
Water	%	ASTM D6304 >0.05	<b>0.005</b>	0.011	0.009
ppm Water	ppm	ASTM D6304 >500	<b>56</b>	114.5	93.6






**FLUID CLEANLINESS**

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>9397</b>	6584	40512
Particles >6µm	ASTM D7647 >1300	<b>▲ 3763</b>	1027	▲ 5509
Particles >14µm	ASTM D7647 >80	<b>▲ 360</b>	49	▲ 239
Particles >21µm	ASTM D7647 >20	<b>▲ 89</b>	11	▲ 43
Particles >38µm	ASTM D7647 >4	<b>▲ 6</b>	1	2
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>▲ 20/19/16</b>	17/13	▲ 20/15

**FLUID DEGRADATION**

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.35</b>	0.287	0.135


# OIL ANALYSIS REPORT

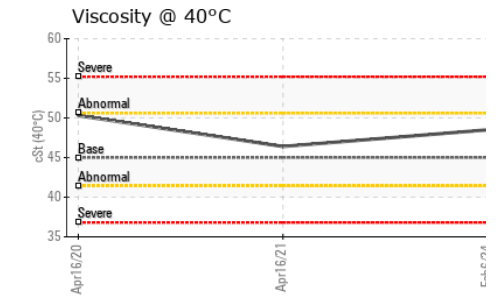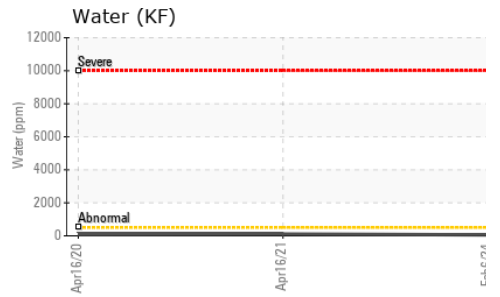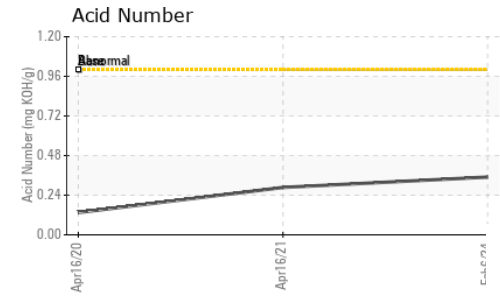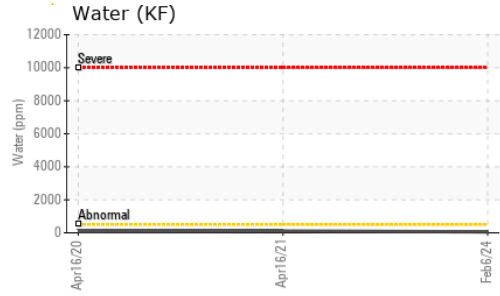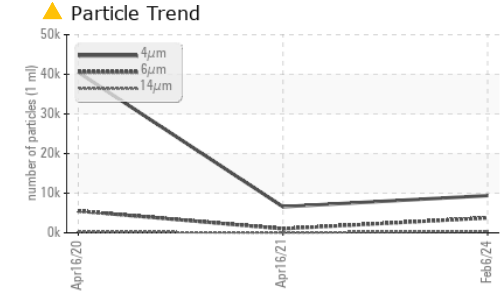



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	48.5	46.4	50.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

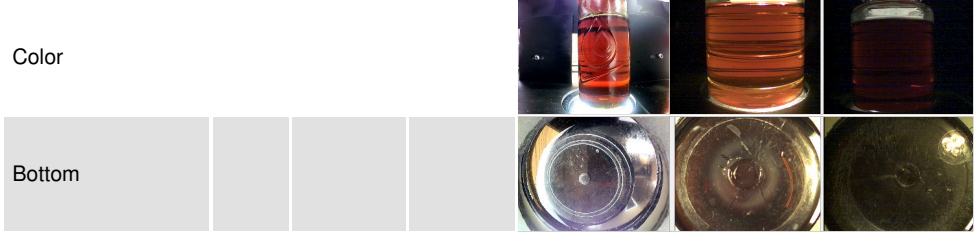

## GRAPHS

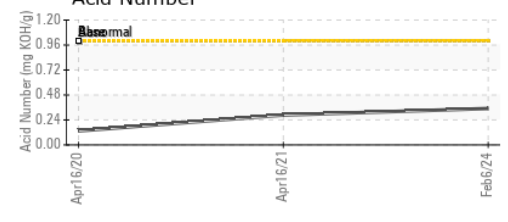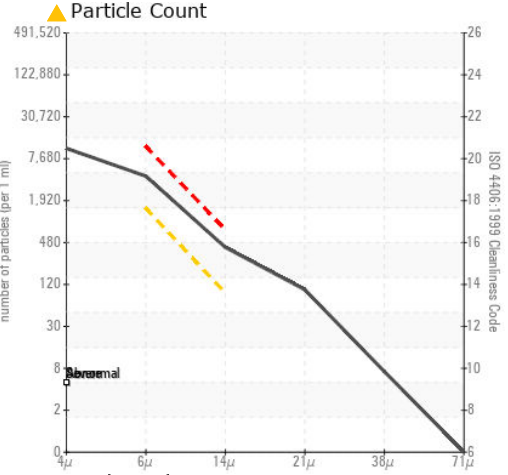

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA014722 **Received** : 23 Feb 2024  
**Lab Number** : 06099159 **Tested** : 27 Feb 2024  
**Unique Number** : 10897389 **Diagnosed** : 27 Feb 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**BG FARMS LLC**  
 4253 CEDAR CROSSING RD  
 UVALDA, GA  
 US 30473  
 Contact: CINDY  
 cindy@williamsfarms.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)