




# OIL ANALYSIS REPORT

Sample Rating Trend

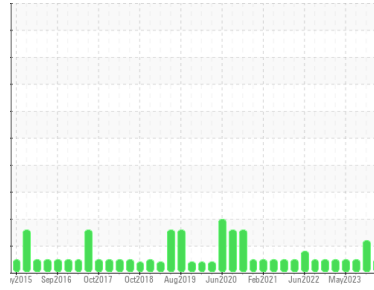

**NORMAL**



Machine Id  
**TYSVIC 06B (S/N 00487-008-1-01-02)**

Component  
**Refrigeration Compressor**  
Fluid  
**USPI ALT-68 SC (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

| method        | limit/base  | current            | history1    | history2    |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | <b>USP0007646</b>  | USP0003475  | USP0000341  |
| Sample Date   | Client Info | <b>22 Feb 2024</b> | 13 Nov 2023 | 31 Aug 2023 |
| Machine Age   | hrs         | Client Info        | <b>0</b>    | 0           |
| Oil Age       | hrs         | Client Info        | <b>0</b>    | 0           |
| Oil Changed   | Client Info | <b>N/A</b>         | N/A         | N/A         |
| Sample Status |             | <b>NORMAL</b>      | ABNORMAL    | NORMAL      |

## WEAR METALS

| method   | limit/base | current        | history1     | history2 |   |
|----------|------------|----------------|--------------|----------|---|
| Iron     | ppm        | ASTM D5185m >8 | <b>0</b>     | <1       | 0 |
| Chromium | ppm        | ASTM D5185m >2 | <b>0</b>     | <1       | 0 |
| Nickel   | ppm        | ASTM D5185m    | <b>0</b>     | 0        | 0 |
| Titanium | ppm        | ASTM D5185m    | <b>0</b>     | <1       | 0 |
| Silver   | ppm        | ASTM D5185m >2 | <b>0</b>     | 0        | 0 |
| Aluminum | ppm        | ASTM D5185m >3 | <b>&lt;1</b> | 0        | 0 |
| Lead     | ppm        | ASTM D5185m >2 | <b>&lt;1</b> | 0        | 0 |
| Copper   | ppm        | ASTM D5185m >8 | <b>&lt;1</b> | 0        | 0 |
| Tin      | ppm        | ASTM D5185m >4 | <b>&lt;1</b> | 0        | 0 |
| Vanadium | ppm        | ASTM D5185m    | <b>0</b>     | 0        | 0 |
| Cadmium  | ppm        | ASTM D5185m    | <b>0</b>     | 0        | 0 |

## ADDITIVES

| method     | limit/base | current        | history1     | history2 |    |
|------------|------------|----------------|--------------|----------|----|
| Boron      | ppm        | ASTM D5185m    | <b>0</b>     | 0        | 0  |
| Barium     | ppm        | ASTM D5185m    | <b>0</b>     | 0        | 0  |
| Molybdenum | ppm        | ASTM D5185m    | <b>0</b>     | 0        | 0  |
| Manganese  | ppm        | ASTM D5185m    | <b>&lt;1</b> | 0        | 0  |
| Magnesium  | ppm        | ASTM D5185m    | <b>&lt;1</b> | <1       | 0  |
| Calcium    | ppm        | ASTM D5185m    | <b>0</b>     | 0        | 0  |
| Phosphorus | ppm        | ASTM D5185m    | <b>&lt;1</b> | 0        | <1 |
| Zinc       | ppm        | ASTM D5185m    | <b>0</b>     | 0        | 0  |
| Sulfur     | ppm        | ASTM D5185m 50 | <b>0</b>     | 0        | 0  |

## CONTAMINANTS

| method    | limit/base | current          | history1     | history2 |       |
|-----------|------------|------------------|--------------|----------|-------|
| Silicon   | ppm        | ASTM D5185m >15  | <b>2</b>     | 2        | 1     |
| Sodium    | ppm        | ASTM D5185m      | <b>0</b>     | 0        | 0     |
| Potassium | ppm        | ASTM D5185m >20  | <b>&lt;1</b> | <1       | <1    |
| Water     | %          | ASTM D6304 >0.01 | <b>0.003</b> | 0.003    | 0.005 |
| ppm Water | ppm        | ASTM D6304 >100  | <b>27</b>    | 38.3     | 51.7  |






## FLUID CLEANLINESS

| method          | limit/base             | current         | history1   | history2 |
|-----------------|------------------------|-----------------|------------|----------|
| Particles >4µm  | ASTM D7647 >10000      | <b>6182</b>     | ▲ 12143    | 2784     |
| Particles >6µm  | ASTM D7647 >2500       | <b>2348</b>     | ▲ 5788     | 749      |
| Particles >14µm | ASTM D7647 >320        | <b>28</b>       | 225        | 32       |
| Particles >21µm | ASTM D7647 >80         | <b>1</b>        | 25         | 7        |
| Particles >38µm | ASTM D7647 >20         | <b>0</b>        | 0          | 3        |
| Particles >71µm | ASTM D7647 >4          | <b>0</b>        | 0          | 1        |
| Oil Cleanliness | ISO 4406 (c) >20/18/15 | <b>20/18/12</b> | ▲ 21/20/15 | 19/17/12 |

## FLUID DEGRADATION

| method           | limit/base | current         | history1     | history2 |       |
|------------------|------------|-----------------|--------------|----------|-------|
| Acid Number (AN) | mg KOH/g   | ASTM D974 0.005 | <b>0.014</b> | 0.012    | 0.014 |


# OIL ANALYSIS REPORT

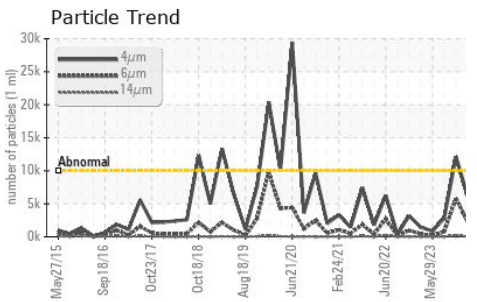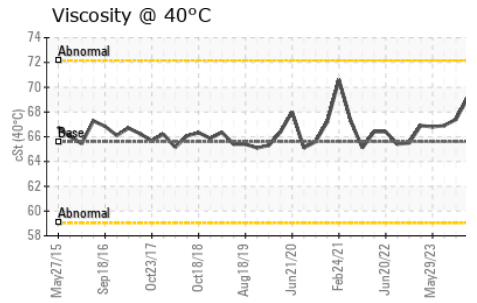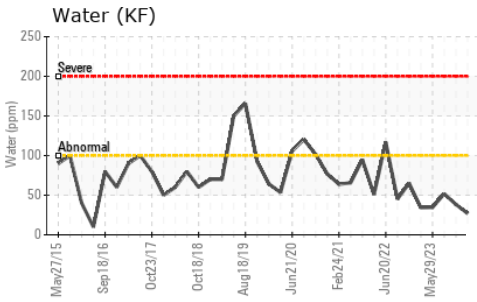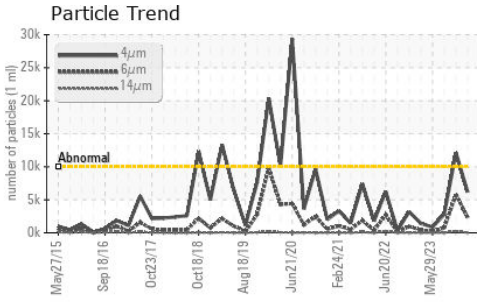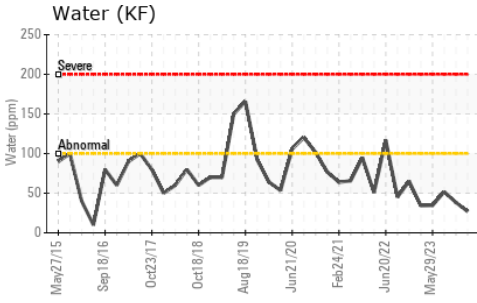






| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.01   | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C      | cSt    | ASTM D445  | 65.6    | 69.1     | 67.4     |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

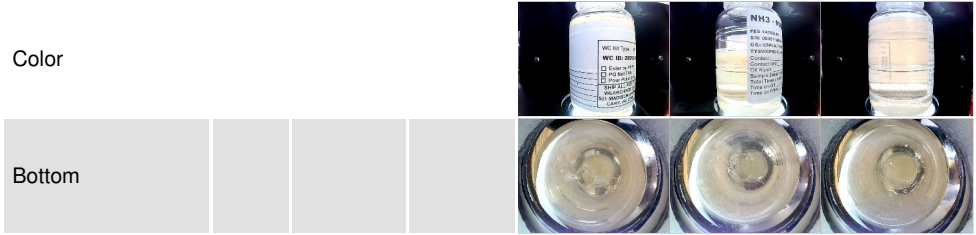

## GRAPHS

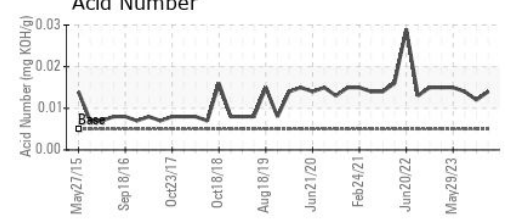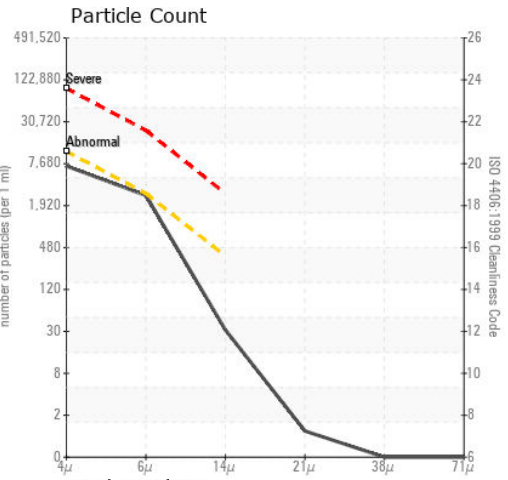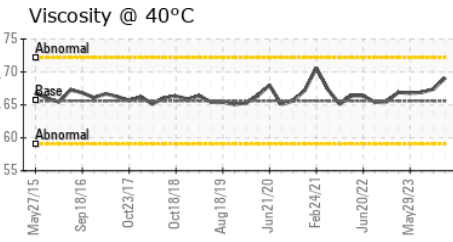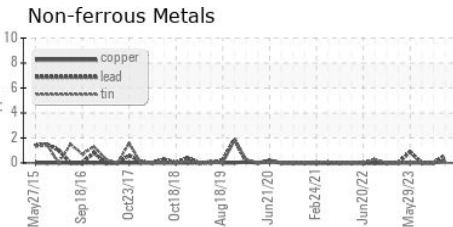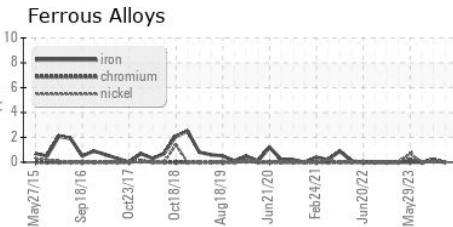

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0007646  
**Lab Number** : 06099192  
**Unique Number** : 10897422  
**Test Package** : IND 2  
**Received** : 23 Feb 2024  
**Tested** : 26 Feb 2024  
**Diagnosed** : 26 Feb 2024 - Doug Bogart

**TYSON -VICKSBURG-USP - TYSVICPRO**  
 1785 INTERPLEX DR  
 VICKSBURG, MS  
 US 39183  
 Contact: RICK DUNN

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: