

OIL ANALYSIS REPORT



ISO

OLD COOLER DISCHARGE CONVEYOR

Gearbox

GEAR OIL FG ISO 220 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0007704		
Sample Date		Client Info		20 Feb 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	22		
Chromium	ppm	ASTM D5185m	>15	0		
Nickel	ppm	ASTM D5185m	>15	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>100	1		
Copper	ppm	ASTM D5185m	>200	، <1		
Tin		ASTM D5185m	>200	<1		
Vanadium	ppm	ASTM D5185m	>20	0		
Cadmium	ppm ppm	ASTM D5185m		0		
ADDITIVES	1-1-	method	limit/base	current	history1	history2
Boron	nnm	ASTM D5185m	5	0		
Barium	ppm ppm	ASTM D5185m	5	0		
		ASTM D5185m		0		
Molybdenum	ppm		5	-		
Manganese	ppm	ASTM D5185m	-	<1		
Magnesium	ppm	ASTM D5185m	5	<1		
Calcium	ppm	ASTM D5185m	12	<1		
Phosphorus	ppm	ASTM D5185m	400	219		
Zinc	ppm	ASTM D5185m	12	19		
Sulfur	ppm	ASTM D5185m	750	12969		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm		>50	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.2	0.002		
ppm Water	ppm	ASTM D6304	>2000	19		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	<u> </u>		
Particles >6µm		ASTM D7647	>5000	<u> </u>		
Particles >14µm		ASTM D7647	>640	48		
Particles >21µm		ASTM D7647	>160	2		
Particles >38µm		ASTM D7647	>40	0		
Particles >71µm		ASTM D7647	>10	0		
Oil Cleanliness		ISO 4406 (c)	>21/19/16	4 24/21/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.275		




Cles

(maa)

Water

Water (

OIL ANALYSIS REPORT

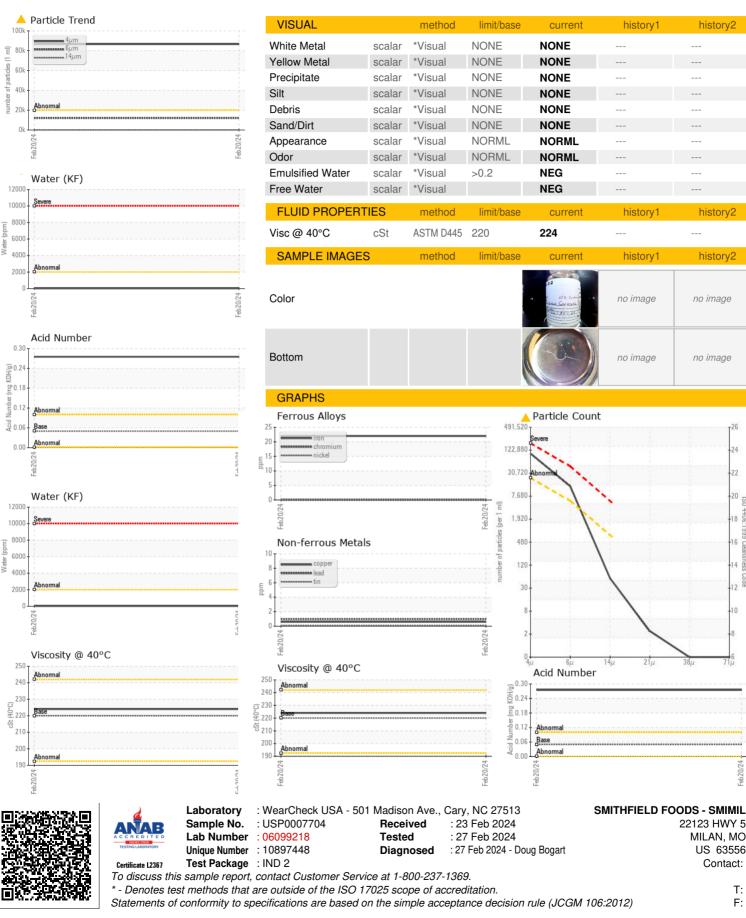

Contact/Location: ? ? - SMIMILMO

214

22123 HWY 5

MILAN, MO

US 63556

Contact:

T:

F:

history2

history2

history2

no image

no image

4406

:1999 Cle

14