




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**SYLV\_U1 SYLV\_U1\_P1**  
Component  
**Non-Drive End Pump**  
Fluid  
**SHELL TELLUS 32 (--- GAL)**

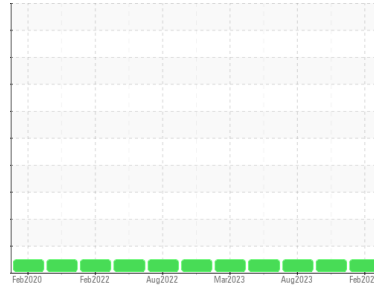

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0036977</b>	RP0027360	RP0027205
Sample Date	Client Info		<b>16 Feb 2024</b>	01 Nov 2023	03 Aug 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<b>7</b>	3	11
Chromium	ppm	ASTM D5185m >5	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m >5	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m >7	<b>&lt;1</b>	2	2
Lead	ppm	ASTM D5185m >12	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185m >30	<b>2</b>	1	4
Tin	ppm	ASTM D5185m >9	<b>&lt;1</b>	<1	1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 11	<b>64</b>	69	60
Calcium	ppm	ASTM D5185m 35	<b>12</b>	12	13
Phosphorus	ppm	ASTM D5185m 259	<b>295</b>	280	278
Zinc	ppm	ASTM D5185m 277	<b>347</b>	349	353

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<b>2</b>	1	3
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	1	<1
Water	%	ASTM D6304 >.1	<b>0.003</b>	0.005	0.005
ppm Water	ppm	ASTM D6304 >1000	<b>26</b>	54.6	53.8




## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.32	<b>0.33</b>	0.30	0.37

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual >.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG

# OIL ANALYSIS REPORT

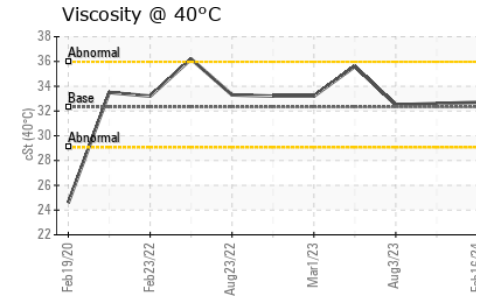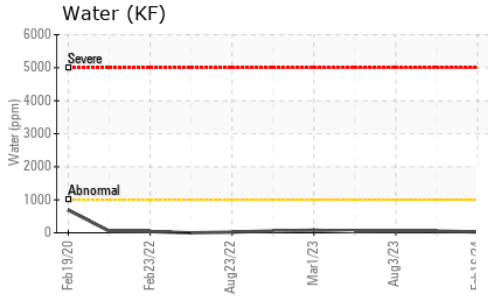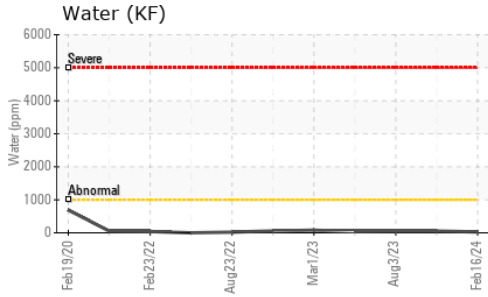


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32.32	<b>32.7</b>	32.6	32.5

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------





Color



Bottom



## GRAPHS

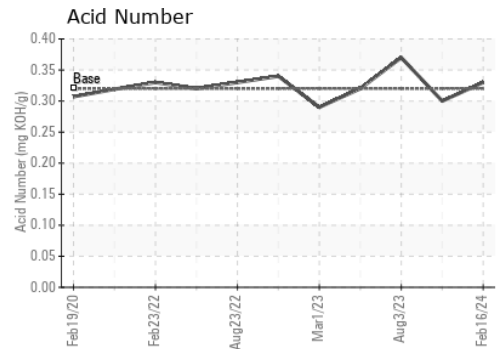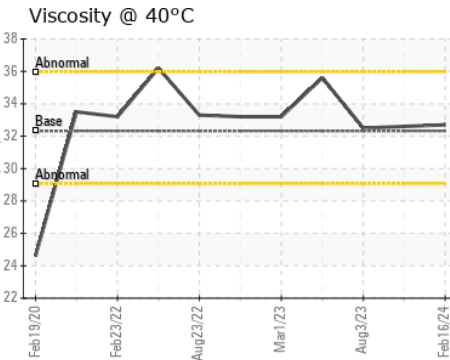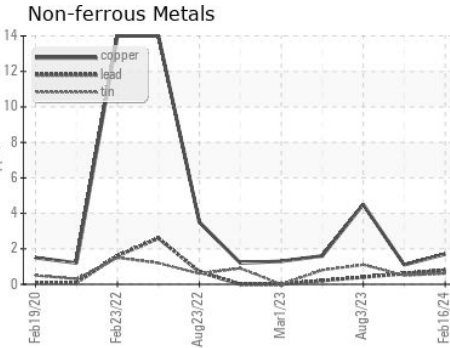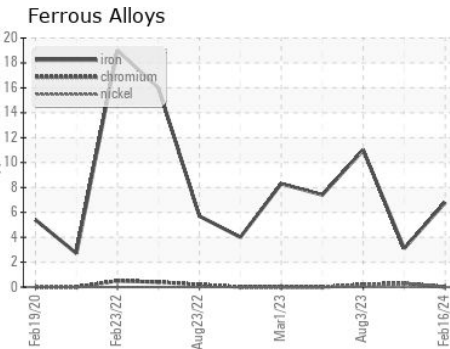

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0036977  
**Lab Number** : **06099237**  
**Unique Number** : 10897467  
**Test Package** : IND 2  
**Received** : 23 Feb 2024  
**Tested** : 27 Feb 2024  
**Diagnosed** : 27 Feb 2024 - Don Baldrige

**ENERGY TRANSFER - SYLVANIA**  
 ROUTE 6  
 SYLVANIA, PA  
 US 16945  
 Contact: JERRY HIGGINS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (610)858-3838

F: