




OIL ANALYSIS REPORT

Sample Rating Trend

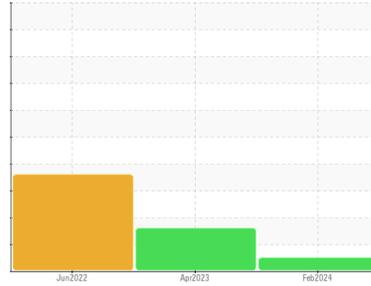

Machine Id
5560200 (S/N 1968)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA011778	KCP54148	KCP49581
Sample Date	Client Info			21 Feb 2024	11 Apr 2023	24 Jun 2022
Machine Age	hrs	Client Info		11176	3547	16
Oil Age	hrs	Client Info		0	3000	0
Oil Changed	Client Info			N/A	Changed	Changed
Sample Status				NORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	<1	<1
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	1
Barium	ppm	ASTM D5185m	90	20	43	27
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	100	29	84	19
Calcium	ppm	ASTM D5185m	0	0	3	<1
Phosphorus	ppm	ASTM D5185m	0	0	5	6
Zinc	ppm	ASTM D5185m	0	0	18	4
Sulfur	ppm	ASTM D5185m	23500	16723	24292	18935

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	2	1
Sodium	ppm	ASTM D5185m		8	19	1
Potassium	ppm	ASTM D5185m	>20	0	2	0
Water	%	ASTM D6304	>0.05	0.012	0.023	▲ 0.466
ppm Water	ppm	ASTM D6304	>500	122	236.4	▲ 4660

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1804	29189	---
Particles >6µm		ASTM D7647	>1300	453	▲ 9351	---
Particles >14µm		ASTM D7647	>80	36	▲ 322	---
Particles >21µm		ASTM D7647	>20	10	▲ 66	---
Particles >38µm		ASTM D7647	>4	0	2	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	18/16/12	▲ 22/20/16	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.38	0.37	0.20


OIL ANALYSIS REPORT

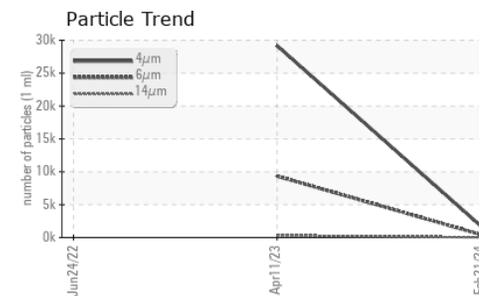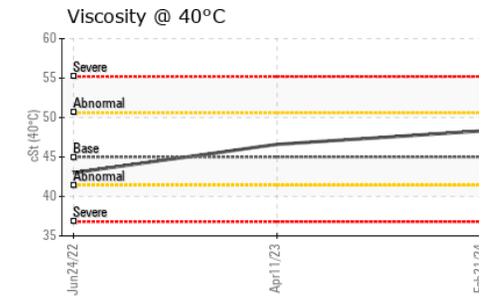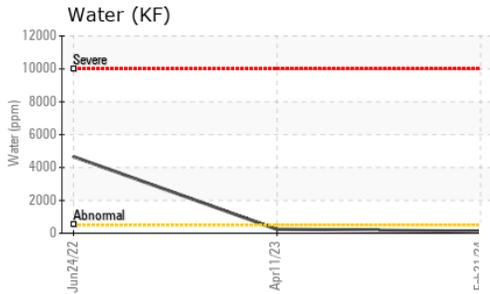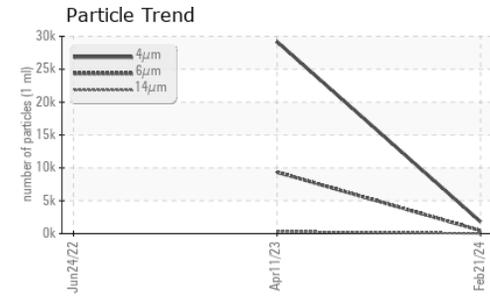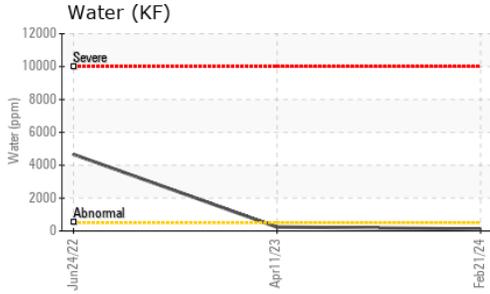





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	48.3	46.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

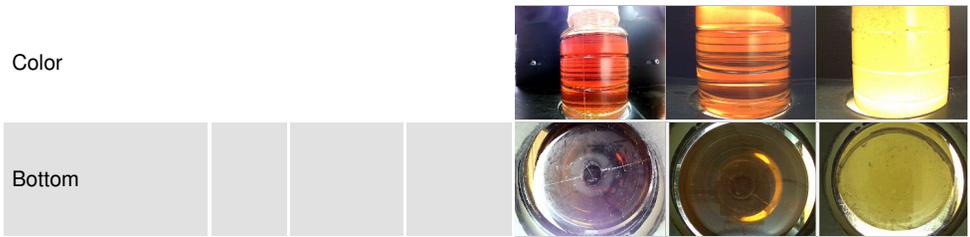

GRAPHS

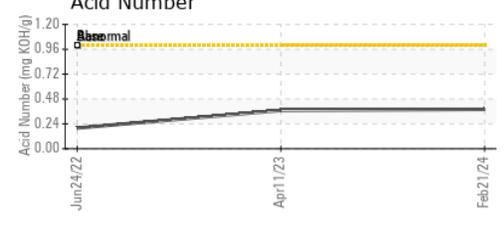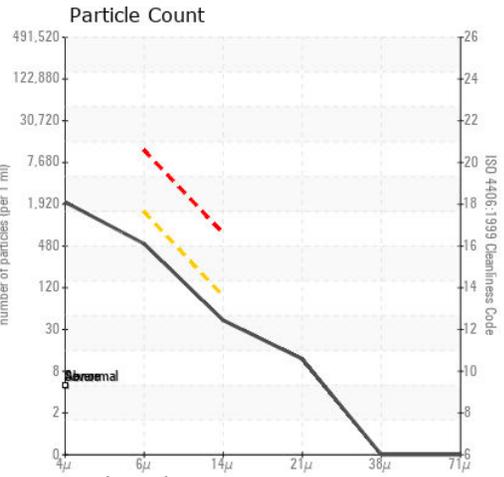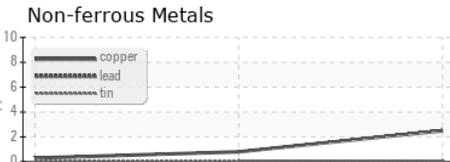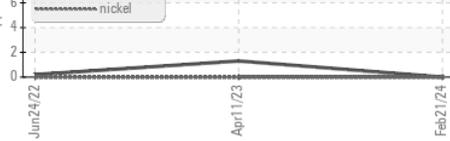

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA011778 **Received** : 26 Feb 2024
Lab Number : 06100141 **Tested** : 27 Feb 2024
Unique Number : 10898371 **Diagnosed** : 28 Feb 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

VIAIT MEDICAL
 45531 NORTH PORT LOOP W
 FREMONT, CA
 US 94538
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: