


Area  
**PALEXTRA 44 [8015398]**  
Machine Id  
**SULLIVAN PALATEK 20CE001067 - B&G**  
Component  
**Compressor**

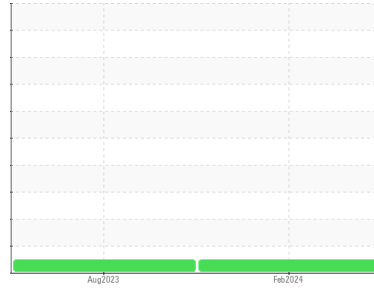

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCS06100219</b>	UCS05936236	---
Sample Date	Client Info			<b>16 Feb 2024</b>	22 Aug 2023	---
Machine Age	hrs	Client Info		<b>15489</b>	13014	---
Oil Age	hrs	Client Info		<b>7489</b>	5961	---
Oil Changed	Client Info			<b>Changed</b>	Not Changd	---
Sample Status				<b>NORMAL</b>	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	---


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m		<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>1</b>	1	---
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	0.3	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	0.3	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	0.4	<b>0</b>	<1	---
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	689	<b>610</b>	638	---
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m	1237	<b>684</b>	889	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	2	---
Sodium	ppm	ASTM D5185m		<b>6</b>	2	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.135	<b>0.19</b>	0.19	---


# OIL ANALYSIS REPORT

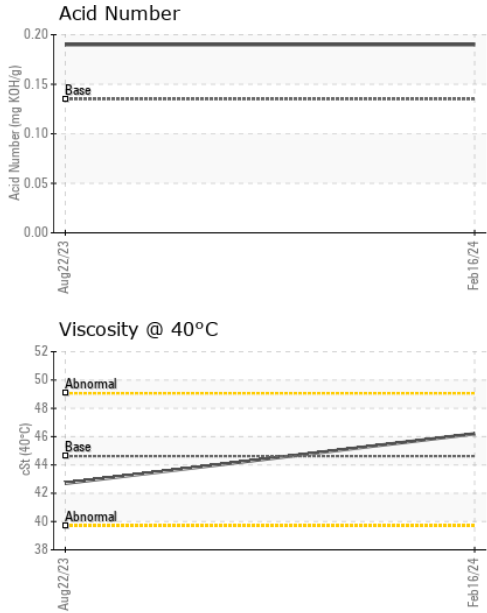





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	MODER	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.62	<b>46.2</b>	42.7	---

**SAMPLE IMAGES**

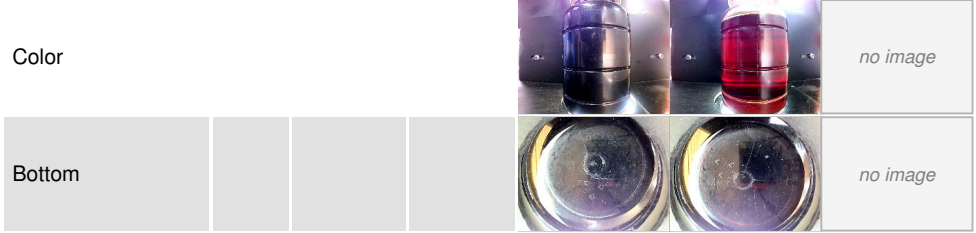

**GRAPHS**

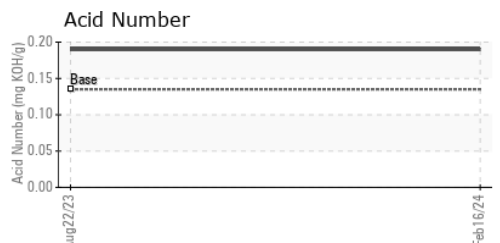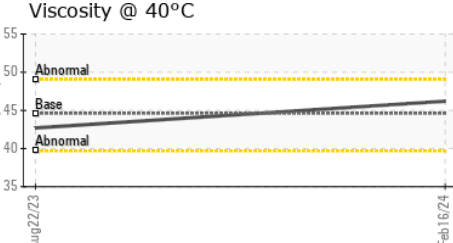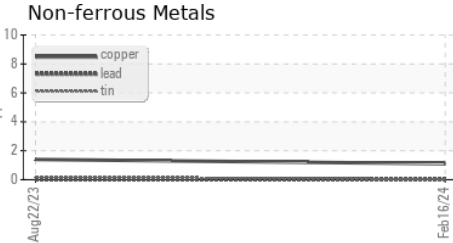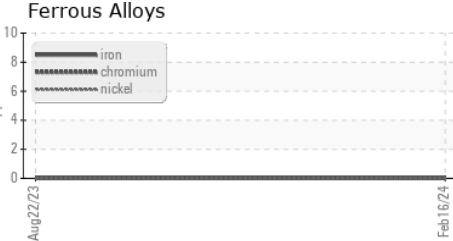

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06100219      **Received** : 26 Feb 2024  
**Lab Number** : 06100219      **Tested** : 27 Feb 2024  
**Unique Number** : 10898449      **Diagnosed** : 28 Feb 2024 - Jonathan Hester  
**Test Package** : IND 2

**SULLIVAN PALATEK**  
 1201 US HWY 20 WEST  
 MICHIGAN CITY, IN  
 US 46360

Contact: RICHARD MILTENBERGER  
 RMILTENBERGER@PALATEK.COM

T: (219)229-1964  
 F: (219)878-8543

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)