OIL ANALYSIS REPORT

Sample Rating Trend

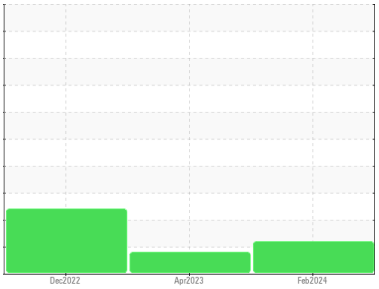

ISO

Area
COMPRESSOR STATIONS/RED HILLS EAST AREA
Machine Id
CABALLO (S/N 5629X2455)
Component
Compressor
Fluid
TULCO LUBSOIL LPG WS 150 (--- GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**TO60002083**	TO60000848	TO70000201
Sample Date		Client Info		**25 Feb 2024**	12 Apr 2023	20 Dec 2022
Machine Age	hrs	Client Info		**0**	30705	28172
Oil Age	hrs	Client Info		**0**	30705	22288
Oil Changed		Client Info		**N/A**	Filtered	Filtered
Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**3**	▲ 59	23
Chromium	ppm	ASTM D5185m	>10	**<1**	<1	0
Nickel	ppm	ASTM D5185m		**<1**	<1	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>25	**2**	0	<1
Lead	ppm	ASTM D5185m	>25	**0**	0	<1
Copper	ppm	ASTM D5185m	>50	**<1**	<1	0
Tin	ppm	ASTM D5185m	>15	**0**	1	2
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**0**	2	0
Barium	ppm	ASTM D5185m	0	**8**	0	0
Molybdenum	ppm	ASTM D5185m	0	**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	<1	<1
Magnesium	ppm	ASTM D5185m	0	**<1**	4	1
Calcium	ppm	ASTM D5185m	0	**2**	5	1
Phosphorus	ppm	ASTM D5185m	0	**92**	162	62
Zinc	ppm	ASTM D5185m	0	**27**	10	5
Sulfur	ppm	ASTM D5185m	0	**2848**	1754	1231

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**0**	0	<1
Sodium	ppm	ASTM D5185m		**22**	9	5
Potassium	ppm	ASTM D5185m	>20	**4**	2	<1
Water	%	ASTM D6304	>2.26	**0.613**	0.845	0.475
ppm Water	ppm	ASTM D6304	>22600	**6136**	8450	4750

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	● **11197**	2542	▲ 61284
Particles >6µm		ASTM D7647	>1300	▲ **3151**	692	▲ 16416
Particles >14µm		ASTM D7647	>320	**191**	46	▲ 1151
Particles >21µm		ASTM D7647	>80	**37**	12	▲ 310
Particles >38µm		ASTM D7647	>20	**6**	0	▲ 21
Particles >71µm		ASTM D7647	>4	**4**	0	3
Oil Cleanliness		ISO 4406 (c)	>20/17/15	▲ **21/19/15**	19/17/13	▲ 23/21/17

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.73**	0.76	0.43

OIL ANALYSIS REPORT

Particle Trend

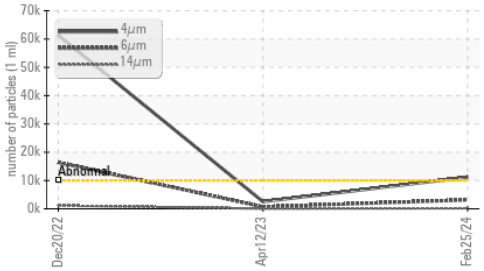

Water (KF)

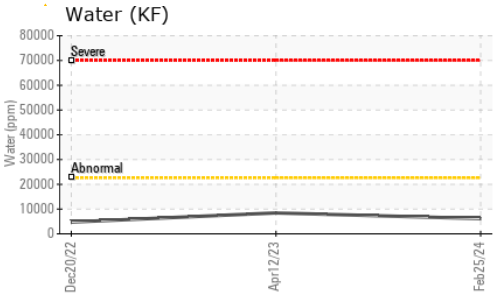

Viscosity @ 100°C

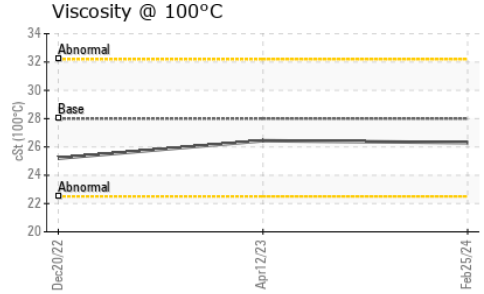

Water (KF)

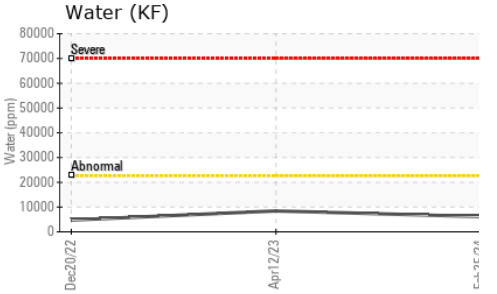

Viscosity @ 100°C

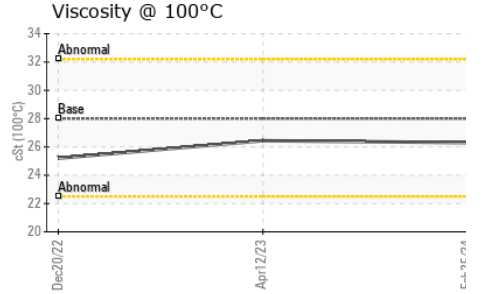

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>2.26	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	151	**148**	133	142
Visc @ 100°C	cSt	ASTM D445	28	**26.3**	26.44	25.2
Viscosity Index (VI)	Scale	ASTM D2270	224	**214**	235	212

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

Ferrous Alloys

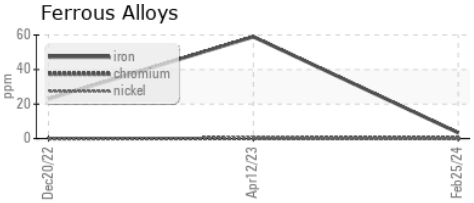

Non-ferrous Metals

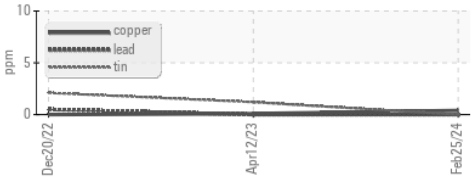

Viscosity @ 40°C

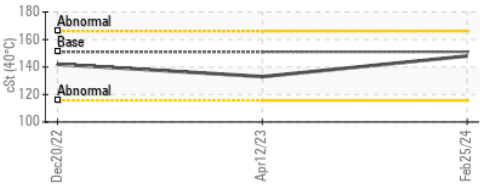

Particle Count

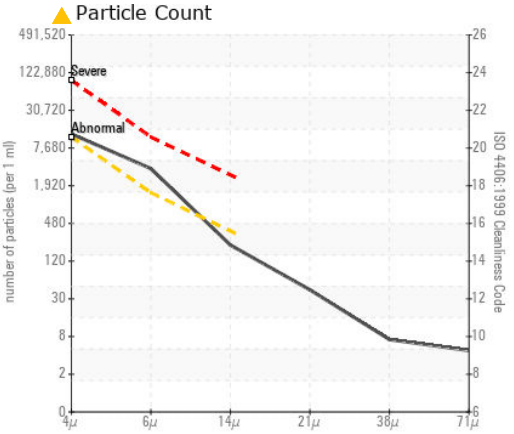

Acid Number

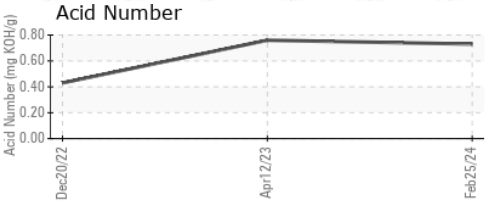

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60002083 **Received** : 26 Feb 2024
Lab Number : 06100905 **Tested** : 27 Feb 2024
Unique Number : 10899135 **Diagnosed** : 28 Feb 2024 - Don Baldridge
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MIDLAND - EOG RESOURCES INC.
5509 CHAMPIONS DRIVE
MIDLAND, TX
US 79706
Contact: HERMAN GARZA
herman_garza@eogresources.com
T: (432)686-3600
F: